



PLUMMER

1107-001-01

March 4, 2020

Texas Commission on Environmental Quality
Applications Review and Processing Team
Building F, Room 2101
12100 Park 35 Circle
Austin, Texas 78753

Re: City of Laredo (CN600131908)
Columbia Bridge Wastewater Treatment Facility (RN101607984)
Application for Renewal of Texas Pollutant Discharge Elimination System (TPDES) Permit No.
WQ0010681006

To Whom It May Concern:

On behalf of the City of Laredo, Plummer submits one original and three copies of a renewal application for the above-referenced permit. The application fee of \$315.00 for the Domestic Wastewater Permit Application and has been submitted to the Texas Commission on Environmental Quality Cashier's Office (MC-214) under a separate cover.

Please feel free to contact me at tkoenings@plummer.com, (512) 687-2148, if you have any questions regarding this submittal.

Sincerely,

PLUMMER
TBPE Firm Registration No. F-13

Tres Koenings
Senior Project Manager

Enclosures: Permit Renewal Application (1 original, 3 copies)

cc: Jose Chavarria, City of Laredo
Carl Scruggs, City of Laredo

RECEIVED
MAR 04 2020
Water Quality Applications Team
Lk Thon



CITY OF LAREDO, TEXAS

TPDES PERMIT NO. WQ0010681006 COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY TPDES PERMIT RENEWAL APPLICATION

SUBMITTED TO:

TEXAS COMMISSION
ON ENVIRONMENTAL QUALITY

MARCH 2020



PLUMMER

1107-001-01

**CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

TABLE OF CONTENTS

I. ADMINISTRATIVE REPORT

Domestic Administrative Report 1.0
Supplemental Permit Information Form (SPIF)

II. TECHNICAL REPORT

Domestic Technical Report 1.0
Domestic Worksheet 2.0
Domestic Worksheet 3.0
Domestic Worksheet 6.0

III. ATTACHMENTS

<u>No.</u>	<u>Description</u>	<u>Reference</u>
A	Core Data Form	Admin Rpt 1.0 Section 3.C
B	U.S. Geological Survey Map	Admin Rpt 1.0 Section 13
C	Treatment Process Description	Tech Rpt. 1.0 Section 2.A
D	List of Treatment Units	Tech Rpt. 1.0 Section 2.B
E	Process Flow Diagram	Tech Rpt. 1.0 Section 2.C
F	Site Drawing	Tech Rpt. 1.0 Section 4
G	Effluent and Soil Analyses	Tech Rpt. 1.0 Section 7
H	Sludge Transportation Agreement	Tech Rpt. 1.0 Section 9
I	Cropping Plan Justification	Wksht 3.0 Section 5
J	Effluent Monitoring Data	Wksht 3.0 Section 9
K	Effluent Parameters Above the MAL	Wksht 6.0 Section 2.C



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

**DOMESTIC WASTEWATER PERMIT APPLICATION
CHECKLIST**

Complete and submit this checklist with the application.

APPLICANT: City of Laredo

PERMIT NUMBER: WQ0010681006

Indicate if each of the following items is included in your application.

	Y	N		Y	N
Administrative Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original USGS Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Administrative Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Affected Landowners Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
SPIF	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Landowner Disk or Labels	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Core Data Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Buffer Zone Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Technical Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Flow Diagram	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Technical Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site Drawing	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 2.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original Photographs	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 2.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Design Calculations	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Solids Management Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Water Balance	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.2	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 3.3	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 4.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 5.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 6.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 7.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>			

For TCEQ Use Only

Segment Number _____ County _____
Expiration Date _____ Region _____
Permit Number _____



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

APPLICATION FOR A DOMESTIC WASTEWATER PERMIT

ADMINISTRATIVE REPORT 1.0

If you have questions about completing this form please contact the Applications Review and Processing Team at 512-239-4671.

Section 1. Application Fees (Instructions Page 29)

Indicate the amount submitted for the application fee (check only one).

Flow	New/Major Amendment	Renewal
<0.05 MGD	\$350.00 <input type="checkbox"/>	\$315.00 <input checked="" type="checkbox"/>
≥0.05 but <0.10 MGD	\$550.00 <input type="checkbox"/>	\$515.00 <input type="checkbox"/>
≥0.10 but <0.25 MGD	\$850.00 <input type="checkbox"/>	\$815.00 <input type="checkbox"/>
≥0.25 but <0.50 MGD	\$1,250.00 <input type="checkbox"/>	\$1,215.00 <input type="checkbox"/>
≥0.50 but <1.0 MGD	\$1,650.00 <input type="checkbox"/>	\$1,615.00 <input type="checkbox"/>
≥1.0 MGD	\$2,050.00 <input type="checkbox"/>	\$2,015.00 <input type="checkbox"/>

Minor Amendment (for any flow) \$150.00 ☐

Payment Information:

Mailed Check/Money Order Number: 109181

Check/Money Order Amount: \$315.00

Name Printed on Check: Plummer

EPAY Voucher Number: N/A

Copy of Payment Voucher enclosed? Yes ☐

Section 2. Type of Application (Instructions Page 29)

- | | |
|---|---|
| <input type="checkbox"/> New TPDES | <input type="checkbox"/> New TLAP |
| <input type="checkbox"/> Major Amendment <u>with</u> Renewal | <input type="checkbox"/> Minor Amendment <u>with</u> Renewal |
| <input type="checkbox"/> Major Amendment <u>without</u> Renewal | <input type="checkbox"/> Minor Amendment <u>without</u> Renewal |
| <input checked="" type="checkbox"/> Renewal without changes | <input type="checkbox"/> Minor Modification of permit |

For amendments or modifications, describe the proposed changes: N/A

For existing permits:

Permit Number: WQ0010681006

EPA I.D. (TPDES only): TX0107395

Expiration Date: September 1, 2020

Section 3. Facility Owner (Applicant) and Co-Applciant Information (Instructions Page 29)

A. The owner of the facility must apply for the permit.

What is the Legal Name of the entity (applicant) applying for this permit?

City of Laredo

(The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal documents forming the entity.)

If the applicant is currently a customer with the TCEQ, what is the Customer Number (CN)? You may search for your CN on the TCEQ website at <http://www15.tceq.texas.gov/crpub/>

CN: 600131908

What is the name and title of the person signing the application? The person must be an executive official meeting signatory requirements in 30 TAC § 305.44.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Robert Eads

Credential (P.E, P.G., Ph.D., etc.): ICMA-CM

Title: Interim Co-City Manager

B. Co-applciant information. Complete this section only if another person or entity is required to apply as a co-permittee.

What is the Legal Name of the co-applciant applying for this permit?

N/A

(The legal name must be spelled exactly as filed with the TX SOS, with the County, or in the legal documents forming the entity.)

If the co-applciant is currently a customer with the TCEQ, what is the Customer Number (CN)? You may search for your CN on the TCEQ website at:

<http://www15.tceq.texas.gov/crpub/>

CN: N/A

What is the name and title of the person signing the application? The person must be an executive official meeting signatory requirements in 30 TAC § 305.44.

Prefix (Mr., Ms., Miss): N/A

First and Last Name: N/A

Credential (P.E, P.G., Ph.D., etc.): N/A

Title: N/A

Provide a brief description of the need for a co-permittee: N/A

C. Core Data Form

Complete the Core Data Form for each customer and include as an attachment. If the customer type selected on the Core Data Form is **Individual**, complete **Attachment 1** of Administrative Report 1.0.

Attachment: A

Section 4. Application Contact Information (Instructions Page 30)

This is the person(s) TCEQ will contact if additional information is needed about this application. Provide a contact for administrative questions and technical questions.

A. Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Riazul I. Mia

Credential (P.E, P.G., Ph.D., etc.): P.E., CFM

Title: Utilities Director

Organization Name: City of Laredo

Mailing Address: 5816 Daugherty Ave.

City, State, Zip Code: Laredo, TX 78041

Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001

E-mail Address: rmia@ci.laredo.tx.us

Check one or both: ☒ Administrative Contact ☒ Technical Contact

B. Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Tres Koenings

Credential (P.E, P.G., Ph.D., etc.):

Title: Senior Project Manager

Organization Name: Plummer Associates, Inc.

Mailing Address: 6300 La Calma Dr, Ste 400

City, State, Zip Code: Austin, TX 78752

Phone No.: (512) 687-2148 Ext.: N/A Fax No.: (512) 452-2325

E-mail Address: tkoenings@plummer.com

Check one or both: ☒ Administrative Contact ☒ Technical Contact

Section 5. Permit Contact Information (Instructions Page 30)

Provide two names of individuals that can be contacted throughout the permit term.

A. Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Riazul I. Mia
Credential (P.E, P.G., Ph.D., etc.): P.E., CFM
Title: Utilities Director
Organization Name: City of Laredo
Mailing Address: 5816 Daugherty Ave.
City, State, Zip Code: Laredo, TX 78041
Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001
E-mail Address: rmia@ci.laredo.tx.us

B. Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Michael Rodgers
Credential (P.E, P.G., Ph.D., etc.):
Title: Assistant Utilities Director
Organization Name: City of Laredo
Mailing Address: 5816 Daugherty Ave.
City, State, Zip Code: Laredo, TX 78041
Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001
E-mail Address: mrodgers@ci.laredo.tx.us

Section 6. Billing Information (Instructions Page 30)

The permittee is responsible for paying the annual fee. The annual fee will be assessed to permits ***in effect on September 1 of each year***. The TCEQ will send a bill to the address provided in this section. The permittee is responsible for terminating the permit when it is no longer needed (using form TCEQ-20029).

Prefix (Mr., Ms., Miss): Mr.
First and Last Name: Riazul I. Mia
Credential (P.E, P.G., Ph.D., etc.): P.E., CFM
Title: Utilities Director
Organization Name: City of Laredo
Mailing Address: 5816 Daugherty Ave.
City, State, Zip Code: Laredo, TX 78041
Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001
E-mail Address: rmia@ci.laredo.tx.us

Section 7. DMR/MER Contact Information (Instructions Page 31)

Provide the name and complete mailing address of the person delegated to receive and submit Discharge Monitoring Reports (EPA 3320-1) or maintain Monthly Effluent Reports.

Prefix (Mr., Ms., Miss): Mr.
First and Last Name: Riazul I. Mia
Credential (P.E, P.G., Ph.D., etc.): P.E., CFM
Title: Utilities Director
Organization Name: City of Laredo
Mailing Address: 5816 Daugherty Ave.
City, State, Zip Code: Laredo, TX 78041
Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001
E-mail Address: rmia@ci.laredo.tx.us

DMR data is required to be submitted electronically. Create an account at:
<https://www.tceq.texas.gov/permitting/netdmr/netdmr.html>.

Section 8. Public Notice Information (Instructions Page 31)

A. Individual Publishing the Notices

Prefix (Mr., Ms., Miss): Mr.
First and Last Name: Tres Koenings
Credential (P.E, P.G., Ph.D., etc.):
Title: Senior Project Manager
Organization Name: Plummer Associates, Inc.
Mailing Address: 6300 La Calma Dr, Ste 400
City, State, Zip Code: Austin, TX 78752
Phone No.: (512) 687-2148 Ext.: N/A Fax No.: (512) 452-2325
E-mail Address: tkoenings@plummer.com

B. Method for Receiving Notice of Receipt and Intent to Obtain a Water Quality Permit Package

Indicate by a check mark the preferred method for receiving the first notice and instructions:

- ☒ E-mail Address tkoenings@plummer.com
☐ Fax
☐ Regular Mail

C. Contact person to be listed in the Notices

Prefix (Mr., Ms., Miss): Mr.
First and Last Name: Riazul I. Mia

Credential (P.E, P.G., Ph.D., etc.): P.E., CFM

Title: Utilities Director

Organization Name: City of Laredo

Phone No.: (956) 721-2000 Ext.: N/A

E-mail: rmia@ci.laredo.tx.us

D. Public Viewing Information

If the facility or outfall is located in more than one county, a public viewing place for each county must be provided.

Public building name: Joe A. Guerra Laredo Public Library

Location within the building: First Floor Reference Desk

Physical Address of Building: 1120 E. Calton Rd.

City: Laredo

County: Webb

Contact Name: Maria G. Soliz

Phone No.: (956) 795-2400 Ext.: 2222

E. Bilingual Notice Requirements:

This information **is required** for **new, major amendment, and renewal applications**. It is not required for minor amendment or minor modification applications.

This section of the application is only used to determine if alternative language notices will be needed. Complete instructions on publishing the alternative language notices will be in your public notice package.

Please call the bilingual/ESL coordinator at the nearest elementary and middle schools and obtain the following information to determine whether an alternative language notices are required.

1. Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility?

☒ Yes ☐ No

If **no**, publication of an alternative language notice is not required; **skip to** Section 9 below.

2. Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?

☒ Yes ☐ No

3. Do the students at these schools attend a bilingual education program at another location?

☐ Yes ☒ No

4. Would the school be required to provide a bilingual education program but the school has waived out of this requirement under 19 TAC §89.1205(g)?
- ☐ Yes ☒ No
5. If the answer is yes to question 1, 2, 3, or 4, public notices in an alternative language are required. Which language is required by the bilingual program? Spanish

Section 9. Regulated Entity and Permitted Site Information (Instructions Page 33)

- A. If the site is currently regulated by TCEQ, provide the Regulated Entity Number (RN) issued to this site. RN101607984

Search the TCEQ's Central Registry at <http://www15.tceq.texas.gov/crpub/> to determine if the site is currently regulated by TCEQ.

- B. Name of project or site (the name known by the community where located):

Columbia Bridge Wastewater Treatment Facility

- C. Owner of treatment facility: City of Laredo

Ownership of Facility: ☒ Public ☐ Private ☐ Both ☐ Federal

- D. Owner of land where treatment facility is or will be:

Prefix (Mr., Ms., Miss):

First and Last Name: City of Laredo

Mailing Address: 5816 Daugherty Ave.

City, State, Zip Code: Laredo, TX 78041

Phone No.: (956) 721-2000

E-mail Address: rmia@ci.laredo.tx.us

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: N/A

- E. Owner of effluent disposal site:

Prefix (Mr., Ms., Miss): N/A

First and Last Name: N/A

Mailing Address: N/A

City, State, Zip Code: N/A

Phone No.: N/A

E-mail Address: N/A

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: N/A

- F. Owner of sewage sludge disposal site (if authorization is requested for sludge disposal on property owned or controlled by the applicant):

Prefix (Mr., Ms., Miss): N/A

First and Last Name: N/A

Mailing Address: N/A

City, State, Zip Code: N/A

Phone No.: N/A

E-mail Address: N/A

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: N/A

Section 10. TPDES Discharge Information (Instructions Page 34)

- A. Is the wastewater treatment facility location in the existing permit accurate?

☒ Yes ☐ No

If **no**, or a new permit application, please give an accurate description:

N/A

- B. Are the point(s) of discharge and the discharge route(s) in the existing permit correct?

☒ Yes ☐ No

If **no**, or a new or amendment permit application, provide an accurate description of the point of discharge and the discharge route to the nearest classified segment as defined in 30 TAC Chapter 307:

N/A

City nearest the outfall(s): Laredo

County in which the outfalls(s) is/are located: Webb

Outfall Latitude: 27° 41' 35.89"

Longitude: - 99° 44' 16.38"

- C. Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?

☐ Yes ☒ No

If **yes**, indicate by a check mark if:

☐ Authorization granted ☐ Authorization pending N/A

For **new and amendment** applications, provide copies of letters that show proof of contact and the approval letter upon receipt.

Attachment: N/A

- D. For all applications involving an average daily discharge of 5 MGD or more, provide the names of all counties located within 100 statute miles downstream of the point(s) of discharge.

N/A

Section 11. TLAP Disposal Information (Instructions Page 36)

- A. For TLAPs, is the location of the effluent disposal site in the existing permit accurate?

☒ Yes ☐ No

If **no**, or a new or amendment permit application, provide an accurate description of the disposal site location:

N/A

- B. City nearest the disposal site: Laredo

- C. County in which the disposal site is located: Webb

- D. Disposal Site Latitude: 27° 41' 36.05" Longitude: -99° 44' 11.54"

- E. For TLAPs, describe the routing of effluent from the treatment facility to the disposal site:

No routing of the effluent has been undertaken: Although authorized in the TPDES permit, land application of the effluent has never commenced

- F. For TLAPs, please identify the nearest watercourse to the disposal site to which rainfall runoff might flow if not contained:

Rio Grande Below Amistad Reservoir in Segment No. 2304

Section 12. Miscellaneous Information (Instructions Page 37)

- A. Is the facility located on or does the treated effluent cross American Indian Land?

☐ Yes ☒ No

- B. If the existing permit contains an onsite sludge disposal authorization, is the location of the sewage sludge disposal site in the existing permit accurate?

☐ Yes ☐ No ☒ Not Applicable

If No, or if a new onsite sludge disposal authorization is being requested in this permit

application, provide an accurate location description of the sewage sludge disposal site.

N/A

- C. Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?

☒ Yes ☐ No

If yes, list each person formerly employed by the TCEQ who represented your company and was paid for service regarding the application:

Tres Koenings, Plummer Associates, Inc.

- D. Do you owe any fees to the TCEQ?

☐ Yes ☒ No

If **yes**, provide the following information:

Account number: N/A

Amount past due: N/A

- E. Do you owe any penalties to the TCEQ?

☐ Yes ☒ No

If **yes**, please provide the following information:

Enforcement order number: N/A

Amount past due: N/A

Section 13. Attachments (Instructions Page 38)

Indicate which attachments are included with the Administrative Report. Check all that apply:

- ☒ Lease agreement or deed recorded easement, if the land where the treatment facility is located or the effluent disposal site are not owned by the applicant or co-applicant.
- ☒ Original full-size USGS Topographic Map with the following information:
 - Applicant's property boundary See Attachment B
 - Treatment facility boundary
 - Labeled point of discharge for each discharge point (TPDES only)
 - Highlighted discharge route for each discharge point (TPDES only)
 - Onsite sewage sludge disposal site (if applicable)
 - Effluent disposal site boundaries (TLAP only)
 - New and future construction (if applicable)
 - 1 mile radius information
 - 3 miles downstream information (TPDES only)
 - All ponds.

- ☐ Attachment 1 for Individuals as co-applicants
- ☒ Other Attachments. Please specify: See Table of Attachments

Section 14. Signature Page (Instructions Page 39)

If co-applicants are necessary, each entity must submit an original, separate signature page.

Permit Number: WQ0010681006

Applicant: City of Laredo

Certification:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.


I further certify that I am authorized under 30 Texas Administrative Code § 305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signatory name (typed or printed): Robert A Eads, ICMA-CM

Signatory title: Interim Co-City Manager

Signature:  Date: 2/19/2020
(Use blue ink)

Subscribed and Sworn to before me by the said Robert A. Eads
on this 19 day of February, 20 20.
My commission expires on the 21 day of February, 20 22.


Notary Public

[SEAL]


County, Texas

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

FOR AGENCIES REVIEWING DOMESTIC TPDES WASTEWATER PERMIT APPLICATIONS

TCEQ USE ONLY:

Application type: ____Renewal ____Major Amendment ____Minor Amendment ____New

County: _____ Segment Number: _____

Admin Complete Date: _____

Agency Receiving SPIF:

____ Texas Historical Commission

____ U.S. Fish and Wildlife

____ Texas Parks and Wildlife Department

____ U.S. Army Corps of Engineers

This form applies to TPDES permit applications only. (Instructions, Page 53)

The SPIF must be completed as a separate document. The TCEQ will mail a copy of the SPIF to each agency as required by the TCEQ agreement with EPA. If any of the items are not completely addressed or further information is needed, you will be contacted to provide the information before the permit is issued. Each item must be completely addressed.

Do not refer to a response of any item in the permit application form. Each attachment must be provided with this form separately from the administrative report of the application. The application will not be declared administratively complete without this form being completed in its entirety including all attachments.

The following applies to all applications:

1. Permittee: City of Laredo

Permit No. WQ00 10681006

EPA ID No. TX 0107395

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

Approximately 1.1 mile southwest of Farm-to-Market Road 1472 and State Highway 255 on an unnamed country road and 10.5 miles west-northwest of Farm-to-Market Roads 1472 and 3338, adjacent to the Rio Grande in Webb County, Texas 78045

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Riazul I. Mia

Credential (P.E, P.G., Ph.D., etc.): P.E., CFM

Title: Utilities Director

Mailing Address: 5816 Daugherty Ave.

City, State, Zip Code: Laredo, TX 78041

Phone No.: (956) 721-2000 Ext.: N/A Fax No.: (956) 721-2001

E-mail Address: rmia@ci.laredo.tx.us

2. List the county in which the facility is located: Webb
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

N/A

4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

Directly to Rio Grande Below Amistad Reservoir in Segment No. 2304 of the Rio Grande Basin

5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report). See SPIF 1 and SPIF 2

Provide original photographs of any structures 50 years or older on the property.

Does your project involve any of the following? Check all that apply.

- ☐ Proposed access roads, utility lines, construction easements
- ☐ Visual effects that could damage or detract from a historic property's integrity
- ☐ Vibration effects during construction or as a result of project design
- ☒ Additional phases of development that are planned for the future
- ☐ Sealing caves, fractures, sinkholes, other karst features

☐ Disturbance of vegetation or wetlands

6. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):

To Be Determined

7. Describe existing disturbances, vegetation, and land use:

Existing land use is typical of a wastewater treatment facility of this size.

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

8. List construction dates of all buildings and structures on the property:

N/A

9. Provide a brief history of the property, and name of the architect/builder, if known.

N/A





PLUMMER




N.T.S.

WEBB COUNTY

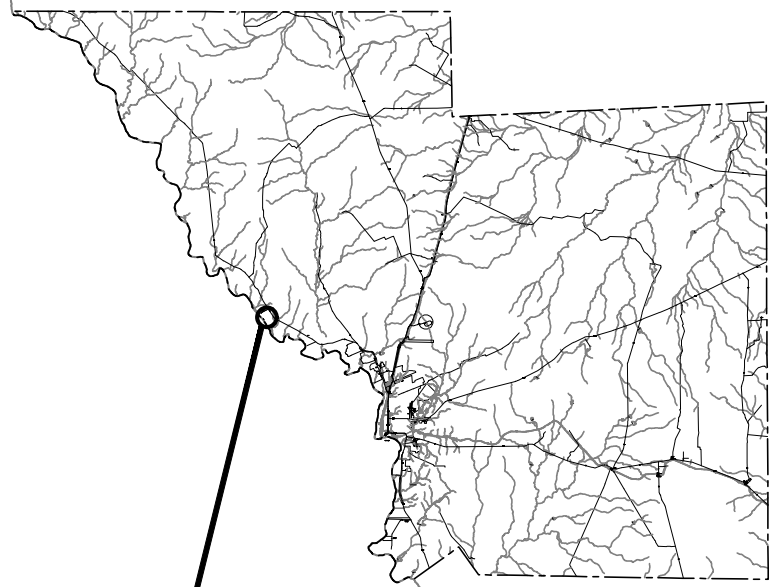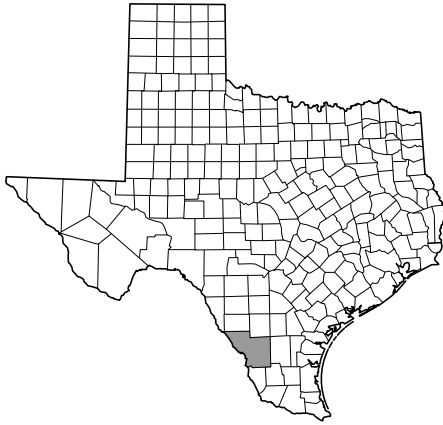

PROJECT
SITE

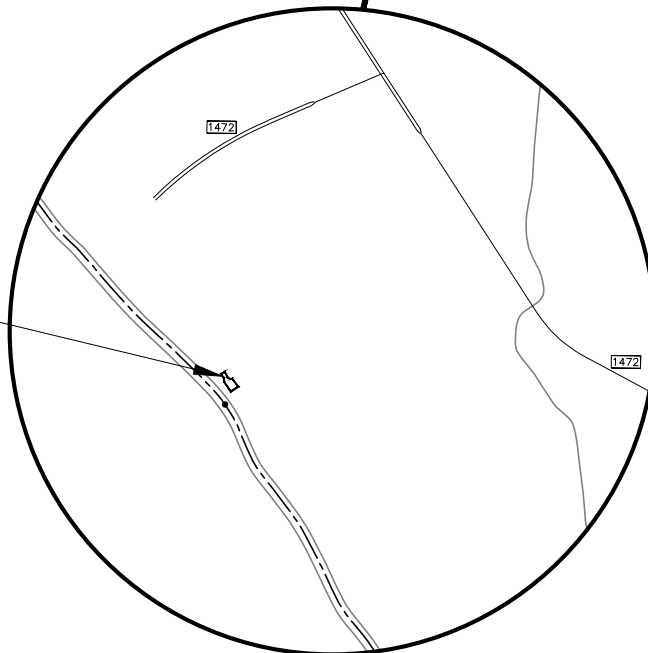


SPIF 1
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION
GENERAL LOCATION MAP



PLUMMER

FEET
0 2000

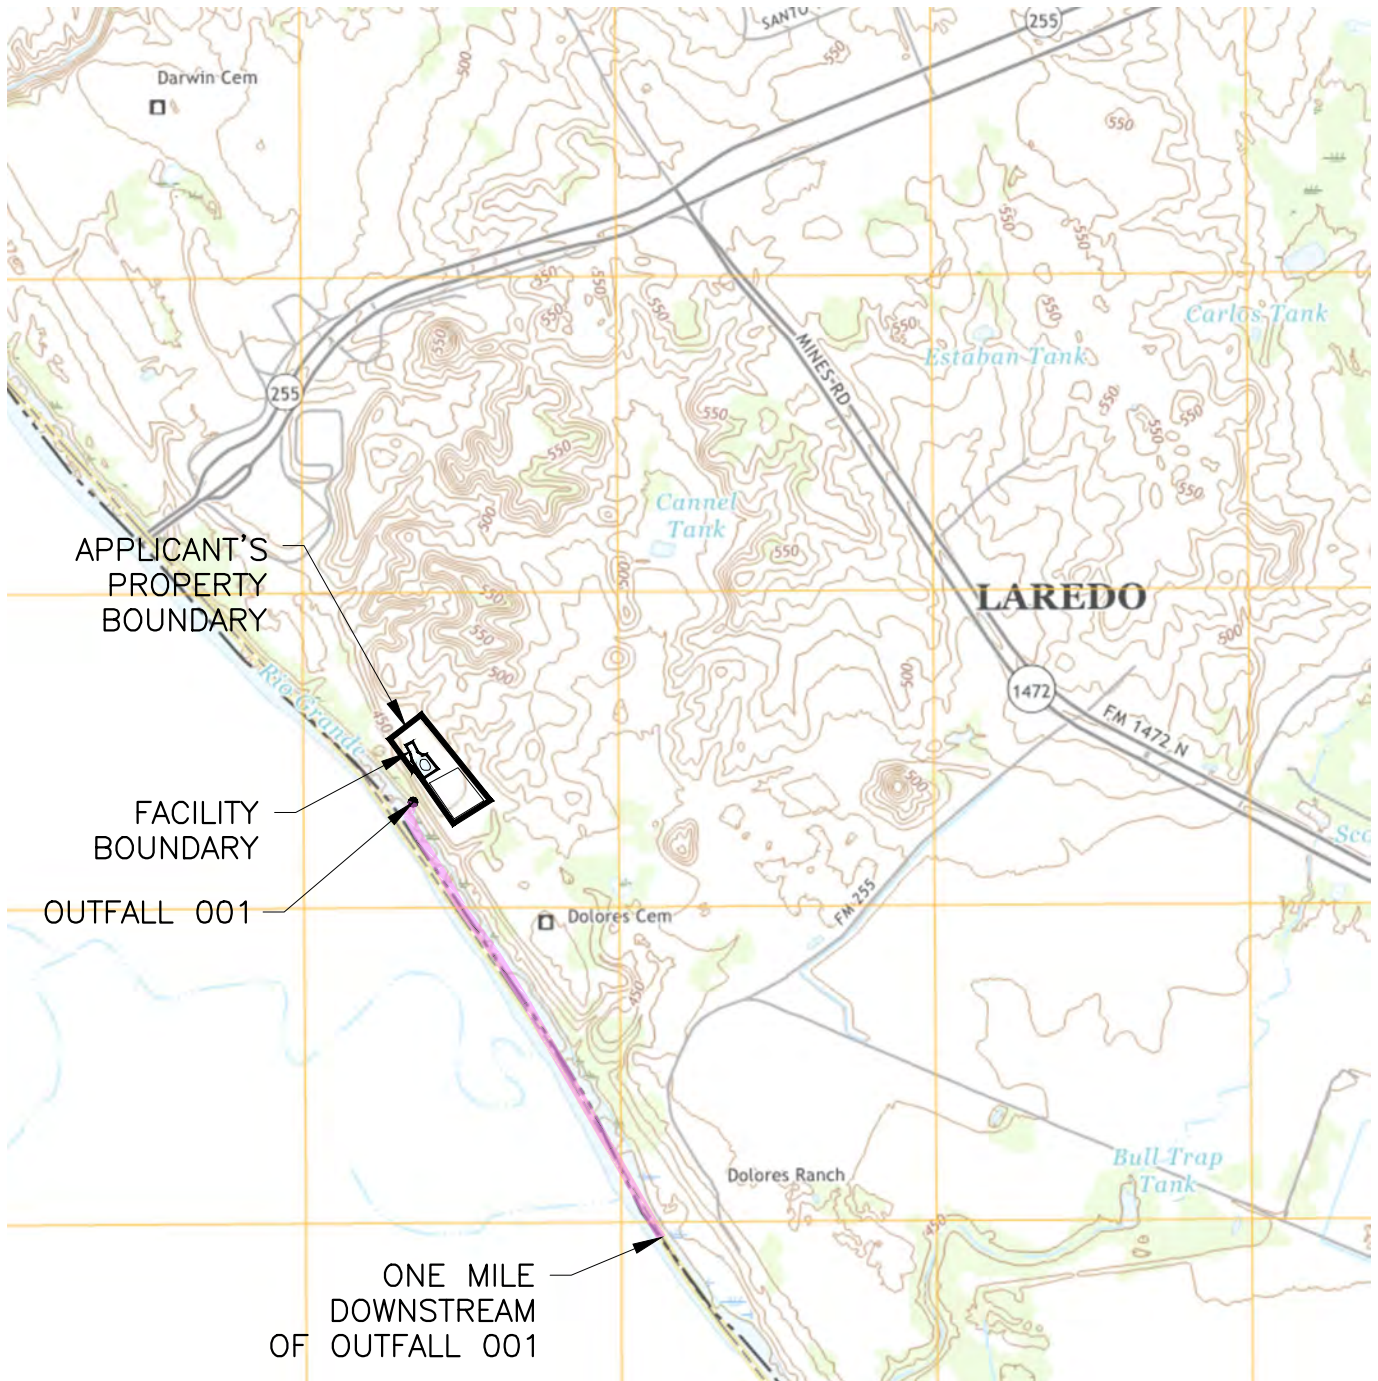

**SPIF 2
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION
USGS MAP**



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
DOMESTIC WASTEWATER PERMIT APPLICATION

DOMESTIC TECHNICAL REPORT 1.0

**The Following Is Required For All Applications
Renewal, New, And Amendment**

Section 1. Permitted or Proposed Flows (Instructions Page 51)

A. Existing/Interim I Phase

Design Flow (MGD): 0.035

2-Hr Peak Flow (MGD): 0.10

Estimated construction start date: Currently Operating

Estimated waste disposal start date: Currently Operating

B. Interim II Phase

Design Flow (MGD): N/A

2-Hr Peak Flow (MGD): N/A

Estimated construction start date: N/A

Estimated waste disposal start date: N/A

C. Final Phase

Design Flow (MGD): 0.16

2-Hr Peak Flow (MGD): 0.45

Estimated construction start date: 2023

Estimated waste disposal start date: 2025

D. Current operating phase: Existing/Interim I

Provide the startup date of the facility: 1993

Section 2. Treatment Process (Instructions Page 51)

A. Treatment process description

Provide a detailed description of the treatment process. **Include the type of**

treatment plant, mode of operation, and all treatment units. Start with the plant's head works and finish with the point of discharge. Include all sludge processing and drying units. **If more than one phase exists or is proposed in the permit, a description of *each phase* must be provided.** Process description:

See Attachment C

Port or pipe diameter at the discharge point, in inches: 15"

B. Treatment Units

In Table 1.0(1), provide the treatment unit type, the number of units, and dimensions (length, width, depth) of each treatment unit, accounting for ***all*** phases of operation.

Table 1.0(1) - Treatment Units

Treatment Unit Type	Number of Units	Dimensions (L x W x D)
<u>See Attachment D</u>		

C. Process flow diagrams

Provide flow diagrams for the existing facilities and **each** proposed phase of construction.

Attachment: E

Section 3. Site Drawing (Instructions Page 52)

Provide a site drawing for the facility that shows the following:

- The boundaries of the treatment facility;
- The boundaries of the area served by the treatment facility;
- If land disposal of effluent, the boundaries of the disposal site and all storage/holding ponds; and
- If sludge disposal is authorized in the permit, the boundaries of the land application or disposal site.

Attachment: F

Provide the name and a description of the area served by the treatment facility.

The Columbia WWTP is a satellite plant that serves a small area approximately 10 miles northwest of the City of Laredo. The service area is bordered by the Rio Grande River on the west and serves developments along FM 1472. The Columbia WWTP service area is approximately 2 square miles.

Section 4. Unbuilt Phases (Instructions Page 52)

Is the application for a renewal of a permit that contains an unbuilt phase or phases?

Yes ☒ No ☐

If **yes**, does the existing permit contain a phase that has not been constructed within five years of being authorized by the TCEQ?

Yes ☒ No ☐

If **yes**, provide a detailed discussion regarding the continued need for the unbuilt phase. Failure to provide sufficient justification may result in the Executive Director recommending denial of the unbuilt phase or phases.

The planned proposed future construction phase will still be needed. The area served by this plant has not developed as expected; the area growth rate, although slower than that of the main city areas, is still growing. The area's growth rate is expected to require the initiation of the proposed/planned expansion in the near future. Therefore, it is recommended to keep the proposed construction phase.

Section 5. Closure Plans (Instructions Page 53)

Have any treatment units been taken out of service permanently, or will any units be taken out of service in the next five years?

Yes ☐

No ☒

If **yes**, was a closure plan submitted to the TCEQ?

Yes ☐

No ☐

N/A

If **yes**, provide a brief description of the closure and the date of plan approval.

N/A

Section 6. Permit Specific Requirements (Instructions Page 53)

For applicants with an existing permit, check the *Other Requirements* or *Special Provisions* of the permit.

A. Summary transmittal

Have plans and specifications been approved for the existing facilities and each proposed phase?

Yes ☒

No ☐

If **yes**, provide the date(s) of approval for each phase: 1993

Provide information, including dates, on any actions taken to meet a requirement or provision pertaining to the submission of a summary transmittal letter. Provide a copy of an approval letter from the TCEQ, if applicable.

A summary transmittal letter will be submitted to the TCEQ prior to construction of the Final Phase treatment facility.

B. Buffer zones

Have the buffer zone requirements been met?

Yes ☒

No ☐

Provide information below, including dates, on any actions taken to meet the conditions of the buffer zone. If available, provide any new documentation relevant to maintaining the buffer zones.

N/A

C. Other actions required by the current permit

Does the *Other Requirements* or *Special Provisions* section in the existing permit require submission of any other information or other required actions? Examples include Notification of Completion, progress reports, soil monitoring data, etc.

Yes ☒ No ☐

If **yes**, provide information below on the status of any actions taken to meet the conditions of an *Other Requirement* or *Special Provision*.

Other Requirement 9.e: The City of Laredo has been performing the annual soil analysis and submitting the laboratory results to the TCEQ regional office, as required.

D. Grit and grease treatment

1. Acceptance of grit and grease waste

Does the facility have a grit and/or grease processing facility onsite that treats and decants or accepts transported loads of grit and grease waste that are discharged directly to the wastewater treatment plant prior to any treatment?

Yes ☐ No ☒

If **No**, stop here and continue with Subsection E. Stormwater Management.

2. Grit and grease processing

Describe below how the grit and grease waste is treated at the facility. In your description, include how and where the grit and grease is introduced to the treatment works and how it is separated or processed. Provide a flow diagram showing how grit and grease is processed at the facility.

N/A

3. Grit disposal

Does the facility have a Municipal Solid Waste (MSW) registration or permit for grit disposal?

Yes ☐ No ☐ N/A

If No, contact the TCEQ Municipal Solid Waste team at 512-239-0000. Note: A registration or permit is required for grit disposal. Grit shall not be combined with treatment plant sludge. See the instruction booklet for additional information on grit disposal requirements and restrictions.

Describe the method of grit disposal.

N/A

4. Grease and decanted liquid disposal

Note: A registration or permit is required for grease disposal. Grease shall not be combined with treatment plant sludge. For more information, contact the TCEQ Municipal Solid Waste team at 512-239-0000.

Describe how the decant and grease are treated and disposed of after grit separation.

N/A

E. Stormwater management

1. Applicability

Does the facility have a design flow of 1.0 MGD or greater in any phase?

Yes ☐ No ☒

Does the facility have an approved pretreatment program, under 40 CFR Part 403?

Yes ☒ No ☐

If **no** to both of the above, then skip to Subsection F, Other Wastes Received.

2. MSGP coverage

Is the stormwater runoff from the WWTP and dedicated lands for sewage disposal currently permitted under the TPDES Multi-Sector General Permit (MSGP), TXR050000?

Yes ☒ No ☐

If **yes**, please provide MSGP Authorization Number and skip to Subsection F, Other Wastes Received:

TXR05 or TXRNE AD77

If **no**, do you intend to seek coverage under TXR050000?

Yes ☐ No ☐ N/A

3. Conditional exclusion

Alternatively, do you intend to apply for a conditional exclusion from permitting based TXR050000 (Multi Sector General Permit) Part II B.2 or TXR050000 (Multi Sector General Permit) Part V, Sector T 3(b)?

Yes ☐ No ☒

If **yes**, please explain below then proceed to Subsection F, Other Wastes Received:

N/A

4. Existing coverage in individual permit

Is your stormwater discharge currently permitted through this individual TPDES or TLAP permit?

Yes ☐ No ☒

If **yes**, provide a description of stormwater runoff management practices at the site that are authorized in the wastewater permit then skip to Subsection F, Other Wastes Received.

N/A

5. Zero stormwater discharge

Do you intend to have no discharge of stormwater via use of evaporation or other means?

Yes ☐

No ☒

If yes, explain below then skip to Subsection F. Other Wastes Received.

N/A

Note: If there is a potential to discharge any stormwater to surface water in the state as the result of any storm event, then permit coverage is required under the MSGP or an individual discharge permit. This requirement applies to all areas of facilities with treatment plants or systems that treat, store, recycle, or reclaim domestic sewage, wastewater or sewage sludge (including dedicated lands for sewage sludge disposal located within the onsite property boundaries) that meet the applicability criteria of above. You have the option of obtaining coverage under the MSGP for direct discharges, (recommended), or obtaining coverage under this individual permit.

6. Request for coverage in individual permit

Are you requesting coverage of stormwater discharges associated with your treatment plant under this individual permit?

Yes ☐

No ☒

If yes, provide a description of stormwater runoff management practices at the site for which you are requesting authorization in this individual wastewater permit and describe whether you intend to comingle this discharge with your treated effluent or discharge it via a separate dedicated stormwater outfall. Please also indicate if you intend to divert stormwater to the treatment plant headworks and indirectly discharge it to water in the state.

N/A

Note: Direct stormwater discharges to waters in the state authorized through this individual permit will require the development and implementation of a stormwater pollution prevention plan (SWPPP) and will be subject to additional monitoring and reporting requirements. Indirect discharges of stormwater via headworks recycling will require compliance with all individual permit requirements including 2-hour peak flow limitations. All stormwater discharge authorization requests will require additional information during the technical review of your application.

F. Discharges to the Lake Houston Watershed

Does the facility discharge in the Lake Houston watershed?

Yes ☐ No ☒

If yes, a Sewage Sludge Solids Management Plan is required. See Example 5 in the instructions.

G. Other wastes received including sludge from other WWTPs and septic waste

1. Acceptance of sludge from other WWTPs

Does the facility accept or will it accept sludge from other treatment plants at the facility site?

Yes ☐ No ☒

If yes, attach sewage sludge solids management plan. See Example 5 of the instructions.

In addition, provide the date that the plant started accepting sludge or is anticipated to start accepting sludge, an estimate of monthly sludge acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the sludge, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

N/A

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

2. Acceptance of septic waste

Is the facility accepting or will it accept septic waste?

Yes ☐ No ☒

If **yes**, does the facility have a Type V processing unit?

Yes ☐ No ☐ N/A

If **yes**, does the unit have a Municipal Solid Waste permit?

Yes ☐ No ☐ N/A

If **yes to any of the above**, provide a the date that the plant started accepting septic waste, or is anticipated to start accepting septic waste, an estimate of monthly septic waste acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the septic waste, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

N/A

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

3. Acceptance of other wastes (not including septic, grease, grit, or RCRA, CERCLA or as discharged by IUs listed in Worksheet 6)

Is the facility accepting or will it accept wastes that are not domestic in nature excluding the categories listed above?

Yes ☐ No ☒

If **yes**, provide the date that the plant started accepting the waste, an estimate how much waste is accepted on a monthly basis (gallons or millions of gallons), a description of the entities generating the waste, and any distinguishing chemical or other physical characteristic of the waste. Also note if this information has or has not changed since the last permit action.

N/A

Section 7. Pollutant Analysis of Treated Effluent (Instructions Page 58)

Is the facility in operation?

Yes ☒

No ☐

See Attachment G

If **no**, this section is not applicable. Proceed to Section 8.

If **yes**, provide effluent analysis data for the listed pollutants. **Wastewater treatment facilities** complete Table 1.0(2). **Water treatment facilities** discharging filter backwash water, complete Table 1.0(3).

Note: The sample date must be within 1 year of application submission.

Table 1.0(2) - Pollutant Analysis for Wastewater Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
CBOD ₅ , mg/l	2.55	2.55	1	Grab	12/18/2019 11:55
Total Suspended Solids, mg/l	5.00	5.00	1	Grab	12/18/2019 11:55
Ammonia Nitrogen, mg/l	0.045	0.045	1	Grab	12/18/2019 11:55
Nitrate Nitrogen, mg/l	40.2	40.2	1	Grab	12/18/2019 11:55
Total Kjeldahl Nitrogen, mg/l	0.783	0.783	1	Grab	12/18/2019 11:55
Sulfate, mg/l	314	314	1	Grab	12/18/2019 11:55
Chloride, mg/l	172	172	1	Grab	12/18/2019 11:55
Total Phosphorus, mg/l	5.70	5.70	1	Grab	12/18/2019 11:55
pH, standard units	6.53	6.53	1	Grab	12/12/2019 09:00

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
Dissolved Oxygen*, mg/l	3.02	3.02	1	Grab	12/12/2019 08:49
Chlorine Residual, mg/l	2.1	2.1	1	Grab	12/12/2019 08:35
<i>E.coli</i> (CFU/100ml) freshwater	1.0	1.0	1	Grab	12/12/2019 08:45
Enterococci (CFU/100ml) saltwater	N/A	N/A	N/A	N/A	N/A
Total Dissolved Solids, mg/l	978	978	1	Grab	12/18/2019 11:55
Electrical Conductivity, µmohs/cm, †	1410	1410	1	Grab	12/18/2019 11:55
Oil & Grease, mg/l	1.3	1.3	1	Grab	12/18/2019 11:55
Alkalinity (CaCO ₃)*, mg/l	6.40	6.40	1	Grab	12/18/2019 11:55

*TPDES permits only

†TLAP permits only

Table 1.0(3) - Pollutant Analysis for Water Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
Total Suspended Solids, mg/l	N/A	N/A	N/A	N/A	N/A
Total Dissolved Solids, mg/l	N/A	N/A	N/A	N/A	N/A
pH, standard units	N/A	N/A	N/A	N/A	N/A
Fluoride, mg/l	N/A	N/A	N/A	N/A	N/A
Aluminum, mg/l	N/A	N/A	N/A	N/A	N/A
Alkalinity (CaCO ₃), mg/l	N/A	N/A	N/A	N/A	N/A

Section 8. Facility Operator (Instructions Page 60)

Facility Operator Name: Jose E. Chavarria

Facility Operator's License Classification and Level: Wastewater Class A

Facility Operator's License Number: WW0003855

Section 9. Sewage Sludge Management and Disposal (Instructions Page 60)

A. Sludge disposal method

Identify the current or anticipated sludge disposal method or methods from the following list. Check all that apply.

- ☐ Permitted landfill
- ☐ Permitted or Registered land application site for beneficial use
- ☐ Land application for beneficial use authorized in the wastewater permit
- ☐ Permitted sludge processing facility
- ☐ Marketing and distribution as authorized in the wastewater permit
- ☐ Composting as authorized in the wastewater permit
- ☐ Permitted surface disposal site (sludge monofill)
- ☐ Surface disposal site (sludge monofill) authorized in the wastewater permit
- ☒ Transported to another permitted wastewater treatment plant or permitted sludge processing facility. If you selected this method, a written statement or contractual agreement from the wastewater treatment plant or permitted sludge processing facility accepting the sludge must be included with this application. See Attachment H
- ☐ Other:

B. Sludge disposal site

Disposal site name: South Laredo Wastewater Treatment Facility

TCEQ permit or registration number: WQ0010681003

County where disposal site is located: Webb

C. Sludge transportation method

Method of transportation (truck, train, pipe, other): Truck

Name of the hauler: City of Laredo

Hauler registration number: 21804

Sludge is transported as a:

Liquid ☒

semi-liquid ☐

semi-solid ☐

solid ☐

**Section 10. Permit Authorization for Sewage Sludge Disposal
(Instructions Page 60)**

A. Beneficial use authorization

Does the existing permit include authorization for land application of sewage sludge for beneficial use?

Yes ☐ No ☒

If yes, are you requesting to continue this authorization to land apply sewage sludge for beneficial use?

Yes ☐ No ☐ N/A

If yes, is the completed **Application for Permit for Beneficial Land Use of Sewage Sludge (TCEQ Form No. 10451)** attached to this permit application (see the instructions for details)?

Yes ☐ No ☐ N/A

B. Sludge processing authorization

Does the existing permit include authorization for any of the following sludge processing, storage or disposal options?

Sludge Composting Yes ☐ No ☒

Marketing and Distribution of sludge Yes ☐ No ☒

Sludge Surface Disposal or Sludge Monofill Yes ☐ No ☒

Temporary storage in sludge lagoons Yes ☐ No ☒

If yes to any of the above sludge options and the applicant is requesting to continue this authorization, is the completed **Domestic Wastewater Permit Application: Sewage Sludge Technical Report (TCEQ Form No. 10056)** attached to this permit application?

Yes ☐ No ☐ N/A

Section 11. Sewage Sludge Lagoons (Instructions Page 61)

Does this facility include sewage sludge lagoons?

Yes ☐ No ☒

If yes, complete the remainder of this section. If no, proceed to Section 12.

A. Location information

The following maps are required to be submitted as part of the application. For each map, provide the Attachment Number.

- Original General Highway (County) Map:

Attachment: N/A

- USDA Natural Resources Conservation Service Soil Map:

Attachment: N/A

- Federal Emergency Management Map:

Attachment: N/A

- Site map:

Attachment: N/A

Discuss in a description if any of the following exist within the lagoon area.

Check all that apply.

- ☐ Overlap a designated 100-year frequency flood plain
- ☐ Soils with flooding classification
- ☐ Overlap an unstable area
- ☐ Wetlands
- ☐ Located less than 60 meters from a fault
- ☐ None of the above

Attachment: N/A

If a portion of the lagoon(s) is located within the 100-year frequency flood plain, provide the protective measures to be utilized including type and size of protective structures:

N/A

B. Temporary storage information

Provide the results for the pollutant screening of sludge lagoons. These results are in addition to pollutant results in Section 7 of Technical Report 1.0.

Nitrate Nitrogen, mg/kg: N/A

Total Kjeldahl Nitrogen, mg/kg: N/A

Total Nitrogen (=nitrate nitrogen + TKN), mg/kg: N/A

Phosphorus, mg/kg: N/A

Potassium, mg/kg: N/A

pH, standard units: N/A

Ammonia Nitrogen mg/kg: N/A

Arsenic: N/A

Cadmium: N/A

Chromium: N/A

Copper: N/A

Lead: N/A

Mercury: N/A

Molybdenum: N/A

Nickel: N/A

Selenium: N/A

Zinc: N/A

Total PCBs: N/A

Provide the following information:

Volume and frequency of sludge to the lagoon(s): N/A

Total dry tons stored in the lagoons(s) per 365-day period: N/A

Total dry tons stored in the lagoons(s) over the life of the unit: N/A

C. Liner information

Does the active/proposed sludge lagoon(s) have a liner with a maximum

hydraulic conductivity of 1×10^{-7} cm/sec?

Yes ☐ No ☐

If yes, describe the liner below. Please note that a liner is required.

N/A

D. Site development plan

Provide a detailed description of the methods used to deposit sludge in the lagoon(s):

N/A

Attach the following documents to the application.

- Plan view and cross-section of the sludge lagoon(s)

Attachment: N/A

- Copy of the closure plan

Attachment: N/A

- Copy of deed recordation for the site

Attachment: N/A

- Size of the sludge lagoon(s) in surface acres and capacity in cubic feet and gallons

Attachment: N/A

- Description of the method of controlling infiltration of groundwater and surface water from entering the site

Attachment: N/A

- Procedures to prevent the occurrence of nuisance conditions

Attachment: N/A

E. Groundwater monitoring

Is groundwater monitoring currently conducted at this site, or are any wells available for groundwater monitoring, or are groundwater monitoring data otherwise available for the sludge lagoon(s)?

Yes ☐ No ☐

If groundwater monitoring data are available, provide a copy. Provide a profile of soil types encountered down to the groundwater table and the depth to the shallowest groundwater as a separate attachment.

Attachment: N/A

Section 12. Authorizations/Compliance/Enforcement (Instructions Page 63)

A. Additional authorizations

Does the permittee have additional authorizations for this facility, such as reuse authorization, sludge permit, etc?

Yes ☒ No ☐

If **yes**, provide the TCEQ authorization number and description of the authorization:

Reclaimed Water Use Authorization No. R10681006

B. Permittee enforcement status

Is the permittee currently under enforcement for this facility?

Yes ☐ No ☒

Is the permittee required to meet an implementation schedule for compliance or enforcement?

Yes ☐ No ☒

If **yes** to either question, provide a brief summary of the enforcement, the implementation schedule, and the current status:

N/A

Section 13. RCRA/CERCLA Wastes (Instructions Page 63)

A. RCRA hazardous wastes

Has the facility received in the past three years, does it currently receive, or will

it receive RCRA hazardous waste?

Yes ☐ No ☒

B. Remediation activity wastewater

Has the facility received in the past three years, does it currently receive, or will it receive CERCLA wastewater, RCRA remediation/corrective action wastewater or other remediation activity wastewater?

Yes ☐ No ☒

C. Details about wastes received

If **yes** to either Subsection A or B above, provide detailed information concerning these wastes with the application.

Attachment: N/A

Section 14. Laboratory Accreditation (Instructions Page 64)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
 - periodically inspected by the TCEQ; or
 - located in another state and is accredited or inspected by that state; or
 - performing work for another company with a unit located in the same site; or
 - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review *30 TAC Chapter 25* for specific requirements.

The following certification statement shall be signed and submitted with every application. See the *Signature Page* section in the Instructions, for a list of designated representatives who may sign the certification.

CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: Robert A. Eads, ICMA-CM

Title: Interim Co-City Manager

Signature: 

Date: 2/19/2020

DOMESTIC TECHNICAL REPORT WORKSHEET 2.0

RECEIVING WATERS

The following is required for all TPDES permit applications

Section 1. Domestic Drinking Water Supply (Instructions Page 73)

Is there a surface water intake for domestic drinking water supply located within 5 miles downstream from the point or proposed point of discharge?

Yes ☐ No ☒

If yes, provide the following:

Owner of the drinking water supply: N/A

Distance and direction to the intake: N/A

Attach a USGS map that identifies the location of the intake.

Attachment: N/A

Section 2. Discharge into Tidally Affected Waters (Instructions Page 73)

Does the facility discharge into tidally affected waters?

Yes ☐ No ☒

If yes, complete the remainder of this section. If no, proceed to Section 3.

A. Receiving water outfall

Width of the receiving water at the outfall, in feet: N/A

B. Oyster waters

Are there oyster waters in the vicinity of the discharge?

Yes ☐ No ☒

If yes, provide the distance and direction from outfall(s).

N/A

C. Sea grasses

Are there any sea grasses within the vicinity of the point of discharge?

Yes ☐

No ☒

If **yes**, provide the distance and direction from the outfall(s).

N/A

Section 3. Classified Segments (Instructions Page 73)

Is the discharge directly into (or within 300 feet of) a classified segment?

Yes ☒

No ☐

If **yes**, this Worksheet is complete.

If **no**, complete Sections 4 and 5 of this Worksheet.

Section 4. Description of Immediate Receiving Waters (Instructions Page 75)

Name of the immediate receiving waters: N/A

A. Receiving water type

Identify the appropriate description of the receiving waters.

☐ Stream

☐ Freshwater Swamp or Marsh

☐ Lake or Pond

Surface area, in acres: N/A

Average depth of the entire water body, in feet: N/A

Average depth of water body within a 500-foot radius of discharge point, in feet: N/A

☐ Man-made Channel or Ditch

☐ Open Bay

- ☐ Tidal Stream, Bayou, or Marsh
- ☐ Other, specify: N/A

B. Flow characteristics

If a stream, man-made channel or ditch was checked above, provide the following. For existing discharges, check one of the following that best characterizes the area *upstream* of the discharge. For new discharges, characterize the area *downstream* of the discharge (check one).

- ☐ Intermittent - dry for at least one week during most years
- ☐ Intermittent with Perennial Pools - enduring pools with sufficient habitat to maintain significant aquatic life uses
- ☐ Perennial - normally flowing

Check the method used to characterize the area upstream (or downstream for new dischargers).

- ☐ USGS flow records
- ☐ Historical observation by adjacent landowners
- ☐ Personal observation
- ☐ Other, specify: N/A

C. Downstream perennial confluences

List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point.

N/A

D. Downstream characteristics

Do the receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.)?

Yes ☐ No ☐

If yes, discuss how.

N/A

E. Normal dry weather characteristics

Provide general observations of the water body during normal dry weather conditions.

N/A

Date and time of observation: N/A

Was the water body influenced by stormwater runoff during observations?

Yes ☐

No ☐

Section 5. General Characteristics of the Waterbody (Instructions Page 74)

A. Upstream influences

Is the immediate receiving water upstream of the discharge or proposed discharge site influenced by any of the following? Check all that apply.

- | | |
|---|---|
| <input type="checkbox"/> Oil field activities | <input type="checkbox"/> Urban runoff |
| <input type="checkbox"/> Upstream discharges | <input type="checkbox"/> Agricultural runoff |
| <input type="checkbox"/> Septic tanks | <input type="checkbox"/> Other(s), specify <u>N/A</u> |

B. Waterbody uses

Observed or evidences of the following uses. Check all that apply.

- | | |
|--|---|
| <input type="checkbox"/> Livestock watering | <input type="checkbox"/> Contact recreation |
| <input type="checkbox"/> Irrigation withdrawal | <input type="checkbox"/> Non-contact recreation |
| <input type="checkbox"/> Fishing | <input type="checkbox"/> Navigation |

- | | |
|--|---|
| <input type="checkbox"/> Domestic water supply | <input type="checkbox"/> Industrial water supply |
| <input type="checkbox"/> Park activities | <input type="checkbox"/> Other(s), specify <u>N/A</u> |

C. Waterbody aesthetics

Check one of the following that best describes the aesthetics of the receiving water and the surrounding area.

- ☐ Wilderness: outstanding natural beauty; usually wooded or unpastured area; water clarity exceptional
- ☐ Natural Area: trees and/or native vegetation; some development evident (from fields, pastures, dwellings); water clarity discolored
- ☐ Common Setting: not offensive; developed but uncluttered; water may be colored or turbid
- ☐ Offensive: stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored

DOMESTIC WORKSHEET 3.0

LAND DISPOSAL OF EFFLUENT

The following is required for all permit applications

Renewal, New, and Amendments

Section 1. Type of Disposal System (Instructions Page 77)

Identify the method of land disposal:

- | | |
|--|--|
| <input type="checkbox"/> Surface application | <input type="checkbox"/> Subsurface application |
| <input checked="" type="checkbox"/> Irrigation | <input type="checkbox"/> Subsurface soils absorption |
| <input type="checkbox"/> Drip irrigation system | <input type="checkbox"/> Subsurface area drip dispersal system |
| <input checked="" type="checkbox"/> Evaporation | |
| <input type="checkbox"/> Evapotranspiration beds | |
| <input type="checkbox"/> Other (describe in detail): | |

NOTE: All applicants without authorization or proposing new/amended subsurface disposal MUST complete and submit Worksheet 7.0.

For existing authorizations, provide Registration Number: N/A

Section 2. Land Application Site(s) (Instructions Page 77)

In table 3.0(1), provide the requested information for the land application sites. Include the agricultural or cover crop type (wheat, cotton, alfalfa, bermuda grass, native grasses, etc.), land use (golf course, hayland, pastureland, park, row crop, etc.), irrigation area, amount of effluent applied, and whether or not the public has access to the area. Specify the amount of land area and the amount of effluent that will be allotted to each agricultural or cover crop, if more than one crop will be used.

Table 3.0(1) - Land Application Site Crops

Crop Type & Land Use	Irrigation Area (acres)	Effluent Application (GPD)	Public Access? Y/N
Landscape	6.63	160,000	N

Section 3. Storage and Evaporation Lagoons/Ponds (Instructions Page 77)

Table 3.0(2) - Storage and Evaporation Ponds

Pond Number	Surface Area (acres)	Storage Volume (acre-feet)	Dimensions	Liner Type
1	1.03	12.36	N/A	Compacted Clay

Attach a copy of a liner certification that was prepared, signed, and sealed by a Texas licensed professional engineer for each pond.

Attachment: Available on Request. Pond Liner Certification has previously been submitted and approved.

Section 4. Flood and Runoff Protection (Instructions Page 77)

Is the land application site within the 100-year frequency flood level?

Yes ☐ No ☒

If yes, describe how the site will be protected from inundation.

N/A

Provide the source used to determine the 100-year frequency flood level:

FEMA FIRM Panel 48479C1000C

Provide a description of tailwater controls and rainfall run-on controls used for the land application site.

Earthen berms and Native grass stands are in place to provide tailwater control of irrigated effluent areas. Run-on is protected by roadway and upgradient perimeter berms.

Section 5. Annual Cropping Plan (Instructions Page 77)

Attach an Annual Cropping Plan which includes a discussion of each of the following items. If not applicable, provide a detailed explanation indicating why.

Attachment: I

- Soils map with crops
- Cool and warm season plant species
- Crop yield goals
- Crop growing season
- Crop nutrient requirements
- Additional fertilizer requirements
- Minimum/maximum harvest height (for grass crops)
- Supplemental watering requirements
- Crop salt tolerances
- Harvesting method/number of harvests
- Justification for not removing existing vegetation to be irrigated

Section 6. Well and Map Information (Instructions Page 78)

Attach a USGS map with the following information shown and labeled. If not applicable, provide a detailed explanation (on a separate page) indicating why.

Attachment: B

- The boundaries of the land application site(s)
- Waste disposal or treatment facility site(s)
- On-site buildings
- Buffer zones
- Effluent storage and tailwater control facilities
- All water wells within 1 mile of the disposal site or property boundaries
- All springs and seeps onsite and within 500 feet of the property boundaries

- All surface waters in the state onsite and within 500 feet of the property boundaries
- All faults and sinkholes onsite and within 500 feet of the property

List and cross reference all water wells shown on the USGS map in the following table. Attach additional pages as necessary to include all of the wells.

Table 3.0(3) - Water Well Data

N/A - No wells within
1 mile of the facility

Well ID	Well Use	Producing? Y/N	Open, cased, capped, or plugged?	Proposed Best Management Practice
N/A	N/A	N/A	N/A	N/A
			Choose an item.	
			Choose an item.	
			Choose an item.	

If water quality data or well log information is available please include the information in an attachment listed by Well ID.

Attachment: N/A

Section 7. Groundwater Quality (Instructions Page 79)

Attach a Groundwater Quality Technical Report which assesses the impact of the wastewater disposal system on groundwater. This report shall include an evaluation of the water wells (including the information in the well table provided in Item 6. above), the wastewater application rate, and pond liners. Indicate by a check mark that this report is provided.

Attachment: N/A - Land Application Has Not Been Implemented

Are groundwater monitoring wells available onsite? Yes ☐ No ☒

Do you plan to install ground water monitoring wells or lysimeters around the land application site? Yes ☐ No ☒

If yes, then provide the proposed location of the monitoring wells or lysimeters on a site map.

Attachment: N/A

Section 8. Soil Map and Soil Analyses (Instructions Page 79)

A. Soil map

Attach a USDA Soil Survey map that shows the area to be used for effluent disposal.

Attachment: N/A - Not Requested by the TCEQ

B. Soil analyses

Attach the laboratory results sheets from the soil analyses. **Note:** for renewal applications, the current annual soil analyses required by the permit are acceptable as long as the test date is less than one year prior to the submission of the application.

Attachment: G

List all USDA designated soil series on the proposed land application site. Attach additional pages as necessary.

Table 3.0(4) - Soil Data

Soil Series	Depth from Surface	Permeability	Available Water Capacity	Curve Number
Lagloria silt loam	63 cm	9.0×10^{-4} cm/s	0.15 cm/cm	71
Maverick-Catarina complex	60 cm	1.0×10^{-4} cm/s	0.14 cm/cm	89

Section 9. Effluent Monitoring Data (Instructions Page 80)

Is the facility in operation?

Yes ☒ No ☐

If **no**, this section is not applicable and the worksheet is complete.

If **yes**, provide the effluent monitoring data for the parameters regulated in the existing permit. If a parameter is not regulated in the existing permit, enter N/A.

Table 3.0(5) - Effluent Monitoring Data

Date	30 Day Avg Flow MGD	BOD₅ mg/l	TSS mg/l	pH	Chlorine Residual mg/l	Acres irrigated
<u>See Attachment J</u>						

Provide a discussion of all persistent excursions above the permitted limits and any corrective actions taken.

N/A

DOMESTIC WORKSHEET 6.0

INDUSTRIAL WASTE CONTRIBUTION

The following is required for all publicly owned treatment works (POTWs)

Section 1. All POTWs (Instructions Page 99)

A. Industrial users

Provide the number of each of the following types of industrial users (IUs) that discharge to your POTW and the daily flows from each user. See the Instructions for definitions of Categorical IUs, Significant IUs - non-categorical, and Other IUs.

If there are no users, enter 0 (zero).

Categorical IUs:

Number of IUs: 0

Average Daily Flows, in MGD: 0

Significant IUs - non-categorical:

Number of IUs: 0

Average Daily Flows, in MGD: 0

Other IUs:

Number of IUs: 0

Average Daily Flows, in MGD: 0

B. Treatment plant interference

In the past three years, has your POTW experienced treatment plant interference (see instructions)?

Yes ☐

No ☒

If yes, identify the dates, duration, description of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IUs that may have caused the interference.

N/A

C. Treatment plant pass through

In the past three years, has your POTW experienced pass through (see instructions)?

Yes ☐

No ☒

If yes, identify the dates, duration, a description of the pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass through event. Include the names of the IUs that may have caused pass through.

N/A

D. Pretreatment program

Does your POTW have an approved pretreatment program?

Yes ☒

No ☐

If yes, complete Section 2 only of this Worksheet.

Is your POTW required to develop an approved pretreatment program?

Yes ☐

No ☐

N/A

If yes, complete Section 2.c. and 2.d. only, and skip Section 3.

If no to either question above, skip Section 2 and complete Section 3 for each significant industrial user and categorical industrial user.

Section 2. POTWs with Approved Programs or Those Required to Develop a Program (Instructions Page 100)

A. Substantial modifications

Have there been any **substantial modifications** to the approved pretreatment program that have not been submitted to the TCEQ for approval according to *40 CFR §403.18*?

Yes ☐

No ☒

If yes, identify the modifications that have not been submitted to TCEQ, including the purpose of the modification.

N/A

B. Non-substantial modifications

Have there been any **non-substantial modifications** to the approved pretreatment program that have not been submitted to TCEQ for review and acceptance?

Yes ☐

No ☒

If yes, identify all non-substantial modifications that have not been submitted to TCEQ, including the purpose of the modification.

N/A

C. Effluent parameters above the MAL

In Table 6.0(1), list all parameters measured above the MAL in the POTW's effluent monitoring during the last three years. Submit an attachment if necessary.

Table 6.0(1) - Parameters Above the MAL

Pollutant	Concentration	MAL	Units	Date
<u>See Attachment K</u>				

D. Industrial user interruptions

Has any SIU, CIU, or other IU caused or contributed to any problems (excluding interferences or pass throughs) at your POTW in the past three years?

Yes ☐

No ☒

If yes, identify the industry, describe each episode, including dates, duration, description of the problems, and probable pollutants.

N/A

Section 3. Significant Industrial User (SIU) Information and Categorical Industrial User (CIU) (Instructions Page 100)

A. General information

Company Name: N/A

SIC Code: N/A

Telephone number: N/A Fax number: N/A

Contact name: N/A

Address: N/A

City, State, and Zip Code: N/A

B. Process information

Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (i.e., process and non-process wastewater).

N/A

C. Product and service information

Provide a description of the principal product(s) or services performed.

N/A

D. Flow rate information

See the Instructions for definitions of “process” and “non-process wastewater.”

Process Wastewater:

Discharge, in gallons/day: N/A

Discharge Type: ☐ Continuous ☐ Batch ☐ Intermittent

Non-Process Wastewater:

Discharge, in gallons/day: N/A

Discharge Type: ☐ Continuous ☐ Batch ☐ Intermittent

E. Pretreatment standards

Is the SIU or CIU subject to technically based local limits as defined in the instructions?

Yes ☐ No ☐

Is the SIU or CIU subject to categorical pretreatment standards found in *40 CFR Parts 405-471*?

Yes ☐ No ☐

If subject to categorical pretreatment standards, indicate the applicable category and subcategory for each categorical process.

Category: N/A

Subcategories: N/A

Category: N/A

Subcategories: N/A

Category: N/A

Subcategories: N/A

Category: N/A

Subcategories: N/A

Category: N/A

Subcategories: N/A

F. Industrial user interruptions

Has the SIU or CIU caused or contributed to any problems (e.g., interferences, pass through, odors, corrosion, blockages) at your POTW in the past three years?

Yes ☐ No ☐

If yes, identify the SIU, describe each episode, including dates, duration, description of problems, and probable pollutants.

N/A

**CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

TABLE OF ATTACHMENTS

<u>No.</u>	<u>Description</u>	<u>Reference</u>
A	Core Data Form	Admin Rpt 1.0 Section 3.C
B	U.S. Geological Survey Map	Admin Rpt 1.0 Section 13
C	Treatment Process Description	Tech Rpt. 1.0 Section 2.A
D	List of Treatment Units	Tech Rpt. 1.0 Section 2.B
E	Process Flow Diagram	Tech Rpt. 1.0 Section 2.C
F	Site Drawing	Tech Rpt. 1.0 Section 4
G	Effluent and Soil Analyses	Tech Rpt. 1.0 Section 7
H	Sludge Transportation Agreement	Tech Rpt. 1.0 Section 9
I	Cropping Plan Justification	Wksht 3.0 Section 5
J	Effluent Monitoring Data	Wksht 3.0 Section 9
K	Effluent Parameters Above the MAL	Wksht 6.0 Section 2.C

ATTACHMENT A

**Core Data Form
Admin Rpt 1.0 Section 3.C**



TCEQ Use Only

TCEQ Core Data Form

For detailed instructions regarding completion of this form, please read the Core Data Form Instructions or call 512-239-5175.

SECTION I: General Information

1. Reason for Submission <i>(If other is checked please describe in space provided.)</i>		
<input type="checkbox"/> New Permit, Registration or Authorization <i>(Core Data Form should be submitted with the program application.)</i>		
<input checked="" type="checkbox"/> Renewal <i>(Core Data Form should be submitted with the renewal form)</i>		<input type="checkbox"/> Other
2. Customer Reference Number <i>(if issued)</i>		3. Regulated Entity Reference Number <i>(if issued)</i>
CN 600131908		RN 101607984

[Follow this link to search for CN or RN numbers in Central Registry**](#)

SECTION II: Customer Information

4. General Customer Information		5. Effective Date for Customer Information Updates (mm/dd/yyyy)			
<input type="checkbox"/> New Customer		<input type="checkbox"/> Update to Customer Information		<input type="checkbox"/> Change in Regulated Entity Ownership	
<input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)					
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>					
6. Customer Legal Name <i>(If an individual, print last name first: eg: Doe, John)</i>				<i>If new Customer, enter previous Customer below:</i>	
City of Laredo					
7. TX SOS/CPA Filing Number	8. TX State Tax ID (11 digits)	9. Federal Tax ID (9 digits)	10. DUNS Number <i>(if applicable)</i>		
N/A	N/A	N/A	N/A		
11. Type of Customer:		<input type="checkbox"/> Corporation		<input type="checkbox"/> Individual	
Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> State <input type="checkbox"/> Other		<input type="checkbox"/> Sole Proprietorship		Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited	
				<input type="checkbox"/> Other:	
12. Number of Employees			13. Independently Owned and Operated?		
<input type="checkbox"/> 0-20 <input type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input type="checkbox"/> 251-500 <input checked="" type="checkbox"/> 501 and higher			<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		
14. Customer Role (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following:					
<input type="checkbox"/> Owner		<input type="checkbox"/> Operator		<input checked="" type="checkbox"/> Owner & Operator	
<input type="checkbox"/> Occupational Licensee		<input type="checkbox"/> Responsible Party		<input type="checkbox"/> Voluntary Cleanup Applicant	
				<input type="checkbox"/> Other:	
15. Mailing Address:		1110 Houston Street			
City	Laredo	State	TX	ZIP	78040
				ZIP + 4	8019
16. Country Mailing Information <i>(if outside USA)</i>			17. E-Mail Address <i>(if applicable)</i>		
N/A			reads@ci.laredo.tx.us		
18. Telephone Number		19. Extension or Code		20. Fax Number <i>(if applicable)</i>	
(956) 721-7302				(956) 721-7498	

SECTION III: Regulated Entity Information

21. General Regulated Entity Information <i>(If 'New Regulated Entity' is selected below this form should be accompanied by a permit application)</i>	
<input type="checkbox"/> New Regulated Entity <input type="checkbox"/> Update to Regulated Entity Name <input type="checkbox"/> Update to Regulated Entity Information	
<i>The Regulated Entity Name submitted may be updated in order to meet TCEQ Agency Data Standards (removal of organizational endings such as Inc, LP, or LLC.)</i>	
22. Regulated Entity Name <i>(Enter name of the site where the regulated action is taking place.)</i>	
Laredo/Colombia Solidarity Bridge Wastewater Treatment Plant	

23. Street Address of the Regulated Entity: (No PO Boxes)	N/A							
	City	N/A	State		ZIP		ZIP + 4	
24. County	Webb							

Enter Physical Location Description if no street address is provided.

25. Description to Physical Location:	Approximately 1.1 mi southwest of Farm-to-Market Road 1472 and State Highway 255 on an unnamed country road and 10.5 miles west-northwest of Farm-to-Market Roads 1472 and 3338, adjacent to the Rio Grande in Webb County, Texas 78045								
26. Nearest City	Laredo				State	TX		Nearest ZIP Code	78040
27. Latitude (N) In Decimal:	27.6922				28. Longitude (W) In Decimal:	99.7369			
Degrees	Minutes	Seconds	Degrees	Minutes	Seconds				
29. Primary SIC Code (4 digits)	4952		30. Secondary SIC Code (4 digits)			31. Primary NAICS Code (5 or 6 digits)	221320		
33. What is the Primary Business of this entity? (Do not repeat the SIC or NAICS description.)		This facility primarily treats domestic wastewater.							
34. Mailing Address:	5816 Daugherty Ave.								
	City	Laredo	State	TX	ZIP	78041	ZIP + 4	3337	
35. E-Mail Address:	rmia@ci.laredo.tx.us								
36. Telephone Number	(956) 721-2000		37. Extension or Code			38. Fax Number (if applicable)	(956) 721-2001		

39. TCEQ Programs and ID Numbers Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.

<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input type="checkbox"/> Emissions Inventory Air	<input type="checkbox"/> Industrial Hazardous Waste
<input type="checkbox"/> Municipal Solid Waste	<input type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
<input type="checkbox"/> Sludge	<input checked="" type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Waste Water	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	TXRNEAD77			
	WQ0010681006 R10681006			

SECTION IV: Preparer Information

40. Name:	Jenni English	41. Title:	Engineer in Training
42. Telephone Number	43. Ext./Code	44. Fax Number	45. E-Mail Address
(512) 687-2193		(512) 452-2325	jenglish@plummer.com

SECTION V: Authorized Signature

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

Company:	City of Laredo	Job Title:	City Manager
Name(In Print) :	Robert A. Eads, ICMA-CM	Phone:	(956) 791-7302
Signature:		Date:	5/1/2020


ATTACHMENT B

**U.S. Geological Survey Map
Admin Rpt 1.0 Section 13**



PLUMMER

FEET
0 2000

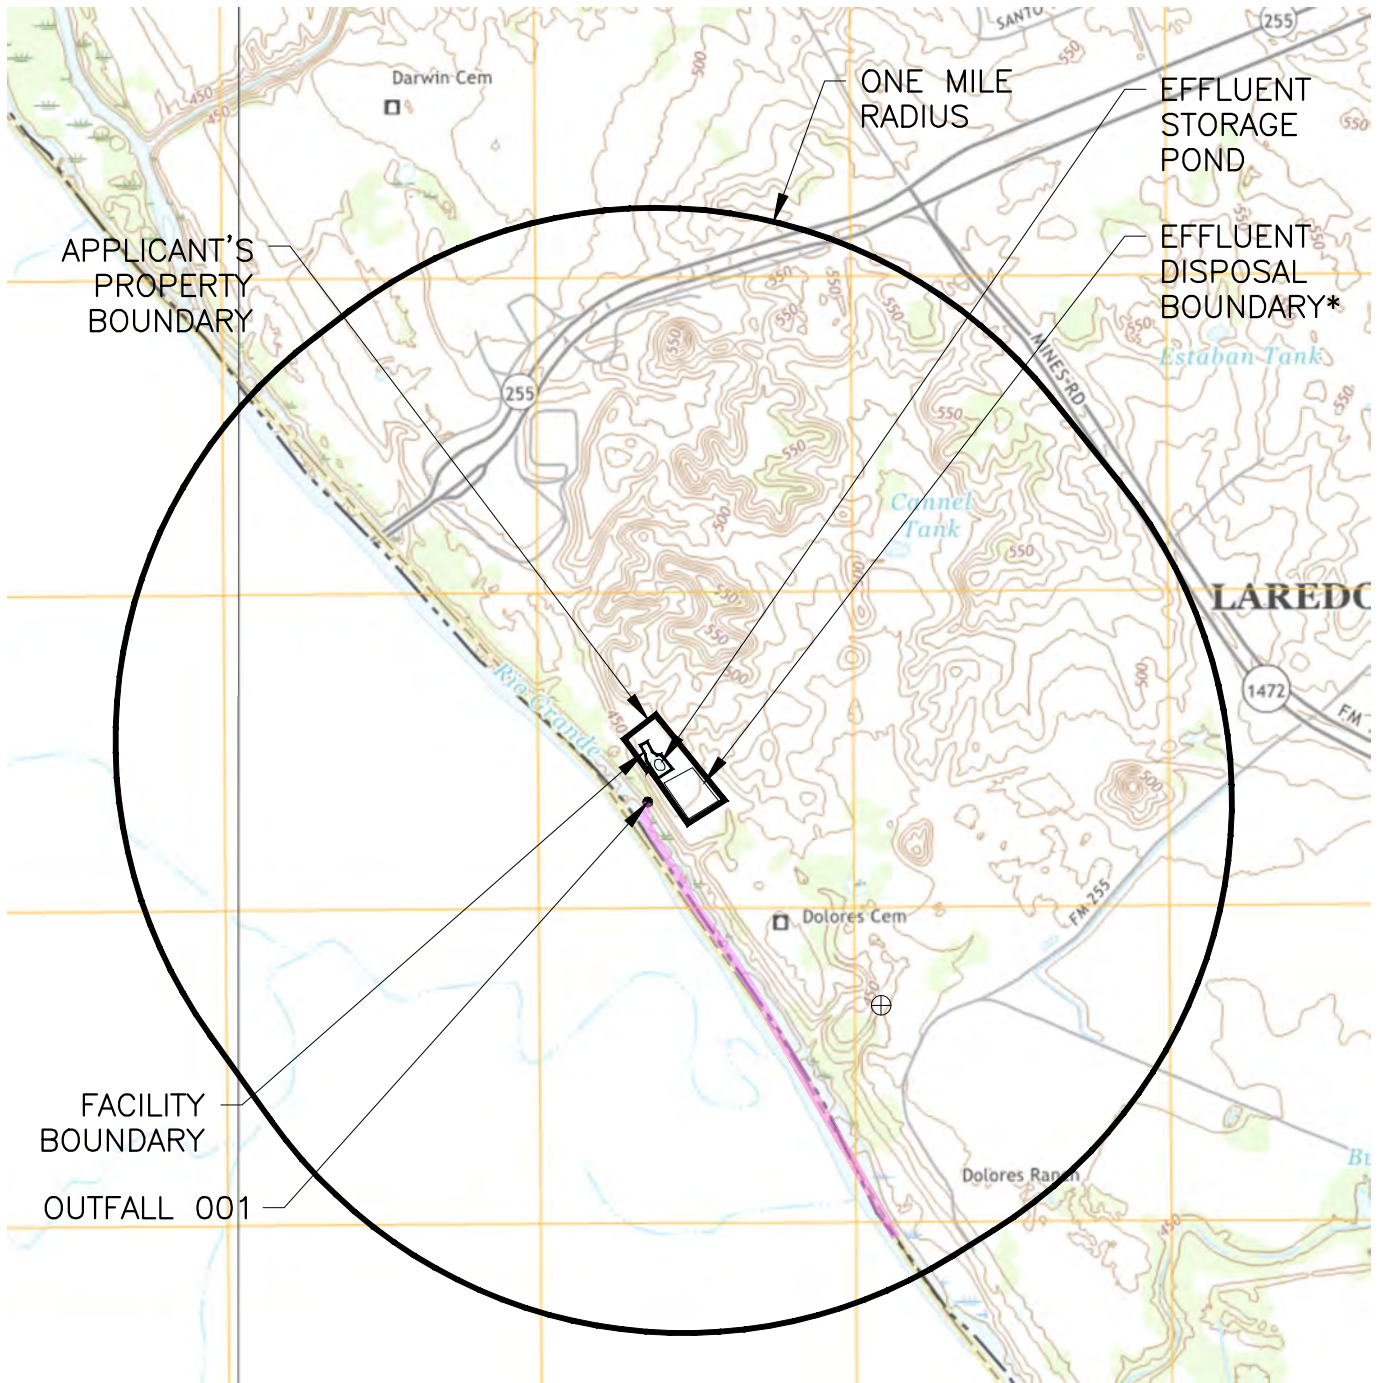

LEGEND

⊕ EXISTING WELL

* LAND DISPOSAL OF EFFLUENT HAS NEVER COMMENCED

**ATTACHMENT B
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION
USGS MAP**

ATTACHMENT C

**Treatment Process Description
Tech Rpt. 1.0 Section 2.A**

**ATTACHMENT C
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

TREATMENT PROCESS DESCRIPTION

The current 0.035 MGD phase is an activated sludge extended aeration package plant. The treatment process consists of the following units: Bar Screen, Extended Activated Sludge Treatment, Secondary Clarification, Chlorination, and Solids Handling.

Influent raw wastewater is pumped to a manual bar screen from an on-site lift station. Following the bar screen, the wastewater then flows to the activated sludge aeration basin, and then flows to the clarifier. Settled activated sludge is returned to the aeration basin from the clarifier as return activated sludge (RAS) or wasted to an aerobic digester as waste activated sludge (WAS). The clarifier effluent flows to a chlorine contact chamber for chlorination and then is discharged as final effluent. Sludge from the aerobic digester is transported via a tanker truck to the South Laredo WWTF for belt filter press dewatering and disposal at the City of Laredo landfill. Additionally, the wastes collected from the bar screenings are transported to the South Laredo WWTF for disposal with dewatered sludge.

The treatment process for the planned second phase is intended to follow the same process flow as for the existing phase.

ATTACHMENT D

**List of Treatment Units
Tech Rpt. 1.0 Section 2.B**

**ATTACHMENT D
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

LIST OF TREATMENT UNITS

EXISTING PHASE		
Type of Unit	Number of Units	Dimensions
Aeration Tank	1	73' L x 24' W x 11' H
Clarifier	1	10' Radius x 12' SWD
Sludge Tank	1	24' L x 8' W x 11' H
Chlorination Basin	1	13' L x 3' W x 9' H
Effluent Holding Pond	1	2.65 MGD

FINAL PHASE*		
Type of Unit	Number of Units	Dimensions
Aeration Tank	2	73' L x 24' W x 11' H
Clarifier	2	10' Radius x 12' SWD
Sludge Tank	2	24' L x 8' W x 11' H
Chlorination Basin	2	24' L x 3' W x 11' H
Effluent Holding Pond	1	2.65 MGD


**Sizing is tentative and may be adjusted at time of design*

ATTACHMENT E

**Process Flow Diagram
Tech Rpt. 1.0 Section 2.C**



PLUMMER

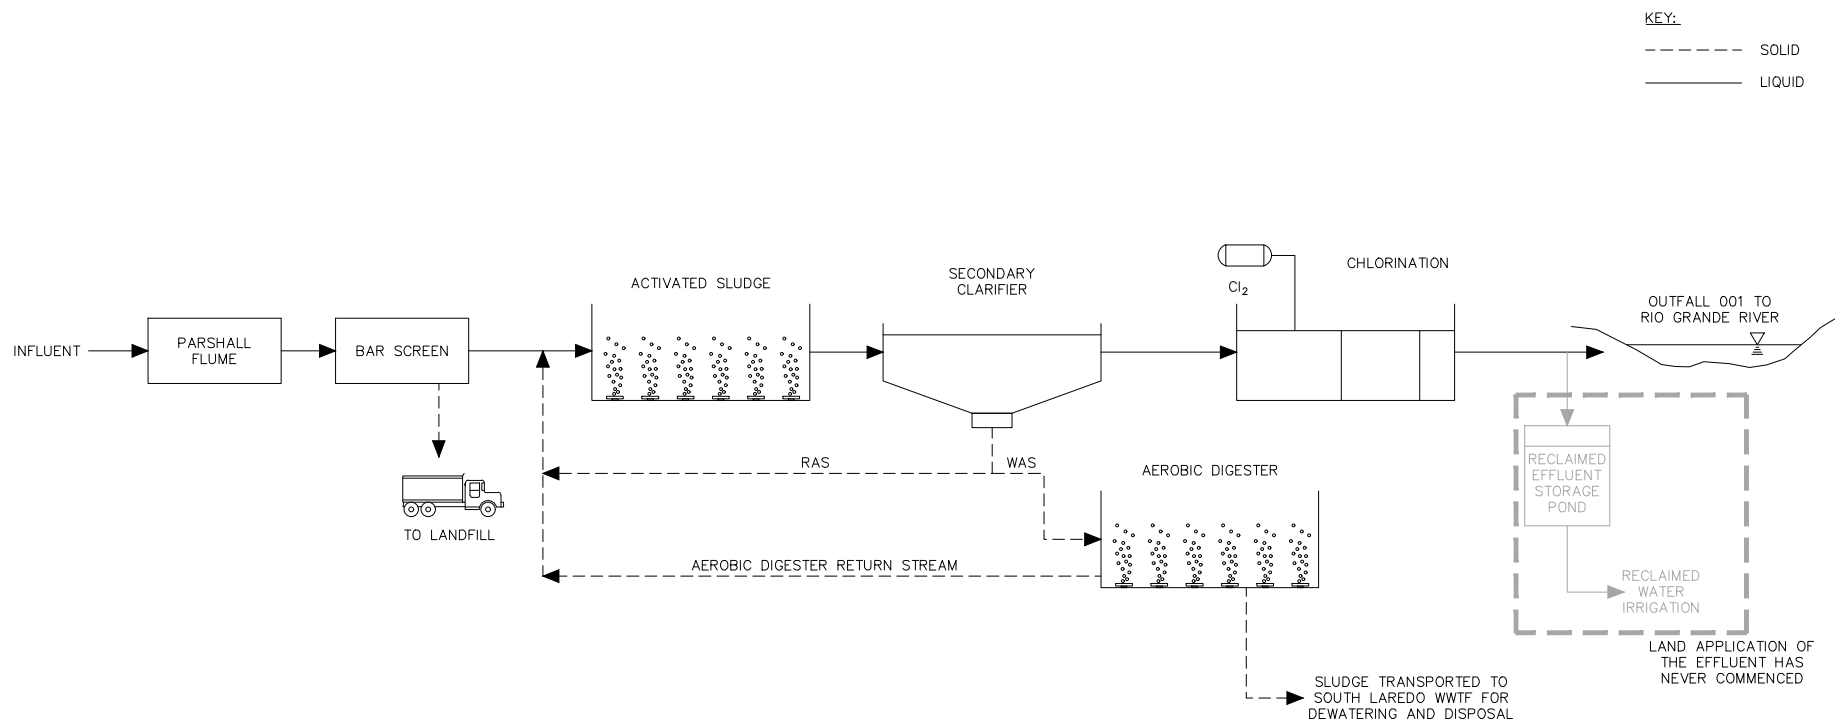

ATTACHMENT E
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION
PROCESS FLOW DIAGRAM


ATTACHMENT F

**Site Drawing
Tech Rpt. 1.0 Section 4**



PLUMMER

FEET
0 4000

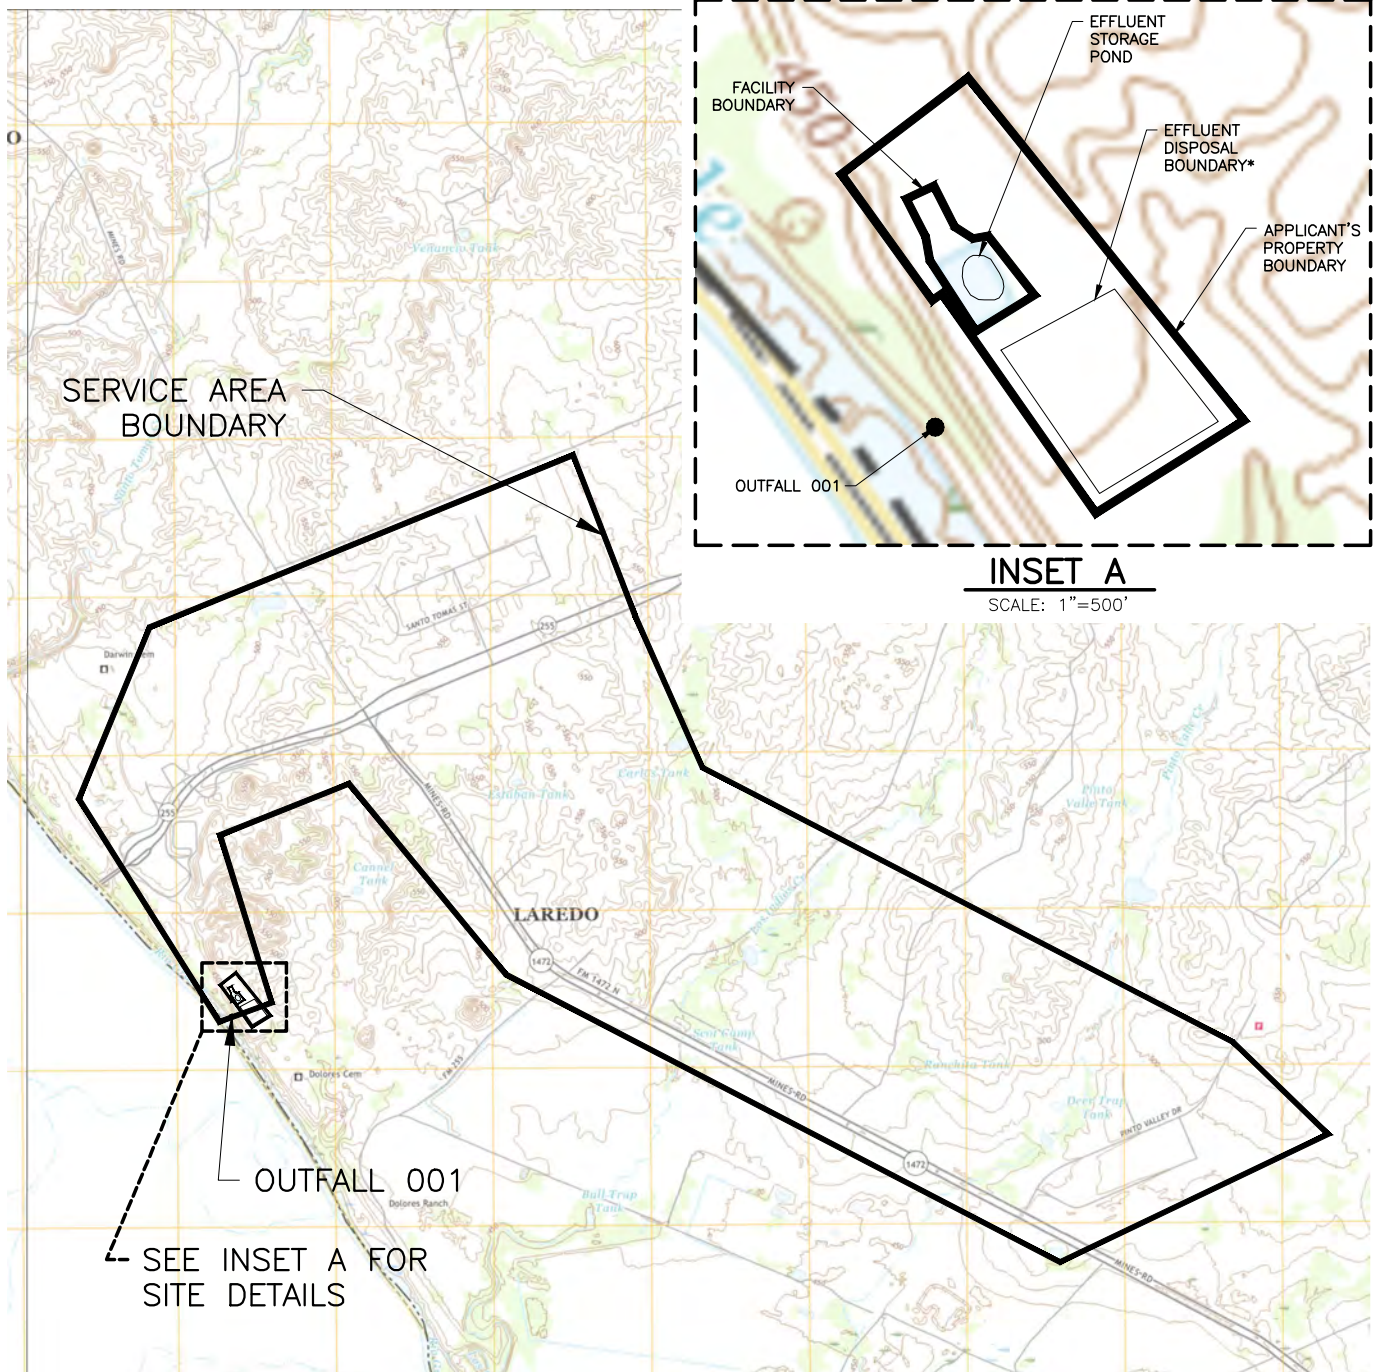

* LAND DISPOSAL OF EFFLUENT HAS NEVER COMMENCED

**ATTACHMENT F
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION
SITE DRAWING**

ATTACHMENT G

**Effluent and Soil Analyses
Tech Rpt. 1.0 Section 7**

CITY OF LAREDO UTILITIES LABORATORY FIELD ANALYSIS WORKSHEET
LAREDO COLUMBIA WWTF

DATE (Sampling & Analysis): 12.12.2019

pH ANALYSIS (Standard Methods (4500-H+pH Value))

pH SAMPLE INFORMATION			
Sample Identification	Sampling Point	Sample Collection Time	Sampled By
Final Effluent	collected at end of chlorine contact chamber	08:44	Julian Garza

pH ANALYSIS INFORMATION					pH Result (SU) <u>6.53</u>
Analysis Time	1st Reading Sample		2nd Reading Sample		Analyzed By
	Temp. C°	pH (SU)	Temp. C°	pH (SU)	
09:00	6.9°	6.53	6.9°	6.58	Jessie Oviedo

pH METER INFORMATION		
ID #	Brand	Model #
PH-11	ORION	230A

pH METER CALIBRATION INFORMATION							
Time	Buffer 4		Buffer 7		Buffer 10		% Slope
	Temp. (C°)	Cal Point (SU)	Temp. (C°)	Cal Point (SU)	Temp. (C°)	Cal Point (SU)	
08:58	19.2°	4.01	19.2°	7.02	—	—	94.0
	Expiration Date	4, 2020	Expiration Date	4, 2020	Expiration Date	5, 2020	Jessie Oviedo

TOTAL CHLORINE RESIDUAL ANALYSIS (Adapted Standard Methods DPD (Hach 8167 Method))

TOTAL CHLORINE RESIDUAL SAMPLE INFORMATION			
Sample Identification	Sampling Point	Sample Collection Time	Sampled By
Final Effluent	collected at end of chlorine contact chamber	08:45	Julian Garza

Meter Check (2ppm Potassium Permanganate Standard)		Total Chlorine Residual (mg/L)	Result
Date: <u>12.11.2019</u>	Time: <u>08:35</u>	<u>2.1</u>	
DPD FAS Titration Method <u>1.95</u> mg/L			
Meter Reading <u>2.0</u> (mg/L) % Deviation: <u>1.27%</u>			

TOTAL CHLORINE RESIDUAL INFORMATION					
Analysis Time	Meter ID	Range Used (High or Low)	Sample Reading (mg/l)	Duplicate Sample Reading (mg/l)	Analyzed By
08:45	CL-09	High Range	2.1	2.1	Julian Garza

DISSOLVED OXYGEN ANALYSIS (Standard Methods (4500-OG. Membrane Electrode Method))

DISSOLVED OXYGEN SAMPLE INFORMATION			
Sample Identification	Sampling Point (in situ)	Sample Collection Time	Sampled By
Final Effluent	at end of chlorine contact chamber	N/A	N/A

DISSOLVED OXYGEN ANALYSIS INFORMATION					DO Result (mg/L) <u>3.02</u>
Analysis Time	in situ Meter Reading		Analyzed By		
	Temp. C°	DO (mg/L)			
08:49	14.7°	3.02	Jessie Oviedo		

DO METER INFORMATION		
ID #	Brand	Model #
DO25	YSI	Pro-20

DISSOLVED OXYGEN METER CALIBRATION INFORMATION							
Time	Initial Reading mg/L	Calibration Temp C°	Altitude	Barometer Reading (mmHg)	Salinity (PPT)	Calibrated Reading mg/L	Calibrated By :
08:35	11.49	10.9°	500 ft.	756.2	0	10.9	Jessie Oviedo

Probe Standardization To Winkler Method

Date: 12/6-2019 ±% Deviation: 2.44%

By: M. Villanreal / J. Garza

**CITY OF LAREDO HEALTH DEPARTMENT**

Laboratory - Environmental Division

2600 Cedar St.

Laredo, TX 78040

TCEQ ID: T 10474638 - 08 TX

Phone: (956) 795 - 4908 x 4693

Fax: (956) 795 - 2188

Chain of Custody # 20191217**Quanti-tray E.coli and Chain of Custody Form
ELO2 APPENDIX DD**

CLIENT NAME: <u>City of Laredo</u>		COUNTY: <u>Webb</u>		SAMPLE TYPE: <u>Grab</u>	
ADDRESS: <u>Springfield & Aldama St</u>		PHONE: <u>956-795-2720</u>		FAX: <u>956-795-2723</u>	
CITY/STATE/ZIP CODE: <u>Laredo, TX 78041</u>					
CONTACT:					
Circle One: <u>Water Source</u>		Facility Name: <u>Laredo Columbia Wastewater Treatment Facility</u>			
<u>Effluent</u>		Facility ID #: <u>TPDES EPA ID# TX 0107395</u>			
Sample ID:	Sampling Point	Disinfection Type	Chlorine Residual	Test Requested	Total Coliform Results (MPN/100mL)
Final Effluent	End of chlorine contact chamber	Chlorine	<u>2.1</u>	IDEXX Laboratories Colilert	NA
				E.coli (enumeration)	
Sampled by: <u>Julian Garza</u>	Date: <u>12.12.19</u>	Time: <u>8:45</u>	Received by: <u>[Signature]</u>	Date: <u>12-12-19</u>	Time: <u>11:12</u>
Relinquished by: <u>[Signature]</u>	Date: <u>12.12.19</u>	Time: <u>10:00</u>	Received by: Lab: <u>Paul [Signature]</u>	Date: <u>12/12/19</u>	Time: <u>11:17 AM</u>
Laboratory:					
Sample Arrival Condition: <u>TCEQ</u>		Sample Arrival Volume: <u>100 mL</u>		Sample arrival temp. observed/corrected: <u>38/5.8</u>	
Sample Accepted: <u>✓</u>		Sample Rejected: <u> </u>		Chlorine Residual: <u>0.00</u>	
Date & Time Analysis Started: <u>12/12/19 @ 12:05</u>		Date & Time Analysis Finished: <u>12/13/19 @ 12:05</u>		CI Strip Lot # & Exp. Date: <u>9091 1/2022</u>	
Date & Time Results Reported to: <u> </u>		Reported By: <u>[Signature]</u>		Not Acceptable: <u> </u>	
The test results on this report meets all NELAC requirements: Acceptable: <u>✓</u>					
Laboratory Contact: Ms. Rebeca I. Castro, Technical Director - (956) 795 - 4908 x 4693					
Remarks / Lab ID #: <u>393114</u>					
Unsuitable Sx Analysis	1) Sx Exceeds 6 hrs Holding Time	<input type="checkbox"/>	3) Excessive chlorine Residual (> 10 mg/L)	<input type="checkbox"/>	5) Form Incomplete, not Filled accordingly/Date Discrepancy
	2) Insufficient Sx Volume (100 ml)	<input type="checkbox"/>	4) Heavy Turbidity Present / Excessive Material	<input type="checkbox"/>	6) Other:

ANALYTICAL REPORT

Eurofins TestAmerica, Corpus Christi
1733 N. Padre Island Drive
Corpus Christi, TX 78408
Tel: (361)289-2673


Laboratory Job ID: 560-84031-1

Client Project/Site: Columbia Bridge WWTP TPDES Application

For:

City of Laredo
5816 Daugherty Avenue
Laredo, Texas 78041

Attn: Saad Hassoun



Authorized for release by:

1/15/2020 4:22:52 PM

Tiffany Fleming, Project Management Assistant I
(361)289-2673

tiffany.fleming@testamericainc.com

Designee for

Lindy Maingot, Project Manager I
(210)344-9751

lindy.maingot@testamericainc.com

LINKS

Review your project
results through

TotalAccess

Have a Question?



Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

Definitions/Glossary

Client: City of Laredo

Job ID: 560-84031-1

Project/Site: Columbia Bridge WWTP TPDES Application

Qualifiers

Metals

Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
F1	MS and/or MSD Recovery is outside acceptance limits.
U	Indicates the analyte was analyzed for but not detected.

General Chemistry

Qualifier	Qualifier Description
*	LCS or LCSD is outside acceptance limits.
B	Compound was found in the blank and sample.
F1	MS and/or MSD Recovery is outside acceptance limits.
F2	MS/MSD RPD exceeds control limits
H	Sample was prepped or analyzed beyond the specified holding time
HF	Field parameter with a holding time of 15 minutes. Test performed by laboratory at client's request.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Job ID: 560-84031-1

Laboratory: Eurofins TestAmerica, Corpus Christi

Narrative

Job Narrative 560-84031-1

Comments

No additional comments.

Receipt

The samples were received on 12/19/2019 8:30 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperatures of the 3 coolers at receipt time were 2.1° C, 2.3° C and 2.3° C.

Metals

Method 6010B: Due to the high concentration of Magnesium, the matrix spike / matrix spike duplicate (MS/MSD) for preparation batch 160-455094 and analytical batch 160-455888 could not be evaluated for accuracy and precision. The associated laboratory control sample (LCS) met acceptance criteria.
(560-84031-D-2-B MS) and (560-84031-D-2-C MSD)

Method 6010B: The post digestion spike % recovery for Magnesium associated with batch preparation batch 160-455094 and analytical batch 160-455888 was outside of control limits indicating a potential matrix interference. The following samples are impacted:
(560-84031-D-2-A PDS) .

Method 6010B: Due to the high concentration of Calcium, the matrix spike / matrix spike duplicate (MS/MSD) for preparation batch 160-455094 and analytical batch 160-456053 could not be evaluated for accuracy and precision. The associated laboratory control sample (LCS) met acceptance criteria.
(560-84031-D-2-B MS ^10) and (560-84031-D-2-C MSD ^10)

Method 6010B: The post digestion spike % recovery for Calcium associated with batch preparation batch 160-455094 and analytical batch 160-456053 was outside of control limits due to high concentrations of target analytes. The following samples are impacted:
(560-84031-D-2-A PDS ^10) .

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

General Chemistry

Method 9045D: This analysis is normally performed in the field and has a method-defined holding time of 15 minutes. The following sample has been qualified with the "HF" flag to indicate analysis was performed in the laboratory outside the 15 minute timeframe: Laredo Columbia WWTP (560-84031-2).

Method SM5210B CBOD: The glucose-glutamic acid standard recovered outside the recovery limits specified in the method in batch 560-170028 .

Methods 300.0, 9056: The following samples were diluted due to the nature of the sample matrix: Laredo Columbia WWTP (560-84031-1), Laredo Columbia WWTP (560-84031-2), (560-83999-A-1 ^25), (560-83999-A-1 MS), (560-83999-A-1 MSD), (560-84011-A-1-A ^20), (560-84011-A-1-B MS) and (560-84011-A-1-C MSD). Elevated reporting limits (RLs) are provided.

Method 300.0: The following sample was analyzed outside of analytical holding time due to system outages. Laredo Columbia WWTP (560-84031-1)

Method 300.0: The instrument blank for analytical batch 560-170350 contained NO3 greater than the method detection limit (MDL), and were not reanalyzed because recovery was less than the RL. The data have been qualified and reported.

Method 9056: The instrument blank for analytical batch 560-170350 contained NO3/SO4 greater than the method detection limit (MDL), and were not reanalyzed because recovery was less than the RL. The data have been qualified and reported.

Method 9056: The following sample was diluted due to the nature of the sample matrix: Laredo Columbia WWTP (560-84031-2). Elevated reporting limits (RLs) are provided.

Case Narrative

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Job ID: 560-84031-1 (Continued)

Laboratory: Eurofins TestAmerica, Corpus Christi (Continued)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

1

2

3

4

5

6

7

8

9

10

11

Detection Summary

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Client Sample ID: Laredo Columbia WWTP

Lab Sample ID: 560-84031-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil	Fac	D	Method	Prep Type
Chloride	172		10.0	1.92	mg/L	10			300.0	Total/NA
Nitrate as N	40.2	H B	5.00	1.03	mg/L	10			300.0	Total/NA
Sulfate	314		10.0	3.77	mg/L	10			300.0	Total/NA
Nitrogen, Kjeldahl	0.783	J F1	1.00	0.432	mg/L	1			351.2	Total/NA
Total Alkalinity as CaCO3	6.40		5.00	5.00	mg/L	1			SM 2320B	Total/NA
Specific Conductance	1410		1.00	1.00	umhos/cm	1			SM 2510B	Total/NA
Total Dissolved Solids	978		20.0	20.0	mg/L	1			SM 2540C	Total/NA
Total Suspended Solids	5.00		2.00	2.00	mg/L	1			SM 2540D	Total/NA
Total Phosphorus	5.70		0.500	0.210	mg/L	10			SM4500 P	Total/NA
									E-1999	
Carbonaceous Biochemical Oxygen Demand	2.55	*	2.00	2.00	mg/L	1			SM5210B CBOD	Total/NA

Client Sample ID: Laredo Columbia WWTP

Lab Sample ID: 560-84031-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil	Fac	D	Method	Prep Type
Dissolved Calcium	460				mg/L	1			20B	Soluble
Dissolved Magnesium	76.0				mg/L	1			20B	Soluble
Dissolved Sodium	339				mg/L	1			20B	Soluble
Sodium Adsorption Ratio	3.90				NONE	1			20B	Soluble
Dissolved Potassium	0.000				mg/L	1			20B	Soluble
Calcium	48900		2430	729	mg/Kg	10			6010B	Total/NA
Sodium	455		97.2	24.3	mg/Kg	1			6010B	Total/NA
Magnesium	4270		97.2	24.3	mg/Kg	1			6010B	Total/NA
Potassium	1460	F1	486	146	mg/Kg	1			6010B	Total/NA
Phosphorus	335		48.6	14.6	mg/Kg	1			6010B	Total/NA
Sulfur	2460	F1	486	146	mg/Kg	1			6010B	Total/NA
Ammonia	5.29	J F2 F1	20.0	2.37	mg/Kg	1			350.1	Total/NA
Nitrogen, Kjeldahl	240	F1	40.0	31.1	mg/Kg	1			351.2	Total/NA
pH	7.5	HF	0.1	0.1	SU	1			9045D	Total/NA
Nitrogen, Organic	235		1.00	0.777	mg/Kg	1			Nitrogen,Org	Total/NA
Nitrate as N	41.2	J B	100	4.00	mg/L	20			9056	Soluble
Chloride	89.0	J	200	10.0	mg/L	20			9056	Soluble
Sulfate	3680	B	200	20.0	mg/L	20			9056	Soluble
Specific Conductance	1840		1.00	1.00	umhos/cm	1			SM 2510B	Soluble

This Detection Summary does not include radiochemical test results.

Eurofins TestAmerica, Corpus Christi

Client Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Client Sample ID: Laredo Columbia WWTP

Lab Sample ID: 560-84031-1

Date Collected: 12/18/19 11:55

Matrix: Water

Date Received: 12/19/19 08:30

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Oil & Grease (HEM)	1.3	U	4.8	1.3	mg/L			12/20/19 09:05	1
Chloride	172		10.0	1.92	mg/L			12/31/19 19:30	10
Nitrate as N	40.2	H B	5.00	1.03	mg/L			12/31/19 19:30	10
Sulfate	314		10.0	3.77	mg/L			12/31/19 19:30	10
Nitrogen, Kjeldahl	0.783	J F1	1.00	0.432	mg/L			01/08/20 15:28	1
Total Alkalinity as CaCO3	6.40		5.00	5.00	mg/L			12/27/19 13:45	1
Specific Conductance	1410		1.00	1.00	umhos/cm			01/07/20 09:40	1
Total Dissolved Solids	978		20.0	20.0	mg/L			12/24/19 14:50	1
Total Suspended Solids	5.00		2.00	2.00	mg/L			12/20/19 11:15	1
Ammonia as N	0.0450	U	0.200	0.0450	mg/L			12/23/19 16:13	1
Total Phosphorus	5.70		0.500	0.210	mg/L		12/31/19 01:57	12/31/19 06:08	10
Carbonaceous Biochemical Oxygen Demand	2.55	*	2.00	2.00	mg/L			12/19/19 13:45	1

Client Sample ID: Laredo Columbia WWTP

Lab Sample ID: 560-84031-2

Date Collected: 12/18/19 10:00

Matrix: Solid

Date Received: 12/19/19 08:30

Method: 20B - Sodium Adsorption Ratio - Soluble

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Dissolved Calcium	460				mg/L		12/27/19 11:40	01/07/20 14:55	1
Dissolved Magnesium	76.0				mg/L		12/27/19 11:40	01/07/20 14:55	1
Dissolved Sodium	339				mg/L		12/27/19 11:40	01/07/20 14:55	1
Sodium Adsorption Ratio	3.90				NONE		12/27/19 11:40	01/07/20 14:55	1
Dissolved Potassium	0.000				mg/L		12/27/19 11:40	01/07/20 14:55	1

Method: 6010B - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	48900		2430	729	mg/Kg		12/24/19 17:57	01/07/20 11:11	10
Sodium	455		97.2	24.3	mg/Kg		12/24/19 17:57	01/06/20 16:38	1
Magnesium	4270		97.2	24.3	mg/Kg		12/24/19 17:57	01/06/20 16:38	1
Potassium	1460	F1	486	146	mg/Kg		12/24/19 17:57	01/06/20 16:38	1
Phosphorus	335		48.6	14.6	mg/Kg		12/24/19 17:57	01/06/20 16:38	1
Sulfur	2460	F1	486	146	mg/Kg		12/24/19 17:57	01/06/20 16:38	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia	5.29	J F2 F1	20.0	2.37	mg/Kg		01/08/20 07:03	01/08/20 12:48	1
Nitrogen, Kjeldahl	240	F1	40.0	31.1	mg/Kg			01/14/20 16:34	1
pH	7.5	HF	0.1	0.1	SU			12/23/19 11:00	1
Nitrogen, Organic	235		1.00	0.777	mg/Kg			01/15/20 14:44	1

General Chemistry - Soluble

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrate as N	41.2	J B	100	4.00	mg/L			01/01/20 04:40	20
Chloride	89.0	J	200	10.0	mg/L			01/01/20 04:40	20
Sulfate	3680	B	200	20.0	mg/L			01/01/20 04:40	20
Specific Conductance	1840		1.00	1.00	umhos/cm			01/07/20 10:00	1

Eurofins TestAmerica, Corpus Christi

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 20B - Sodium Adsorption Ratio

Lab Sample ID: MB 560-170254/1-A

Matrix: Solid

Analysis Batch: 170438

Client Sample ID: Method Blank

Prep Type: Soluble

Prep Batch: 170254

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Dissolved Calcium	0.0000				mg/L		12/27/19 11:40	01/07/20 14:55	1
Dissolved Magnesium	0.0000				mg/L		12/27/19 11:40	01/07/20 14:55	1
Dissolved Sodium	0.0000				mg/L		12/27/19 11:40	01/07/20 14:55	1
Sodium Adsorption Ratio	0.0000				NONE		12/27/19 11:40	01/07/20 14:55	1
Dissolved Potassium	0.0000				mg/L		12/27/19 11:40	01/07/20 14:55	1

Lab Sample ID: 560-84031-2 DU

Matrix: Solid

Analysis Batch: 170438

Client Sample ID: Laredo Columbia WWTP

Prep Type: Soluble

Prep Batch: 170254

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	Limit
Dissolved Calcium	460		470.0		mg/L		2	
Dissolved Magnesium	76.0		71.00		mg/L		7	
Dissolved Sodium	339		272.0		mg/L		22	
Sodium Adsorption Ratio	3.90		3.100		NONE		23	
Dissolved Potassium	0.000		0.0000		mg/L		NC	

Method: 6010B - Metals (ICP)

Lab Sample ID: MB 160-455094/1-A

Matrix: Solid

Analysis Batch: 455888

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 455094

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sodium	23.9	U	95.5	23.9	mg/Kg		12/24/19 17:57	01/06/20 16:11	1
Magnesium	23.9	U	95.5	23.9	mg/Kg		12/24/19 17:57	01/06/20 16:11	1
Potassium	143	U	478	143	mg/Kg		12/24/19 17:57	01/06/20 16:11	1
Phosphorus	14.3	U	47.8	14.3	mg/Kg		12/24/19 17:57	01/06/20 16:11	1
Sulfur	143	U	478	143	mg/Kg		12/24/19 17:57	01/06/20 16:11	1

Lab Sample ID: MB 160-455094/1-A

Matrix: Solid

Analysis Batch: 456053

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 455094

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	71.7	U	239	71.7	mg/Kg		12/24/19 17:57	01/07/20 10:58	1

Lab Sample ID: LCS 160-455094/2-A

Matrix: Solid

Analysis Batch: 455888

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Phosphorus	96.8	97.79		mg/Kg		101	80 - 120
Sulfur	968	914.4		mg/Kg		94	80 - 120

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 6010B - Metals (ICP) (Continued)

Lab Sample ID: LCSSRM 160-455094/3-A ^5

Matrix: Solid

Analysis Batch: 455888

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Spike Added	LCSSRM Result	LCSSRM Qualifier	Unit	D	%Rec	%Rec. Limits
Sodium	2930	2279		mg/Kg		77.8	56.0 - 111.6
Magnesium	15500	12830		mg/Kg		82.8	64.0 - 110.3
Potassium	24100	19460		mg/Kg		80.8	60.6 - 110.0

Lab Sample ID: LCSSRM 160-455094/3-A ^5

Matrix: Solid

Analysis Batch: 456053

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Spike Added	LCSSRM Result	LCSSRM Qualifier	Unit	D	%Rec	%Rec. Limits
Calcium	10300	8448		mg/Kg		82.0	65.0 - 109.7

Lab Sample ID: 560-84031-2 MS

Matrix: Solid

Analysis Batch: 455888

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Sodium	455		842	1253		mg/Kg		95	75 - 125
Magnesium	4270		842	6146	4	mg/Kg		222	75 - 125
Potassium	1460	F1	842	3909	F1	mg/Kg		291	75 - 125
Phosphorus	335		84.2	431.4		mg/Kg		115	75 - 125
Sulfur	2460	F1	842	2770	F1	mg/Kg		37	75 - 125

Lab Sample ID: 560-84031-2 MSD

Matrix: Solid

Analysis Batch: 455888

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Sodium	455		954	1337		mg/Kg		92	75 - 125	6	20
Magnesium	4270		954	5788	4	mg/Kg		159	75 - 125	6	20
Potassium	1460	F1	954	3518	F1	mg/Kg		216	75 - 125	11	20
Phosphorus	335		95.4	421.8		mg/Kg		92	75 - 125	2	20
Sulfur	2460	F1	954	3297		mg/Kg		88	75 - 125	17	20

Lab Sample ID: 560-84031-D-2-B MS ^10

Matrix: Solid

Analysis Batch: 456053

Client Sample ID: 560-84031-D-2-B MS ^10

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Calcium	53990		842	46370	4	mg/Kg		-904	75 - 125

Lab Sample ID: 560-84031-D-2-C MSD ^10

Matrix: Solid

Analysis Batch: 456053

Client Sample ID: 560-84031-D-2-C MSD ^10

Prep Type: Total/NA

Prep Batch: 455094

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Calcium	53990		954	45320	4	mg/Kg		-909	75 - 125	2	20

Eurofins TestAmerica, Corpus Christi

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 1664A - HEM and SGT-HEM

Lab Sample ID: MB 560-170094/1

Matrix: Water

Analysis Batch: 170094

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Oil & Grease (HEM)	1.4	U	5.0	1.4	mg/L			12/20/19 09:05	1

Lab Sample ID: LCS 560-170094/2

Matrix: Water

Analysis Batch: 170094

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Oil & Grease (HEM)	39.9	32.90		mg/L		82	78 - 114

Method: 300.0 - Anions, Ion Chromatography

Lab Sample ID: MB 560-170350/3

Matrix: Water

Analysis Batch: 170350

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	0.192	U	1.00	0.192	mg/L			12/31/19 12:26	1
Nitrate as N	0.2040	J	0.500	0.103	mg/L			12/31/19 12:26	1
Sulfate	0.377	U	1.00	0.377	mg/L			12/31/19 12:26	1

Lab Sample ID: LCS 560-170350/4

Matrix: Water

Analysis Batch: 170350

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Chloride	10.0	10.02		mg/L		100	90 - 110
Nitrate as N	5.00	5.031		mg/L		101	90 - 110
Sulfate	20.0	20.37		mg/L		102	90 - 110

Method: 350.1 - Nitrogen, Ammonia

Lab Sample ID: MB 600-284704/1-A

Matrix: Solid

Analysis Batch: 284760

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 284704

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia	2.37	U	20.0	2.37	mg/Kg		01/08/20 07:03	01/08/20 12:46	1

Lab Sample ID: LCS 600-284704/2-A

Matrix: Solid

Analysis Batch: 284760

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 284704

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	500	500.9		mg/Kg		100	90 - 110

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 350.1 - Nitrogen, Ammonia (Continued)

Lab Sample ID: 560-84031-2 MS

Matrix: Solid

Analysis Batch: 284760

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Prep Batch: 284704

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	5.29	J F2 F1	500	802.0	F1	mg/Kg		159	90 - 110

Lab Sample ID: 560-84031-2 MSD

Matrix: Solid

Analysis Batch: 284760

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Prep Batch: 284704

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Ammonia	5.29	J F2 F1	500	538.3	F2	mg/Kg		107	90 - 110	39	20

Method: 351.2 - Nitrogen, Total Kjeldahl

Lab Sample ID: MB 600-284771/10

Matrix: Water

Analysis Batch: 284771

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrogen, Kjeldahl	0.432	U	1.00	0.432	mg/L			01/08/20 15:14	1

Lab Sample ID: LCS 600-284771/11

Matrix: Water

Analysis Batch: 284771

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrogen, Kjeldahl	10.0	9.112		mg/L		91	90 - 110

Lab Sample ID: 560-84031-1 MS

Matrix: Water

Analysis Batch: 284771

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrogen, Kjeldahl	0.783	J F1	10.0	9.650	F1	mg/L		89	90 - 110

Lab Sample ID: 560-84031-1 MSD

Matrix: Water

Analysis Batch: 284771

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Nitrogen, Kjeldahl	0.783	J F1	10.0	8.175	F1	mg/L		74	90 - 110	17	20

Lab Sample ID: MB 600-285256/10

Matrix: Solid

Analysis Batch: 285256

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrogen, Kjeldahl	31.1	U	40.0	31.1	mg/Kg			01/14/20 16:32	1

Eurofins TestAmerica, Corpus Christi

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 351.2 - Nitrogen, Total Kjeldahl (Continued)

Lab Sample ID: LCS 600-285256/11

Matrix: Solid

Analysis Batch: 285256

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrogen, Kjeldahl	400	385.5		mg/Kg		96	90 - 110

Lab Sample ID: 560-84031-2 MS

Matrix: Solid

Analysis Batch: 285256

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrogen, Kjeldahl	240	F1	400	469.2	F1	mg/Kg		57	90 - 110

Lab Sample ID: 560-84031-2 MSD

Matrix: Solid

Analysis Batch: 285256

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Nitrogen, Kjeldahl	240	F1	400	538.8	F1	mg/Kg		75	90 - 110	14	20

Method: 9045D - pH

Lab Sample ID: LCS 560-170158/2

Matrix: Solid

Analysis Batch: 170158

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
pH	5.00	5.0		SU		99	98 - 102

Lab Sample ID: 560-84031-2 DU

Matrix: Solid

Analysis Batch: 170158

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	RPD Limit
pH	7.5	HF	7.5		SU		0.1	20

Method: 9056 - Anions, Ion Chromatography

Lab Sample ID: MB 560-170026/1-A

Matrix: Solid

Analysis Batch: 170350

Client Sample ID: Method Blank

Prep Type: Soluble

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrate as N	1.930	J	5.00	0.200	mg/L			01/01/20 01:22	1
Chloride	0.500	U	10.0	0.500	mg/L			01/01/20 01:22	1
Sulfate	3.210	J	10.0	1.00	mg/L			01/01/20 01:22	1

Lab Sample ID: LCS 560-170026/2-A

Matrix: Solid

Analysis Batch: 170350

Client Sample ID: Lab Control Sample

Prep Type: Soluble

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrate as N	50.0	50.70		mg/L		101	80 - 120
Chloride	100	101.6		mg/L		102	80 - 120

Eurofins TestAmerica, Corpus Christi

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: 9056 - Anions, Ion Chromatography (Continued)

Lab Sample ID: LCS 560-170026/2-A

Matrix: Solid

Analysis Batch: 170350

Client Sample ID: Lab Control Sample

Prep Type: Soluble

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Sulfate	200	203.9		mg/L		102	80 - 120

Method: SM 2320B - Alkalinity

Lab Sample ID: MB 560-170269/1

Matrix: Water

Analysis Batch: 170269

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Alkalinity as CaCO3	5.00	U	5.00	5.00	mg/L			12/27/19 13:45	1

Lab Sample ID: LCS 560-170269/2

Matrix: Water

Analysis Batch: 170269

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Total Alkalinity as CaCO3	100	90.00		mg/L		90	85 - 115

Method: SM 2510B - Conductivity, Specific Conductance

Lab Sample ID: MB 560-170409/3

Matrix: Water

Analysis Batch: 170409

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Specific Conductance	1.00	U	1.00	1.00	umhos/cm			01/07/20 09:40	1

Lab Sample ID: LCS 560-170409/4

Matrix: Water

Analysis Batch: 170409

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Specific Conductance	999	1030		umhos/cm		103	90 - 110

Lab Sample ID: 560-84031-1 DU

Matrix: Water

Analysis Batch: 170409

Client Sample ID: Laredo Columbia WWTP

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	RPD Limit
Specific Conductance	1410		1410		umhos/cm		0	20

Lab Sample ID: MB 560-170410/1-A

Matrix: Solid

Analysis Batch: 170411

Client Sample ID: Method Blank

Prep Type: Soluble

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Specific Conductance	1.00	U	1.00	1.00	umhos/cm			01/07/20 10:00	1

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: SM 2510B - Conductivity, Specific Conductance (Continued)

Lab Sample ID: LCS 560-170410/2-A

Matrix: Solid

Analysis Batch: 170411

Client Sample ID: Lab Control Sample

Prep Type: Soluble

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Specific Conductance	999	1020		umhos/cm		102	90 - 110

Lab Sample ID: 560-84031-2 DU

Matrix: Solid

Analysis Batch: 170411

Client Sample ID: Laredo Columbia WWTP

Prep Type: Soluble

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	RPD Limit
Specific Conductance	1840		1850		umhos/cm		0.5	20

Method: SM 2540C - Solids, Total Dissolved (TDS)

Lab Sample ID: MB 560-170228/1

Matrix: Water

Analysis Batch: 170228

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	10.0	U	10.0	10.0	mg/L			12/24/19 14:50	1

Lab Sample ID: LCS 560-170228/2

Matrix: Water

Analysis Batch: 170228

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Total Dissolved Solids	2250	2120		mg/L		94	90 - 110

Method: SM 2540D - Solids, Total Suspended (TSS)

Lab Sample ID: MB 560-170084/1

Matrix: Water

Analysis Batch: 170084

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Suspended Solids	2.00	U	2.00	2.00	mg/L			12/20/19 11:15	1

Lab Sample ID: LCS 560-170084/2

Matrix: Water

Analysis Batch: 170084

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Total Suspended Solids	200	195.5		mg/L		98	80 - 120

Method: SM 4500 NH3 G - Ammonia

Lab Sample ID: MB 560-170181/3

Matrix: Water

Analysis Batch: 170181

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia as N	0.0450	U	0.200	0.0450	mg/L			12/23/19 14:42	1

Eurofins TestAmerica, Corpus Christi

QC Sample Results

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Method: SM 4500 NH3 G - Ammonia (Continued)

Lab Sample ID: LCS 560-170181/4

Matrix: Water

Analysis Batch: 170181

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia as N	2.50	2.556		mg/L		102	90 - 110

Method: SM4500 P E-1999 - Phosphorus

Lab Sample ID: MB 600-284391/3-A

Matrix: Water

Analysis Batch: 284395

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 284391

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Phosphorus	0.0210	U	0.0500	0.0210	mg/L		12/31/19 01:56	12/31/19 06:08	1

Lab Sample ID: LCS 600-284391/4-A

Matrix: Water

Analysis Batch: 284395

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 284391

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Total Phosphorus	0.500	0.5074		mg/L		101	90 - 110

Method: SM5210B CBOD - Carbonaceous BOD, 5 Day

Lab Sample ID: USB 560-170028/1

Matrix: Water

Analysis Batch: 170028

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	USB Result	USB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Carbonaceous Biochemical Oxygen Demand	2.00	U	2.00	2.00	mg/L			12/19/19 10:20	1

Lab Sample ID: USB 560-170028/2

Matrix: Water

Analysis Batch: 170028

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	USB Result	USB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Carbonaceous Biochemical Oxygen Demand	2.00	U	2.00	2.00	mg/L			12/19/19 10:20	1

Lab Sample ID: LCS 560-170028/3

Matrix: Water

Analysis Batch: 170028

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Carbonaceous Biochemical Oxygen Demand	198	160.5	*	mg/L		81	84.6 - 115.4

Accreditation/Certification Summary

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Laboratory: Eurofins TestAmerica, Corpus Christi

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
Texas	NELAP	T104704210-19-23	03-31-20

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
20B	20B	Solid	Dissolved Calcium
20B	20B	Solid	Dissolved Magnesium
20B	20B	Solid	Dissolved Potassium
20B	20B	Solid	Dissolved Sodium
20B	20B	Solid	Sodium Adsorption Ratio
SM 2540C		Water	Total Dissolved Solids
SM5210B CBOD		Water	Carbonaceous Biochemical Oxygen Demand

Laboratory: Eurofins TestAmerica, Houston

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
Texas	NELAP	T104704223-19-25	10-31-20

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
350.1	350.1	Solid	Ammonia
351.2		Solid	Nitrogen, Kjeldahl
Nitrogen,Org		Solid	Nitrogen, Organic

Accreditation/Certification Summary

Client: City of Laredo
Project/Site: Columbia Bridge WWTP TPDES Application

Job ID: 560-84031-1

Laboratory: Eurofins TestAmerica, St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
ANAB	Dept. of Defense ELAP	L2305	04-06-22
ANAB	Dept. of Energy	L2305.01	04-06-22
ANAB	ISO/IEC 17025	L2305	04-06-22
Arizona	State	AZ0813	12-08-20
California	Los Angeles County Sanitation Districts	10259	06-30-20
California	State	2886	06-30-20
Connecticut	State	PH-0241	03-31-21
Florida	NELAP	E87689	06-30-20
HI - RadChem Recognition	State	n/a	06-30-20
Illinois	NELAP	004553	11-30-19 *
Iowa	State	373	09-17-20
Kansas	NELAP	E-10236	10-31-20
Kentucky (DW)	State	KY90125	12-31-20
Louisiana	NELAP	04080	06-30-20
Louisiana (DW)	State	LA011	12-31-20
Maryland	State	310	09-30-20
MI - RadChem Recognition	State	9005	06-30-20
Missouri	State	780	06-30-22
Nevada	State	MO000542020-1	07-31-20
New Jersey	NELAP	MO002	06-30-20
New York	NELAP	11616	04-01-20
North Dakota	State	R-207	06-30-20
NRC	NRC	24-24817-01	12-31-22
Oklahoma	State	9997	08-31-20
Pennsylvania	NELAP	68-00540	02-28-20
South Carolina	State	85002001	06-30-20
Texas	NELAP	T104704193-19-13	07-31-20
US Fish & Wildlife	US Federal Programs	058448	07-31-20
USDA	US Federal Programs	P330-17-00028	02-02-20
Utah	NELAP	MO000542019-11	07-31-20
Virginia	NELAP	10310	06-14-20
Washington	State	C592	08-30-20
West Virginia DEP	State	381	10-31-20

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

Eurofins TestAmerica, Corpus Christi

Method Summary

Client: City of Laredo

Job ID: 560-84031-1

Project/Site: Columbia Bridge WWTP TPDES Application

Method	Method Description	Protocol	Laboratory
20B	Sodium Adsorption Ratio	USDA	TAL CC
6010B	Metals (ICP)	SW846	TAL SL
1664A	HEM and SGT-HEM	1664A	TAL CC
300.0	Anions, Ion Chromatography	MCAWW	TAL CC
350.1	Nitrogen, Ammonia	MCAWW	TAL HOU
351.2	Nitrogen, Total Kjeldahl	MCAWW	TAL HOU
9045D	pH	SW846	TAL CC
9056	Anions, Ion Chromatography	SW846	TAL CC
Nitrogen, Org	Organic Nitrogen	EPA	TAL HOU
SM 2320B	Alkalinity	SM	TAL CC
SM 2510B	Conductivity, Specific Conductance	SM	TAL CC
SM 2540C	Solids, Total Dissolved (TDS)	SM	TAL CC
SM 2540D	Solids, Total Suspended (TSS)	SM	TAL CC
SM 4500 NH3 G	Ammonia	SM	TAL CC
SM4500 P E-1999	Phosphorus	SM	TAL HOU
SM5210B CBOD	Carbonaceous BOD, 5 Day	SM	TAL CC
20B	Preparation, Sodium Absorption Ratio	USDA	TAL CC
3050B	Preparation, Metals	SW846	TAL SL
350.1	Distillation, Ammonia	EPA	TAL HOU
DI Leach	Deionized Water Leaching Procedure	ASTM	TAL CC
SM 4500 P B	Sample Preparation for Total and Ortho Phosphorus	SM	TAL HOU

Protocol References:

1664A = EPA-821-98-002

ASTM = ASTM International

EPA = US Environmental Protection Agency

MCAWW = "Methods For Chemical Analysis Of Water And Wastes", EPA-600/4-79-020, March 1983 And Subsequent Revisions.

SM = "Standard Methods For The Examination Of Water And Wastewater"

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

USDA = "USDA Agriculture Handbook 60, section 20B".

Laboratory References:

TAL CC = Eurofins TestAmerica, Corpus Christi, 1733 N. Padre Island Drive, Corpus Christi, TX 78408, TEL (361)289-2673

TAL HOU = Eurofins TestAmerica, Houston, 6310 Rothway Street, Houston, TX 77040, TEL (713)690-4444

TAL SL = Eurofins TestAmerica, St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Sample Summary

Client: City of Laredo

Job ID: 560-84031-1

Project/Site: Columbia Bridge WWTP TPDES Application

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Asset ID
560-84031-1	Laredo Columbia WWTP	Water	12/18/19 11:55	12/19/19 08:30	
560-84031-2	Laredo Columbia WWTP	Solid	12/18/19 10:00	12/19/19 08:30	

Chain of Custody Record

Loc: 560


84031



Client Information Client Contact: Saad Hassoun City of Laredo Address: 5816 Daugherty Avenue City: Laredo State, Zip: TX, 78041 Phone: 956-795-2720 (Tel) Email: shassoun@ci.laredo.tx.us Project Name: Columbia Bridge WWTP TPDES Application Site:		Sampler: Lab PMT: Maingot, Lindy Phone: E-Mail: lindy.maingot@testamericainc.com Carrit	
Due Date Requested: TAT Requested (days): PO #: Pre-Payment by CC Required WO #: Project #: SOW #:		Analysis Requested: 208_SAR, 6010 (Total Cations/Anions (ICP) - 6 reported) 9056 3501_1, 3512_NP 4500_P_E 3512_NP 1664A_NP - Local Method 2510B, 2540C, Calcd, 2540D, SM5210B, CBOD_5D 2320B, 300 SM4500NH3_G - Local Method Perform MS/MSD (Yes or No) Field Filtered Sample (Yes or No)	
Sample Identification Laredo Columbia WWTP Laredo Columbia WWTP	Sample Date 12-18-19 12-18-19	Sample Time 1155 1000	Sample Type (C=Comp, G=grab) G G
Matrix (Water, S=solid, O=oil, T=tissue, A=air) Water Water Solid Solid	Preservation Code: X X X X	Special Instructions/Note: ALL TEST must meet The MAL Standard method	Total Number of Containers 2510B 9045D 208_SAR, 6010 (Total Cations/Anions (ICP) - 6 reported) 9056 3501_1, 3512_NP 4500_P_E 3512_NP 1664A_NP - Local Method 2510B, 2540C, Calcd, 2540D, SM5210B, CBOD_5D 2320B, 300 SM4500NH3_G - Local Method Perform MS/MSD (Yes or No) Field Filtered Sample (Yes or No)
Possible Hazard Identification <input type="checkbox"/> Non-Hazard <input type="checkbox"/> Flammable <input type="checkbox"/> Skin Irritant <input type="checkbox"/> Poison B <input type="checkbox"/> Unknown <input type="checkbox"/> Radiological Deliverable Requested: I, II, III, IV, Other (specify)		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) <input type="checkbox"/> Return To Client <input type="checkbox"/> Disposal By Lab <input type="checkbox"/> Archive For Months	
Empty Kit Relinquished by: Saad Hassoun Relinquished by: Saad Hassoun Relinquished by: Relinquished by:		Method of Shipment: Date/Time: 12/19/19 8:30 Date/Time: Date/Time:	
Custody Seal No.: Δ Yes Δ No		Cooler Temperature(s) °C and Other Remarks: 2.5 12/13 2.3 CP	

[illegible]

Chain of Custody Record



Client Information (Sub Contract Lab) Client Contact: Shipping/Receiving Company: TestAmerica Laboratories, Inc. Address: 6310 Roffway Street, City: Houston State, Zip: TX, 77040 Phone: 713-690-4444(Tel) 713-690-5646(Fax) Email: Project Name: Columbia Bridge WWTP TPDES Application Site:		Sampler: Maingot, Lindy Lab PM: Maingot, Lindy E-Mail: lindy.maingot@testamericainc.com Accreditations Required (See note): NELAP - Texas	Carrier Tracking No(s): State of Origin: Texas Job #: 560-84031-1 Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Anchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other: M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (Specify)	COC No: 560-20662.1 Page: Page 1 of 1 Job #: 560-84031-1					
Due Date Requested: 1/3/2020 TAT Requested (days): PO #: WO #: Project #: 56007963 SSOW#:		Analysis Requested Perform MS/MSD (Yes or No) <input checked="" type="checkbox"/> Field Filtered Sample (Yes or No) <input checked="" type="checkbox"/> 351.2 NP <input checked="" type="checkbox"/> 4500 P E/SM4500 P B <input checked="" type="checkbox"/> 350 T/Disill_Amonia <input checked="" type="checkbox"/> Nitrogen_Org <input checked="" type="checkbox"/>							
Sample Identification - Client ID (Lab ID) Laredo Columbia WWTP (560-84031-1) Laredo Columbia WWTP (560-84031-2)		Sample Date 12/18/19 12/18/19	Sample Time 11:55 Central 10:00 Central	Sample Type (C=comp, G=grab) Water Solid	Matrix (W=water, S=solid, O=wastewater, BT=tissue, A=air) Water Solid	Preservation Code: 	Total Number of containers 6 3	Special Instructions/Note: 	
Note: Since laboratory accreditations are subject to change, Eurofins TestAmerica places the ownership of method, analyte & accreditation compliance upon our subcontract laboratories. This sample shipment is forwarded under chain-of-custody. If the laboratory does not currently maintain accreditation in the State of Origin listed above for analysis/matrix being analyzed, the samples must be shipped back to the Eurofins TestAmerica laboratory or other instructions will be provided. Any changes to accreditation status should be brought to Eurofins TestAmerica attention immediately. If all requested accreditations are current to date, return the signed Chain of Custody attesting to said compliance to Eurofins TestAmerica.									
Possible Hazard Identification Unconfirmed Deliverable Requested: I, II, III, IV, Other (specify) Primary Deliverable Rank: 2									Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) <input type="checkbox"/> Return To Client <input type="checkbox"/> Disposal By Lab <input type="checkbox"/> Archive For _____ Months
Empty Kit Relinquished by: _____ Date: _____ Relinquished by: _____ Date/Time: 12/19/19 17:00 Company: ECA Relinquished by: _____ Date/Time: _____ Company: _____ Relinquished by: _____ Date/Time: _____ Company: _____									Received by: <i>Maingot</i> Received by: <i>Maingot</i> Received by: <i>Maingot</i> Date/Time: 12/19/19 12:57 Company: ECA Date/Time: _____ Company: _____
Custody Seals Intact: <input type="checkbox"/> Yes <input type="checkbox"/> No Custody Seal No.: _____ Cooler Temperature(s) °C and Other Remarks: _____									Method of Shipment: _____ Cooler Temperature(s) °C and Other Remarks: _____

Eurofins TestAmerica Houston

Environment Testing
TestAmerica

Sample Receipt Checklist

19 DEC 20 12:57

JOB NUMBER: _____

Date/Time Received: _____

CLIENT: _____

UNPACKED BY: _____

CARRIER/DRIVER: _____

Custody Seal Present: ☒ YES ☐ NO

Number of Coolers Received: 1

Cooler ID	Temp Blank	Trip Blank	Observed Temp (°C)	Therm ID	Therm CF	Corrected Temp (°C)
8542	Y / N	Y / N	0.5	676	+0.1	0.6
	Y / N	Y / N				
	Y / N	Y / N				
	Y / N	Y / N				
	Y / N	Y / N				
	Y / N	Y / N				

CF = correction factor

Samples received on ice? ☒ YES ☐ NOLABORATORY PRESERVATION OF SAMPLES REQUIRED: ☒ NO ☐ YESBase samples are > pH 12: ☐ YES ☐ NOAcid preserved are < pH 2: ☐ YES ☐ NOTX1005 samples frozen upon receipt: ☐ YES DATE & TIME PUT IN FREEZER: _____

pH paper Lot # _____

VOA headspace acceptable (5-6mm): ☐ YES ☐ NO ☒ NA

Did samples meet the laboratory's standard conditions of sample acceptability upon receipt?

☒ YES ☐ NO

COMMENTS:

HS-SA-WI-013

Rev. 4A; 08/26/2019

Login Sample Receipt Checklist

Client: City of Laredo

Job Number: 560-84031-1

Login Number: 84031

List Source: Eurofins TestAmerica, Corpus Christi

List Number: 1

Creator: Olson, Troy

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	Check done at department level as required.

Login Sample Receipt Checklist

Client: City of Laredo

Job Number: 560-84031-1

Login Number: 84031

List Number: 3

Creator: Taylor, Jacquelyn R

List Source: Eurofins TestAmerica, Houston

List Creation: 12/23/19 11:43 AM

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	Lab does not accept radioactive samples.
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	0.6
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	Check done at department level as required.

Login Sample Receipt Checklist

Client: City of Laredo

Job Number: 560-84031-1

Login Number: 84031

List Number: 2

Creator: Hellm, Michael

List Source: Eurofins TestAmerica, St. Louis

List Creation: 12/20/19 02:49 PM

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	0.1
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	N/A	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	N/A	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

ATTACHMENT H

Sludge Transportation Agreement Tech Rpt. 1.0 Section 9

The South Laredo Wastewater Treatment Facility is authorized to receive, process, and dispose of water treatment plant sludge from the Columbia Bridge Wastewater Treatment Facility. See Attached page from South Laredo WWTF TPDES Permit.

Systems. The permittee shall clearly show how the treatment system will meet the effluent limitations required on Page 2a of this permit. A copy of the summary transmittal letter shall be available at the plant site for inspection by authorized representatives of the TCEQ.

8. The permittee shall notify the TCEQ Regional Office (MC Region 16) and the Applications Review and Processing Team (MC 148) of the Water Quality Division, in writing at least forty-five (45) days prior to the completion of the Final phase facility on Notification of Completion Form 20007.
9. The permittee is authorized to receive, process, and dispose of the wastewater sludge generated at the Columbia Bridge Wastewater Treatment Plant (WWTP) (Permit No. WQ0010681006), Unitec WWTP (Permit No. WQ0010681005), North Laredo WWTP (Permit No. WQ0010681004), Webb County Detention Center WWTP (Permit No. WQ0012271001), El Cenizo WWTP (Permit No. WQ0013577001), Zacate Creek WWTP (Permit No. WQ0010681002), Penitas WWTP (Permit No. WQ0010681007), and Sombreretillo WWTP (Permit No. WQ0010681008). The permittee shall ensure that the appropriate sludge metals and toxicity characteristic leaching procedure (TCLP) analysis satisfies 30 TAC Chapter 312 rules for disposing of sewage sludge.
10. The permittee must maintain capacity in the South Laredo Wastewater Treatment Facility to treat the supernatant from the Zacate Creek digester. The permittee shall monitor the flow and five-day biochemical oxygen demand (BOD₅) concentration of the supernatant.
11. The aerobic digester, if in use, shall be adequately lined to control seepage. The liner shall meet the requirements in 30 TAC Section 217.203, Design Criteria for Natural Treatment Facilities.

The permittee shall furnish certification by a Texas Licensed Professional Engineer that the completed pond lining meets the appropriate criteria above prior to use of the facilities. The certification shall be submitted to the TCEQ Regional Office (MC Region 16) and the Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division.

12. The expansion of this facility to 18 million gallons per day is designed to accommodate wastewater flow currently being treated at another facility (City of Laredo Zacate Creek WWTP, WQ0010681002). The Zacate Creek facility will be closed after its wastewater flow is diverted. The modeling analysis was performed assuming cessation of discharge from the Zacate Creek facility.

ATTACHMENT I

**Cropping Plan Justification
Wksht 3.0 Section 5**

**ATTACHMENT I
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES RENEWAL PERMIT APPLICATION
REQUEST FOR INFORMATION**

CROPPING PLAN JUSTIFICATION

Although the existing permit authorizes land application through on-site irrigation, the land disposal of effluent has never been implemented. As no effluent has been applied, a cropping plan is not needed for the effluent disposal site.

ATTACHMENT J

**Effluent Monitoring Data
Wksht 3.0 Section 9**

**ATTACHMENT J
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

EFFLUENT MONITORING DATA

Date	30 Day Avg Flow, MGD	BOD₅, mg/L	TSS, mg/L	pH	Chlorine Residual, mg/L	Total Acres Irrigated
08-2016	0.017	2.0	6.5	6.6	3.7	0
09-2016	0.017	2.0	8.9	7	3.7	0
10-2016	0.018	2.2	4.3	6.9	3.3	0
11-2016	0.016	2.2	3.8	7.2	3.5	0
12-2016	0.015	2.2	6.6	6.8	3.7	0
01-2017	0.020	2.0	4.8	7.1	3.5	0
02-2017	0.014	2.0	6.0	7.2	3.3	0
03-2017	0.010	5.8	5.5	6.4	3.7	0
04-2017	0.015	2.0	4.1	7.1	3.5	0
05-2017	0.014	2.0	4.0	7.1	3.7	0
06-2017	0.016	2.0	4.7	6.6	3.5	0
08-2017	0.019	2.0	6.1	6.7	3.9	0
08-2017	0.020	2.0	4.1	6.9	3.7	0
09-2017	0.014	2.0	4.7	6.5	3.7	0
10-2017	0.017	2.3	4.9	7.1	3.7	0
11-2017	0.011	2.8	4.4	7.6	3.4	0
12-2017	0.014	3.4	5.5	6.9	3.0	0
01-2018	0.020	2.3	4.3	6.6	3.4	0
02-2018	0.016	2.8	4.8	6.6	3.6	0
03-2018	0.013	2.8	6.6	6.3	3.4	0
04-2018	0.013	4.0	12.1	6.3	3.9	0
05-2018	0.013	3.0	4.0	6.5	3.7	0
06-2018	0.011	2.0	3.5	6.1	4.0	0
07-2018	0.007	2.0	8.8	6.1	4.0	0
08-2018	0.018	2.3	10.8	6.8	4.0	0
09-2018	0.016	2.0	6.8	6.3	4.0	0
10-2018	0.028	2.0	6.0	6.4	3.9	0
11-2018	0.034	2.0	5.9	6.8	4.0	0
12-2018	0.030	2.2	3.3	7.9	3.8	0
01-2019	0.034	2.2	6.4	6.8	4.0	0
02-2019	0.030	2.9	7.0	7	4.0	0
03-2019	0.028	2.0	6.8	7	4.0	0
04-2019	0.024	2.3	4.6	6.6	4.0	0
05-2019	0.027	2.0	6.0	6.9	4.0	0
06-2019	0.033	3.2	4.5	7.1	3.9	0
07-2019	0.028	2.0	3.6	7	4.0	0
08-2019	0.028	2.0	9.2	7.1	3.8	0
09-2019	0.034	2.0	5.0	6.8	3.4	0
10-2019	0.035	2.0	3.6	6.5	3.8	0

ATTACHMENT K

**Effluent Parameters Above the MAL
Wksht 6.0 Section 2.C**

**ATTACHMENT K
CITY OF LAREDO
COLUMBIA BRIDGE WASTEWATER TREATMENT FACILITY
TPDES PERMIT RENEWAL APPLICATION**

EFFLUENT PARAMETERS ABOVE THE MAL

Pollutant	Concentration	MAL	Units	Date
Aluminum	92.0	2.5	µg/L	9/6/2017
Arsenic	4.0	0.5	µg/L	9/6/2017
Barium	51.0	3	µg/L	9/6/2017
Chromium, Total	5.6	3	µg/L	9/6/2017
Chromium, Tri	5.8	3	µg/L	9/6/2017
Copper, Total	8.8	2	µg/L	9/6/2017
Fluoride	530	500	µg/L	9/6/2017
Lead, Total	2.5	0.5	µg/L	9/6/2017
Nickel, Total	4.1	2	µg/L	9/6/2017
Nitrate-Nitrogen	27,000	100	µg/L	9/6/2017
Selenium, Total	2.1	5	µg/L	9/6/2017
Zinc, Total	55.0	5	µg/L	9/6/2017
Chlorodibromomethane	17.0	10	µg/L	9/6/2017
Chloroform	32.0	10	µg/L	9/6/2017
Dichlorobromomethane	29.0	10	µg/L	9/6/2017
TTHM (Total Trihalomethanes)	81.0	10	µg/L	9/6/2017
Aluminum	140	2.5	µg/L	5/11/2018
Arsenic, Total	1.9	0.5	µg/L	5/11/2018
Barium	68.0	3	µg/L	5/11/2018
Copper	9.7	2	µg/L	5/11/2018
Mercury	0.006	0.005	µg/L	5/11/2018
Nitrate-Nitrogen	45,000	100	µg/L	5/11/2018
Zinc, Total	11.0	5	µg/L	5/11/2018
Chlorodibromomethane	20	10	µg/L	5/11/2018
Chloroform	23	10	µg/L	5/11/2018
Dichlorobromomethane	27	10	µg/L	5/11/2018
Aluminum	77	2.5	µg/L	5/15/2019
Arsenic	1.2	0.5	µg/L	5/15/2019
Barium	79	3	µg/L	5/15/2019
Copper	23	2	µg/L	5/15/2019
Zinc	14	5	µg/L	5/15/2019
TTHM (Total Trihalomethanes)	21	10	µg/L	5/15/2019

**EXECUTIVE DIRECTOR'S PRELIMINARY DECISION
AND
DRAFT PERMIT**

**STATEMENT OF BASIS/TECHNICAL SUMMARY
AND EXECUTIVE DIRECTOR'S PRELIMINARY DECISION**

DESCRIPTION OF APPLICATION

Applicant:	City of Laredo Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0010681006, EPA ID No. TX0107395
Regulated Activity:	Domestic Wastewater Permit
Type of Application:	Renewal
Request:	Renewal with no changes
Authority:	Federal Clean Water Act (CWA) § 402; Texas Water Code (TWC) § 26.027; 30 Texas Administrative Code (TAC) Chapters 30, 305, 307, 309, 312, and 319; Commission policies; and United States Environmental Protection Agency (EPA) guidelines.

EXECUTIVE DIRECTOR RECOMMENDATION

The Executive Director has made a preliminary decision that this permit, if issued, meets all statutory and regulatory requirements. The draft permit includes an expiration date of **five years from the date of issuance**.

REASON FOR PROJECT PROPOSED

The applicant has applied to the Texas Commission on Environmental Quality (TCEQ) for a renewal of the existing permit that authorizes the discharge of treated domestic wastewater at a daily average flow not to exceed 0.035 million gallons per day (MGD) in the Interim phase and a daily average flow not to exceed 0.16 MGD in the Final phase. The existing wastewater treatment facility serves a small area approximately 10 miles northwest of the City of Laredo.

PROJECT DESCRIPTION AND LOCATION

The Laredo/Colombia Solidarity Bridge Wastewater Treatment Facility is an activated sludge process plant operated in the extended aeration mode. Treatment units in the Interim phase include a bar screen, an aeration basin, a final clarifier, an aerobic digester, and a chlorine contact chamber. Treatment units in the Final phase include a bar screen, two aeration basins, two final clarifiers, two aerobic digesters, and two chlorine contact chambers. The facility is operating in the Interim phase.

Sludge generated from the treatment facility is hauled by a registered transporter to South Laredo Wastewater Treatment Facility, Permit No. WQ0010681003, to be digested, dewatered, and then disposed of with the bulk of the sludge from the plant accepting the sludge. The draft permit also authorizes the disposal of sludge at a TCEQ-authorized land application site, co-disposal landfill, wastewater treatment facility, or facility that further processes sludge.

The plant site is located Approximately 1.1 miles southwest of Farm-to-Market Road 1472 and State Highway 255 on an unnamed country road and 10.5 miles west-northwest of Farm-to-Market Roads 1472 and 3338, adjacent to the Rio Grande, in Webb County, Texas 78045.

Outfall Location:

Outfall Number	Latitude	Longitude
001	27.692214 N	99.736832 W

The treated effluent is discharged directly to Rio Grande Below Amistad Reservoir in Segment No. 2304 of the Rio Grande Basin. The designated uses for Segment No. 2304 are primary contact recreation, public water supply, and high aquatic life use. The effluent limitations in the draft permit will maintain and protect the existing instream uses. All determinations are preliminary and subject to additional review and/or revisions.

Effluent limitations for the conventional effluent parameters (i.e., Biochemical Oxygen Demand or Carbonaceous Biochemical Oxygen Demand, Ammonia Nitrogen, etc.) are based on stream standards and waste load allocations for water-quality limited streams as established in the Texas Surface Water Quality Standards (TSWQS) and the State of Texas Water Quality Management Plan (WQMP).

For this type of discharge, end-of-pipe compliance with pH limits between 6.0 and 9.0 standard units reasonably assures instream compliance with the TSWQS for pH when the discharge authorized is from a minor facility. This conservative assumption is based on TCEQ sampling conducted throughout the state that indicates that instream buffering quickly restores pH levels to ambient conditions.

The effluent limitations in the draft permit have been reviewed for consistency with the WQMP. The existing effluent limitations are contained in the approved WQMP.

The discharge from this permit action is not expected to have an effect on any federal endangered or threatened aquatic or aquatic-dependent species or proposed species or their critical habitat. This determination is based on the United States Fish and Wildlife Service's (USFWS's) biological opinion on the State of Texas authorization of the TPDES (September 14, 1998; October 21, 1998, update). To make this determination for TPDES permits, TCEQ and EPA only considered aquatic or aquatic-dependent species occurring in watersheds of critical concern or high priority as listed in Appendix A of the USFWS biological opinion. The determination is subject to reevaluation due to subsequent updates or amendments to the biological opinion. The permit does not require EPA review with respect to the presence of endangered or threatened species.

Segment No. 2304 is currently listed on the state's inventory of impaired and threatened waters (the 2018 CWA § 303(d) list). The listing is specifically for elevated bacteria levels from a point 0.66 kilometers (0.41 mile) upstream of the confluence of the Arroyo El Lobo (Mexico) in Webb County upstream to the San Idelfonso Creek confluence (AU 2304_01), from the San Idelfonso Creek confluence upstream to International Bridge #2 (AU 2304_02), from the International Bridge #2 upstream to the City of Laredo water treatment plant intake (AU 2304_03), from El Indio upstream to downstream of U.S. Highway 277 (Eagle Pass) (AU 2304_07), and from the Las Moras Creek confluence upstream to the San Felipe Creek confluence (AU 2304_09). This

facility is designed to provide adequate disinfection and, when operated properly, should not add to the bacterial impairment of the segment. In addition, in order to ensure that the proposed discharge meets the stream bacterial standard, an effluent limitation of 126 colony-forming units (CFU) or most probable number (MPN) of *Escherichia coli* per 100 ml will be continued in the draft permit.

SUMMARY OF EFFLUENT DATA

The following is a summary of the applicant's effluent monitoring data for the period from May 2018 through May 2020. The average of Daily Average value is computed by the averaging of all 30-day average values for the reporting period for each parameter: flow, five-day biochemical oxygen demand (BOD₅), and total suspended solids (TSS). The average of Daily Average value for *E. coli* in CFU or MPN per 100 ml is calculated via geometric mean.

<u>Parameter</u>	<u>Average of Daily Average</u>
Flow, MGD	0.025
BOD ₅ , mg/l	2.3
TSS, mg/l	6.4
<i>E. coli</i> , CFU or MPN per 100 ml	2

DRAFT PERMIT CONDITIONS

The draft permit authorizes a discharge of treated domestic wastewater at an interim volume not to exceed a daily average flow of 0.035 MGD and a final volume not to exceed a daily average flow of 0.16 MGD.

The effluent limitations in both phases of the draft permit, based on a 30-day average, are 20 mg/l BOD₅, 20 mg/l TSS, 126 CFU or MPN of *E. coli* per 100 ml, and 2.0 mg/l minimum dissolved oxygen (DO). The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes based on peak flow.

The facility does not appear to receive significant industrial wastewater contributions. Permit requirements for pretreatment are based on TPDES regulations contained in 30 TAC Chapter 315, which references 40 Code of Federal Regulations (CFR) Part 403, "General Pretreatment Regulations for Existing and New Sources of Pollution" [*rev. Federal Register/ Vol. 70/ No. 198/ Friday, October 14, 2005/ Rules and Regulations, pages 60134-60798*]. The draft permit includes specific requirements that establish responsibilities of local government, industry, and the public to implement the standards to control pollutants which pass through or interfere with treatment processes in publicly owned treatment works (POTWs) or which may contaminate the sewage sludge. This permit has appropriate pretreatment language for a facility of this size and complexity.

The permittee has a pretreatment program which was approved by the EPA on **December 29, 2005**. The permittee is required, under the conditions of the approved pretreatment program, to prepare annually a list of industrial users which during the preceding twelve months were in significant noncompliance with applicable pretreatment requirements for those facilities covered under the program. This list is to be published annually during the month of **January** in a newspaper of general

circulation that provides meaningful public notice within the jurisdiction(s) served by the POTW.

Effective December 21, 2023, the permittee must submit the pretreatment program annual status report electronically using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. [rev. *Federal Register/ Vol. 80/ No. 204/ Friday, October 22, 2015/ Rules and Regulations, pages 64064-64158*].

The permittee is under a continuing duty to: establish and enforce specific local limits, to implement the provisions of 40 CFR § 403.5, to develop and enforce local limits as necessary, and to modify the approved POTW pretreatment program as necessary to comply with federal, state, and local law, as amended. The permittee is required to effectively enforce such limits and to modify their pretreatment program, including the Legal Authority, Enforcement Response Plan and/or Standard Operating Procedures (including forms), if required by the Executive Director to reflect changing conditions at the POTW.

The legal authority and the POTW's pretreatment program are not in compliance with current 40 CFR Part 403 regulations [rev. *Federal Register/ Vol. 70/ No. 198/ Friday, October 14, 2005/ Rules and Regulations, pages 60134-60798*] and 30 TAC Chapter 315, as amended. The permittee has submitted a modification to their pretreatment program containing some or all of the required [i.e. more stringent] Streamlining Rule provisions to the TCEQ on **October 4, 2011**, and revisions submitted in **January 2017**. The Executive Director is currently reviewing this modification. If after review of the modification submission, the Executive Director determines that the submission does not comply with applicable requirements, including 40 CFR §§ 403.8 and 403.9, the Executive Director will notify the permittee. According to 40 CFR § 403.11(c), the notification will include suggested revisions to bring the modification submission into compliance with applicable requirements, including 40 CFR § 403.8(b) and (f), and 40 CFR § 403.9(b). In such a case, revised information will be necessary for the Executive Director to make a determination on whether to accept, approve, or deny the permittee's modification submission, as applicable.

The draft permit also includes authorization to dispose of a portion of the treated effluent via irrigation of 6.63 acres at a maximum application rate of 5.91 acre-feet per year per acre irrigated.

The draft permit includes Sludge Provisions according to the requirements of 30 TAC Chapter 312, Sludge Use, Disposal, and Transportation. Sludge generated from the treatment facility is hauled by a registered transporter to South Laredo Wastewater Treatment Facility, Permit No. WQ0010681003, to be digested, dewatered, and then disposed of with the bulk of the sludge from the plant accepting the sludge. The draft permit also authorizes the disposal of sludge at a TCEQ-authorized land application site, co-disposal landfill, wastewater treatment facility, or facility that further processes sludge.

SUMMARY OF CHANGES FROM APPLICATION

None.

SUMMARY OF CHANGES FROM EXISTING PERMIT

Effluent limitations and monitoring requirements in the draft permit remain the same as the existing permit requirements.

The Standard Permit Conditions, Sludge Provisions, and Other Requirements sections of the draft permit have been updated.

The pretreatment language has been updated from the current permit. The pretreatment requirements will continue until permit expiration. Please see specific details in the Pretreatment Requirements Section of the fact sheet.

For Publicly Owned Treatment Works (POTWs), effective December 21, 2023, the permittee must submit the written report for unauthorized discharges and unanticipated bypasses that exceed any effluent limit in the permit using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver.

Effective December 21, 2020, the permittee must submit the annual sludge report using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. The Reporting Requirements of the Sludge Provisions have also been updated.

Certain accidental discharges or spills of treated or untreated wastewater from wastewater treatment facilities or collection systems owned or operated by a local government may be reported on a monthly basis in accordance with 30 TAC § 305.132.

Other Requirement No. 1 in the existing permit has been updated to reflect the requirements of 30 TAC § 30.342, which does not allow renewal of a Class D operator's license for mechanical treatment plants.

Other Requirement No. 3 in the existing permit has been removed because this provision is covered under 30 TAC § 305.62(d), which authorizes the TCEQ to reopen an issued permit when necessary.

BASIS FOR DRAFT PERMIT

The following items were considered in developing the draft permit:

1. Application received on March 4, 2020, and additional information received on April 27, 2020, May 1, 2020, and July 21, 2020.
2. TPDES Permit No. WQ0010681006 issued on October 7, 2015.
3. The effluent limitations and conditions in the draft permit comply with EPA-approved portions of the 2018 Texas Surface Water Quality Standards (TSWQS), 30 TAC §§ 307.1 - 307.10, effective March 1, 2018; 2014 TSWQS, effective March 6, 2014; 2010 TSWQS, effective July 22, 2010; and 2000 TSWQS, effective July 26, 2000.

4. The effluent limitations in the draft permit meet the requirements for secondary treatment and the requirements for disinfection according to 30 TAC Chapter 309, Subchapter A: Effluent Limitations.
5. Interoffice memoranda from the Water Quality Assessment Section of the TCEQ Water Quality Division. Interoffice memorandum from the Pretreatment Team of the TCEQ Water Quality Division.
6. Consistency with the Coastal Management Plan: The facility is not located in the Coastal Management Program boundary.
7. *Procedures to Implement the Texas Surface Water Quality Standards* (IP), Texas Commission on Environmental Quality, June 2010, as approved by EPA, and the IP, January 2003, for portions of the 2010 IP not approved by EPA.
8. Texas 2018 CWA Section 303(d) List, Texas Commission on Environmental Quality, September 27, 2019; approved by the EPA on December 23, 2019.
9. Texas Natural Resource Conservation Commission, Guidance Document for Establishing Monitoring Frequencies for Domestic and Industrial Wastewater Discharge Permits, Document No. 98-001.000-OWR-WQ, May 1998.

PROCEDURES FOR FINAL DECISION

When an application is declared administratively complete, the Chief Clerk sends a letter to the applicant advising the applicant to publish the Notice of Receipt of Application and Intent to Obtain Permit in the newspaper. In addition, the Chief Clerk instructs the applicant to place a copy of the application in a public place for review and copying in the county where the facility is or will be located. This application will be in a public place throughout the comment period. The Chief Clerk also mails this notice to any interested persons and, if required, to landowners identified in the permit application. This notice informs the public about the application, and provides that an interested person may file comments on the application or request a contested case hearing or a public meeting.

Once a draft permit is completed, it is sent, along with the Executive Director's preliminary decision, as contained in the technical summary or fact sheet, to the Chief Clerk. At that time, the Notice of Application and Preliminary Decision will be mailed to the same people and published in the same newspaper as the prior notice. This notice sets a deadline for making public comments. The applicant must place a copy of the Executive Director's preliminary decision and draft permit in the public place with the application.

Any interested person may request a public meeting on the application until the deadline for filing public comments. A public meeting is intended for the taking of public comment, and is not a contested case proceeding.

After the public comment deadline, the Executive Director prepares a response to all significant public comments on the application or the draft permit raised during the public comment period. The Chief Clerk then mails the Executive Director's response to comments and final decision to people who have filed comments, requested a contested case hearing, or requested to

City of Laredo

TPDES Permit No. WQ0010681006

Statement of Basis/Technical Summary and Executive Director's Preliminary Decision

be on the mailing list. This notice provides that if a person is not satisfied with the Executive Director's response and decision, they can request a contested case hearing or file a request to reconsider the Executive Director's decision within 30 days after the notice is mailed.


The Executive Director will issue the permit unless a written hearing request or request for reconsideration is filed within 30 days after the Executive Director's response to comments and final decision is mailed. If a hearing request or request for reconsideration is filed, the Executive Director will not issue the permit and will forward the application and request to the TCEQ Commissioners for their consideration at a scheduled Commission meeting. If a contested case hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

If the Executive Director calls a public meeting or the Commission grants a contested case hearing as described above, the Commission will give notice of the date, time, and place of the meeting or hearing. If a hearing request or request for reconsideration is made, the Commission will consider all public comments in making its decision and shall either adopt the Executive Director's response to public comments or prepare its own response.

For additional information about this application, contact Tong Li, E.I.T. at (512) 239-4653.



Tong Li, E.I.T.
Municipal Permits Team
Wastewater Permitting Section (MC 148)



Date



TPDES PERMIT NO.
WQ0010681006
*[For TCEQ office use only - EPA I.D.
No. TX0107395]*

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
P.O. Box 13087
Austin, Texas 78711-3087

This is a renewal that replaces TPDES
Permit No. WQ0010681006 issued on
October 7, 2015.

PERMIT TO DISCHARGE WASTES
under provisions of
Section 402 of the Clean Water Act
and Chapter 26 of the Texas Water Code

City of Laredo

whose mailing address is

1110 Houston Street
Laredo, Texas 78040

is authorized to treat and discharge wastes from the Laredo/Colombia Solidarity Bridge Wastewater
Treatment Facility, SIC Code 4952

located Approximately 1.1 miles southwest of Farm-to-Market Road 1472 and State Highway 255 on an
unnamed country road and 10.5 miles west-northwest of Farm-to-Market Roads 1472 and 3338,
adjacent to the Rio Grande, in Webb County, Texas 78045

directly to Rio Grande Below Amistad Reservoir in Segment No. 2304 of the Rio Grande Basin

only according to effluent limitations, monitoring requirements, and other conditions set forth in this
permit, as well as the rules of the Texas Commission on Environmental Quality (TCEQ), the laws of the
State of Texas, and other orders of the TCEQ. The issuance of this permit does not grant to the
permittee the right to use private or public property for conveyance of wastewater along the discharge
route described in this permit. This includes, but is not limited to, property belonging to any individual,
partnership, corporation or other entity. Neither does this permit authorize any invasion of personal
rights nor any violation of federal, state, or local laws or regulations. It is the responsibility of the
permittee to acquire property rights as may be necessary to use the discharge route.

This permit shall expire at midnight, **five years from the date of issuance.**

ISSUED DATE:

For the Commission

INTERIM EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTSOutfall Number 001

1. During the period beginning upon the date of issuance and lasting through the completion of expansion to the 0.16 million gallons per day (MGD) facility, the permittee is authorized to discharge subject to the following effluent limitations:

The daily average flow of effluent shall not exceed 0.035 MGD, nor shall the average discharge during any two-hour period (2-hour peak) exceed 69 gallons per minute (gpm).

<u>Effluent Characteristic</u>	<u>Discharge Limitations</u>				<u>Min. Self-Monitoring Requirements</u>	
	Daily Avg mg/l (lbs/day)	7-day Avg mg/l	Daily Max mg/l	Single Grab mg/l	Report Daily Avg. & Max. Single Grab Measurement Frequency	Sample Type
Flow, MGD	Report	N/A	Report	N/A	Five/week	Instantaneous
Biochemical Oxygen Demand (5-day)	20 (5.8)	30	45	65	One/week	Grab
Total Suspended Solids	20 (5.8)	30	45	65	One/week	Grab
<i>E. coli</i> , CFU or MPN/100 ml	126	N/A	N/A	399	One/quarter	Grab

2. The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes (based on peak flow), and shall be monitored five times per week by grab sample. An equivalent method of disinfection may be substituted only with prior approval of the Executive Director.
3. The pH shall not be less than 6.0 standard units nor greater than 9.0 standard units and shall be monitored once per month by grab sample.
4. There shall be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
5. Effluent monitoring samples shall be taken at the following location(s): Following the final treatment unit.
6. The effluent shall contain a minimum dissolved oxygen of 2.0 mg/l and shall be monitored once per week by grab sample.

FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTSOutfall Number 001

1. During the period beginning upon the completion of expansion to the 0.16 million gallons per day (MGD) facility and lasting through the date of expiration, the permittee is authorized to discharge subject to the following effluent limitations:

The daily average flow of effluent shall not exceed 0.16 MGD, nor shall the average discharge during any two-hour period (2-hour peak) exceed 311 gallons per minute (gpm).

<u>Effluent Characteristic</u>	<u>Discharge Limitations</u>				<u>Min. Self-Monitoring Requirements</u>	
	Daily Avg mg/l (lbs/day)	7-day Avg mg/l	Daily Max mg/l	Single Grab mg/l	Report Daily Avg. & Max. Measurement Frequency	Single Grab Sample Type
Flow, MGD	Report	N/A	Report	N/A	Continuous	Totalizing Meter
Biochemical Oxygen Demand (5-day)	20 (27)	30	45	65	One/week	Grab
Total Suspended Solids	20 (27)	30	45	65	One/week	Grab
<i>E. coli</i> , CFU or MPN/100 ml	126	N/A	N/A	399	One/month	Grab

2. The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes (based on peak flow), and shall be monitored five times per week by grab sample. An equivalent method of disinfection may be substituted only with prior approval of the Executive Director.
3. The pH shall not be less than 6.0 standard units nor greater than 9.0 standard units and shall be monitored once per month by grab sample.
4. There shall be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
5. Effluent monitoring samples shall be taken at the following location(s): Following the final treatment unit.
6. The effluent shall contain minimum dissolved oxygen of 2.0 mg/l and shall be monitored once per week by grab sample.

DEFINITIONS AND STANDARD PERMIT CONDITIONS

As required by Title 30 Texas Administrative Code (TAC) Chapter 305, certain regulations appear as standard conditions in waste discharge permits. 30 TAC § 305.121 - 305.129 (relating to Permit Characteristics and Conditions) as promulgated under the Texas Water Code (TWC) §§ 5.103 and 5.105, and the Texas Health and Safety Code (THSC) §§ 361.017 and 361.024(a), establish the characteristics and standards for waste discharge permits, including sewage sludge, and those sections of 40 Code of Federal Regulations (CFR) Part 122 adopted by reference by the Commission. The following text includes these conditions and incorporates them into this permit. All definitions in TWC § 26.001 and 30 TAC Chapter 305 shall apply to this permit and are incorporated by reference. Some specific definitions of words or phrases used in this permit are as follows:

1. Flow Measurements

- a. Annual average flow - the arithmetic average of all daily flow determinations taken within the preceding 12 consecutive calendar months. The annual average flow determination shall consist of daily flow volume determinations made by a totalizing meter, charted on a chart recorder and limited to major domestic wastewater discharge facilities with one million gallons per day or greater permitted flow.
- b. Daily average flow - the arithmetic average of all determinations of the daily flow within a period of one calendar month. The daily average flow determination shall consist of determinations made on at least four separate days. If instantaneous measurements are used to determine the daily flow, the determination shall be the arithmetic average of all instantaneous measurements taken during that month. Daily average flow determination for intermittent discharges shall consist of a minimum of three flow determinations on days of discharge.
- c. Daily maximum flow - the highest total flow for any 24-hour period in a calendar month.
- d. Instantaneous flow - the measured flow during the minimum time required to interpret the flow measuring device.
- e. 2-hour peak flow (domestic wastewater treatment plants) - the maximum flow sustained for a two-hour period during the period of daily discharge. The average of multiple measurements of instantaneous maximum flow within a two-hour period may be used to calculate the 2-hour peak flow.
- f. Maximum 2-hour peak flow (domestic wastewater treatment plants) - the highest 2-hour peak flow for any 24-hour period in a calendar month.

2. Concentration Measurements

- a. Daily average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar month, consisting of at least four separate representative measurements.
 - i. For domestic wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values in the previous four consecutive month period consisting of at least four measurements shall be utilized as the daily average concentration.

- ii. For all other wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values taken during the month shall be utilized as the daily average concentration.
- b. 7-day average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar week, Sunday through Saturday.
- c. Daily maximum concentration - the maximum concentration measured on a single day, by the sample type specified in the permit, within a period of one calendar month.
- d. Daily discharge - the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in terms of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the sampling day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the average measurement of the pollutant over the sampling day.

The daily discharge determination of concentration made using a composite sample shall be the concentration of the composite sample. When grab samples are used, the daily discharge determination of concentration shall be the arithmetic average (weighted by flow value) of all samples collected during that day.

- e. Bacteria concentration (*E. coli* or Enterococci) - Colony Forming Units (CFU) or Most Probable Number (MPN) of bacteria per 100 milliliters effluent. The daily average bacteria concentration is a geometric mean of the values for the effluent samples collected in a calendar month. The geometric mean shall be determined by calculating the n th root of the product of all measurements made in a calendar month, where n equals the number of measurements made; or, computed as the antilogarithm of the arithmetic mean of the logarithms of all measurements made in a calendar month. For any measurement of bacteria equaling zero, a substituted value of one shall be made for input into either computation method. If specified, the 7-day average for bacteria is the geometric mean of the values for all effluent samples collected during a calendar week.
 - f. Daily average loading (lbs/day) - the arithmetic average of all daily discharge loading calculations during a period of one calendar month. These calculations must be made for each day of the month that a parameter is analyzed. The daily discharge, in terms of mass (lbs/day), is calculated as (Flow, MGD x Concentration, mg/l x 8.34).
 - g. Daily maximum loading (lbs/day) - the highest daily discharge, in terms of mass (lbs/day), within a period of one calendar month.
3. Sample Type
- a. Composite sample - For domestic wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC § 319.9 (a). For industrial wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC § 319.9 (b).

- b. Grab sample - an individual sample collected in less than 15 minutes.
- 4. Treatment Facility (facility) - wastewater facilities used in the conveyance, storage, treatment, recycling, reclamation and/or disposal of domestic sewage, industrial wastes, agricultural wastes, recreational wastes, or other wastes including sludge handling or disposal facilities under the jurisdiction of the Commission.
- 5. The term "sewage sludge" is defined as solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in 30 TAC Chapter 312. This includes the solids that have not been classified as hazardous waste separated from wastewater by unit processes.
- 6. Bypass - the intentional diversion of a waste stream from any portion of a treatment facility.

MONITORING AND REPORTING REQUIREMENTS

1. Self-Reporting

Monitoring results shall be provided at the intervals specified in the permit. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall conduct effluent sampling and reporting in accordance with 30 TAC §§ 319.4 - 319.12. Unless otherwise specified, effluent monitoring data shall be submitted each month, to the Compliance Monitoring Team of the Enforcement Division (MC 224), by the 20th day of the following month for each discharge which is described by this permit whether or not a discharge is made for that month. Monitoring results must be submitted online using the NetDMR reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. Monitoring results must be signed and certified as required by Monitoring and Reporting Requirements No. 10.

As provided by state law, the permittee is subject to administrative, civil and criminal penalties, as applicable, for negligently or knowingly violating the Clean Water Act (CWA); TWC §§ 26, 27, and 28; and THSC § 361, including but not limited to knowingly making any false statement, representation, or certification on any report, record, or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance, or falsifying, tampering with or knowingly rendering inaccurate any monitoring device or method required by this permit or violating any other requirement imposed by state or federal regulations.

2. Test Procedures

- a. Unless otherwise specified in this permit, test procedures for the analysis of pollutants shall comply with procedures specified in 30 TAC §§ 319.11 - 319.12. Measurements, tests, and calculations shall be accurately accomplished in a representative manner.
- b. All laboratory tests submitted to demonstrate compliance with this permit must meet the requirements of 30 TAC § 25, Environmental Testing Laboratory Accreditation and Certification.

3. Records of Results

- a. Monitoring samples and measurements shall be taken at times and in a manner so as to be representative of the monitored activity.
- b. Except for records of monitoring information required by this permit related to the permittee's sewage sludge use and disposal activities, which shall be retained for a period

of at least five years (or longer as required by 40 CFR Part 503), monitoring and reporting records, including strip charts and records of calibration and maintenance, copies of all records required by this permit, records of all data used to complete the application for this permit, and the certification required by 40 CFR § 264.73(b)(9) shall be retained at the facility site, or shall be readily available for review by a TCEQ representative for a period of three years from the date of the record or sample, measurement, report, application or certification. This period shall be extended at the request of the Executive Director.

c. Records of monitoring activities shall include the following:

- i. date, time and place of sample or measurement;
- ii. identity of individual who collected the sample or made the measurement.
- iii. date and time of analysis;
- iv. identity of the individual and laboratory who performed the analysis;
- v. the technique or method of analysis; and
- vi. the results of the analysis or measurement and quality assurance/quality control records.

The period during which records are required to be kept shall be automatically extended to the date of the final disposition of any administrative or judicial enforcement action that may be instituted against the permittee.

4. Additional Monitoring by Permittee

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit using approved analytical methods as specified above, all results of such monitoring shall be included in the calculation and reporting of the values submitted on the approved self-report form. Increased frequency of sampling shall be indicated on the self-report form.

5. Calibration of Instruments

All automatic flow measuring or recording devices and all totalizing meters for measuring flows shall be accurately calibrated by a trained person at plant start-up and as often thereafter as necessary to ensure accuracy, but not less often than annually unless authorized by the Executive Director for a longer period. Such person shall verify in writing that the device is operating properly and giving accurate results. Copies of the verification shall be retained at the facility site and/or shall be readily available for review by a TCEQ representative for a period of three years.

6. Compliance Schedule Reports

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date to the Regional Office and the Compliance Monitoring Team of the Enforcement Division (MC 224).

7. Noncompliance Notification

- a. In accordance with 30 TAC § 305.125(9) any noncompliance which may endanger human health or safety, or the environment shall be reported by the permittee to the TCEQ. Except as allowed by 30 TAC § 305.132, report of such information shall be provided orally or by facsimile transmission (FAX) to the Regional Office within 24 hours of becoming aware of the noncompliance. A written submission of such information shall also be provided by the permittee to the Regional Office and the Compliance Monitoring Team of the Enforcement Division (MC 224) within five working days of becoming aware of the noncompliance. For Publicly Owned Treatment Works (POTWs), effective December 21, 2023, the permittee must submit the written report for unauthorized discharges and unanticipated bypasses that exceed any effluent limit in the permit using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. The written submission shall contain a description of the noncompliance and its cause; the potential danger to human health or safety, or the environment; the period of noncompliance, including exact dates and times; if the noncompliance has not been corrected, the time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance, and to mitigate its adverse effects.
 - b. The following violations shall be reported under Monitoring and Reporting Requirement 7.a.:
 - i. Unauthorized discharges as defined in Permit Condition 2(g).
 - ii. Any unanticipated bypass that exceeds any effluent limitation in the permit.
 - iii. Violation of a permitted maximum daily discharge limitation for pollutants listed specifically in the Other Requirements section of an Industrial TPDES permit.
 - c. In addition to the above, any effluent violation which deviates from the permitted effluent limitation by more than 40% shall be reported by the permittee in writing to the Regional Office and the Compliance Monitoring Team of the Enforcement Division (MC 224) within 5 working days of becoming aware of the noncompliance.
 - d. Any noncompliance other than that specified in this section, or any required information not submitted or submitted incorrectly, shall be reported to the Compliance Monitoring Team of the Enforcement Division (MC 224) as promptly as possible. For effluent limitation violations, noncompliances shall be reported on the approved self-report form.
8. In accordance with the procedures described in 30 TAC §§ 35.301 - 35.303 (relating to Water Quality Emergency and Temporary Orders) if the permittee knows in advance of the need for a bypass, it shall submit prior notice by applying for such authorization.
9. Changes in Discharges of Toxic Substances
- All existing manufacturing, commercial, mining, and silvicultural permittees shall notify the Regional Office, orally or by facsimile transmission within 24 hours, and both the Regional Office and the Compliance Monitoring Team of the Enforcement Division (MC 224) in writing within five (5) working days, after becoming aware of or having reason to believe:
- a. That any activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant listed at 40 CFR Part 122, Appendix D,

Tables II and III (excluding Total Phenols) which is not limited in the permit, if that discharge will exceed the highest of the following “notification levels”:

- i. One hundred micrograms per liter (100 µg/L);
 - ii. Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4,6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - iii. Five (5) times the maximum concentration value reported for that pollutant in the permit application; or
 - iv. The level established by the TCEQ.
- b. That any activity has occurred or will occur which would result in any discharge, on a nonroutine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following “notification levels”:
- i. Five hundred micrograms per liter (500 µg/L);
 - ii. One milligram per liter (1 mg/L) for antimony;
 - iii. Ten (10) times the maximum concentration value reported for that pollutant in the permit application; or
 - iv. The level established by the TCEQ.

10. Signatories to Reports

All reports and other information requested by the Executive Director shall be signed by the person and in the manner required by 30 TAC § 305.128 (relating to Signatories to Reports).

11. All POTWs must provide adequate notice to the Executive Director of the following:

- a. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to CWA § 301 or § 306 if it were directly discharging those pollutants;
- b. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit; and
- c. For the purpose of this paragraph, adequate notice shall include information on:
 - i. The quality and quantity of effluent introduced into the POTW; and
 - ii. Any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

PERMIT CONDITIONS

1. General

- a. When the permittee becomes aware that it failed to submit any relevant facts in a permit

application, or submitted incorrect information in an application or in any report to the Executive Director, it shall promptly submit such facts or information.

- b. This permit is granted on the basis of the information supplied and representations made by the permittee during action on an application, and relying upon the accuracy and completeness of that information and those representations. After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked, in whole or in part, in accordance with 30 TAC Chapter 305, Subchapter D, during its term for good cause including, but not limited to, the following:
 - i. Violation of any terms or conditions of this permit;
 - ii. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts; or
 - iii. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- c. The permittee shall furnish to the Executive Director, upon request and within a reasonable time, any information to determine whether cause exists for amending, revoking, suspending or terminating the permit. The permittee shall also furnish to the Executive Director, upon request, copies of records required to be kept by the permit.

2. Compliance

- a. Acceptance of the permit by the person to whom it is issued constitutes acknowledgment and agreement that such person will comply with all the terms and conditions embodied in the permit, and the rules and other orders of the Commission.
- b. The permittee has a duty to comply with all conditions of the permit. Failure to comply with any permit condition constitutes a violation of the permit and the Texas Water Code or the Texas Health and Safety Code, and is grounds for enforcement action, for permit amendment, revocation, or suspension, or for denial of a permit renewal application or an application for a permit for another facility.
- c. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit.
- d. The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal or other permit violation that has a reasonable likelihood of adversely affecting human health or the environment.
- e. Authorization from the Commission is required before beginning any change in the permitted facility or activity that may result in noncompliance with any permit requirements.
- f. A permit may be amended, suspended and reissued, or revoked for cause in accordance with 30 TAC §§ 305.62 and 305.66 and TWCS 7.302. The filing of a request by the permittee for a permit amendment, suspension and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
- g. There shall be no unauthorized discharge of wastewater or any other waste. For the

purpose of this permit, an unauthorized discharge is considered to be any discharge of wastewater into or adjacent to water in the state at any location not permitted as an outfall or otherwise defined in the Other Requirements section of this permit.

- h. In accordance with 30 TAC § 305.535(a), the permittee may allow any bypass to occur from a TPDES permitted facility which does not cause permitted effluent limitations to be exceeded or an unauthorized discharge to occur, but only if the bypass is also for essential maintenance to assure efficient operation.
- i. The permittee is subject to administrative, civil, and criminal penalties, as applicable, under TWC §§ 7.051 - 7.075 (relating to Administrative Penalties), 7.101 - 7.111 (relating to Civil Penalties), and 7.141 - 7.202 (relating to Criminal Offenses and Penalties) for violations including, but not limited to, negligently or knowingly violating the federal CWA §§ 301, 302, 306, 307, 308, 318, or 405, or any condition or limitation implementing any sections in a permit issued under the CWA § 402, or any requirement imposed in a pretreatment program approved under the CWA §§ 402 (a)(3) or 402 (b)(8).

3. Inspections and Entry

- a. Inspection and entry shall be allowed as prescribed in the TWC Chapters 26, 27, and 28, and THSC § 361.
- b. The members of the Commission and employees and agents of the Commission are entitled to enter any public or private property at any reasonable time for the purpose of inspecting and investigating conditions relating to the quality of water in the state or the compliance with any rule, regulation, permit or other order of the Commission. Members, employees, or agents of the Commission and Commission contractors are entitled to enter public or private property at any reasonable time to investigate or monitor or, if the responsible party is not responsive or there is an immediate danger to public health or the environment, to remove or remediate a condition related to the quality of water in the state. Members, employees, Commission contractors, or agents acting under this authority who enter private property shall observe the establishment's rules and regulations concerning safety, internal security, and fire protection, and if the property has management in residence, shall notify management or the person then in charge of his presence and shall exhibit proper credentials. If any member, employee, Commission contractor, or agent is refused the right to enter in or on public or private property under this authority, the Executive Director may invoke the remedies authorized in TWC § 7.002. The statement above, that Commission entry shall occur in accordance with an establishment's rules and regulations concerning safety, internal security, and fire protection, is not grounds for denial or restriction of entry to any part of the facility, but merely describes the Commission's duty to observe appropriate rules and regulations during an inspection.

4. Permit Amendment and/or Renewal

- a. The permittee shall give notice to the Executive Director as soon as possible of any planned physical alterations or additions to the permitted facility if such alterations or additions would require a permit amendment or result in a violation of permit requirements. Notice shall also be required under this paragraph when:
 - i. The alteration or addition to a permitted facility may meet one of the criteria for

determining whether a facility is a new source in accordance with 30 TAC § 305.534 (relating to New Sources and New Dischargers); or

- ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in the permit, nor to notification requirements in Monitoring and Reporting Requirements No. 9; or
 - iii. The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.
- b. Prior to any facility modifications, additions, or expansions that will increase the plant capacity beyond the permitted flow, the permittee must apply for and obtain proper authorization from the Commission before commencing construction.
 - c. The permittee must apply for an amendment or renewal at least 180 days prior to expiration of the existing permit in order to continue a permitted activity after the expiration date of the permit. If an application is submitted prior to the expiration date of the permit, the existing permit shall remain in effect until the application is approved, denied, or returned. If the application is returned or denied, authorization to continue such activity shall terminate upon the effective date of the action. If an application is not submitted prior to the expiration date of the permit, the permit shall expire and authorization to continue such activity shall terminate.
 - d. Prior to accepting or generating wastes which are not described in the permit application or which would result in a significant change in the quantity or quality of the existing discharge, the permittee must report the proposed changes to the Commission. The permittee must apply for a permit amendment reflecting any necessary changes in permit conditions, including effluent limitations for pollutants not identified and limited by this permit.
 - e. In accordance with the TWC § 26.029(b), after a public hearing, notice of which shall be given to the permittee, the Commission may require the permittee, from time to time, for good cause, in accordance with applicable laws, to conform to new or additional conditions.
 - f. If any toxic effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is promulgated under CWA § 307(a) for a toxic pollutant which is present in the discharge and that standard or prohibition is more stringent than any limitation on the pollutant in this permit, this permit shall be modified or revoked and reissued to conform to the toxic effluent standard or prohibition. The permittee shall comply with effluent standards or prohibitions established under CWA § 307(a) for toxic pollutants within the time provided in the regulations that established those standards or prohibitions, even if the permit has not yet been modified to incorporate the requirement.

5. Permit Transfer

- a. Prior to any transfer of this permit, Commission approval must be obtained. The Commission shall be notified in writing of any change in control or ownership of

facilities authorized by this permit. Such notification should be sent to the Applications Review and Processing Team (MC 148) of the Water Quality Division.

- b. A permit may be transferred only according to the provisions of 30 TAC § 305.64 (relating to Transfer of Permits) and 30 TAC § 50.133 (relating to Executive Director Action on Application or WQMP update).

6. Relationship to Hazardous Waste Activities

This permit does not authorize any activity of hazardous waste storage, processing, or disposal that requires a permit or other authorization pursuant to the Texas Health and Safety Code.

7. Relationship to Water Rights

Disposal of treated effluent by any means other than discharge directly to water in the state must be specifically authorized in this permit and may require a permit pursuant to TWC Chapter 11.

8. Property Rights

A permit does not convey any property rights of any sort, or any exclusive privilege.

9. Permit Enforceability

The conditions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstances, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

10. Relationship to Permit Application

The application pursuant to which the permit has been issued is incorporated herein; provided, however, that in the event of a conflict between the provisions of this permit and the application, the provisions of the permit shall control.

11. Notice of Bankruptcy

- a. Each permittee shall notify the Executive Director, in writing, immediately following the filing of a voluntary or involuntary petition for bankruptcy under any chapter of Title 11 (Bankruptcy) of the United States Code (11 USC) by or against:
 - i. the permittee;
 - ii. an entity (as that term is defined in 11 USC, § 101(14)) controlling the permittee or listing the permit or permittee as property of the estate; or
 - iii. an affiliate (as that term is defined in 11 USC, § 101(2)) of the permittee.
- b. This notification must indicate:
 - i. the name of the permittee and the permit number(s);
 - ii. the bankruptcy court in which the petition for bankruptcy was filed; and

- iii. the date of filing of the petition.

OPERATIONAL REQUIREMENTS

1. The permittee shall at all times ensure that the facility and all of its systems of collection, treatment, and disposal are properly operated and maintained. This includes, but is not limited to, the regular, periodic examination of wastewater solids within the treatment plant by the operator in order to maintain an appropriate quantity and quality of solids inventory as described in the various operator training manuals and according to accepted industry standards for process control. Process control, maintenance, and operations records shall be retained at the facility site, or shall be readily available for review by a TCEQ representative, for a period of three years.
2. Upon request by the Executive Director, the permittee shall take appropriate samples and provide proper analysis in order to demonstrate compliance with Commission rules. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall comply with all applicable provisions of 30 TAC Chapter 312 concerning sewage sludge use and disposal and 30 TAC §§ 319.21 - 319.29 concerning the discharge of certain hazardous metals.
3. Domestic wastewater treatment facilities shall comply with the following provisions:
 - a. The permittee shall notify the Municipal Permits Team, Wastewater Permitting Section (MC 148) of the Water Quality Division, in writing, of any facility expansion at least 90 days prior to conducting such activity.
 - b. The permittee shall submit a closure plan for review and approval to the Municipal Permits Team, Wastewater Permitting Section (MC 148) of the Water Quality Division, for any closure activity at least 90 days prior to conducting such activity. Closure is the act of permanently taking a waste management unit or treatment facility out of service and includes the permanent removal from service of any pit, tank, pond, lagoon, surface impoundment and/or other treatment unit regulated by this permit.
4. The permittee is responsible for installing prior to plant start-up, and subsequently maintaining, adequate safeguards to prevent the discharge of untreated or inadequately treated wastes during electrical power failures by means of alternate power sources, standby generators, and/or retention of inadequately treated wastewater.
5. Unless otherwise specified, the permittee shall provide a readily accessible sampling point and, where applicable, an effluent flow measuring device or other acceptable means by which effluent flow may be determined.
6. The permittee shall remit an annual water quality fee to the Commission as required by 30 TAC Chapter 21. Failure to pay the fee may result in revocation of this permit under TWC § 7.302(b)(6).
7. Documentation

For all written notifications to the Commission required of the permittee by this permit, the permittee shall keep and make available a copy of each such notification under the same conditions as self-monitoring data are required to be kept and made available. Except for

information required for TPDES permit applications, effluent data, including effluent data in permits, draft permits and permit applications, and other information specified as not confidential in 30 TAC §§ 1.5(d), any information submitted pursuant to this permit may be claimed as confidential by the submitter. Any such claim must be asserted in the manner prescribed in the application form or by stamping the words confidential business information on each page containing such information. If no claim is made at the time of submission, information may be made available to the public without further notice. If the Commission or Executive Director agrees with the designation of confidentiality, the TCEQ will not provide the information for public inspection unless required by the Texas Attorney General or a court pursuant to an open records request. If the Executive Director does not agree with the designation of confidentiality, the person submitting the information will be notified.

8. Facilities that generate domestic wastewater shall comply with the following provisions; domestic wastewater treatment facilities at permitted industrial sites are excluded.
 - a. Whenever flow measurements for any domestic sewage treatment facility reach 75% of the permitted daily average or annual average flow for three consecutive months, the permittee must initiate engineering and financial planning for expansion and/or upgrading of the domestic wastewater treatment and/or collection facilities. Whenever the flow reaches 90% of the permitted daily average or annual average flow for three consecutive months, the permittee shall obtain necessary authorization from the Commission to commence construction of the necessary additional treatment and/or collection facilities. In the case of a domestic wastewater treatment facility which reaches 75% of the permitted daily average or annual average flow for three consecutive months, and the planned population to be served or the quantity of waste produced is not expected to exceed the design limitations of the treatment facility, the permittee shall submit an engineering report supporting this claim to the Executive Director of the Commission.

If in the judgment of the Executive Director the population to be served will not cause permit noncompliance, then the requirement of this section may be waived. To be effective, any waiver must be in writing and signed by the Director of the Enforcement Division (MC 219) of the Commission, and such waiver of these requirements will be reviewed upon expiration of the existing permit; however, any such waiver shall not be interpreted as condoning or excusing any violation of any permit parameter.

- b. The plans and specifications for domestic sewage collection and treatment works associated with any domestic permit must be approved by the Commission and failure to secure approval before commencing construction of such works or making a discharge is a violation of this permit and each day is an additional violation until approval has been secured.
 - c. Permits for domestic wastewater treatment plants are granted subject to the policy of the Commission to encourage the development of area-wide waste collection, treatment, and disposal systems. The Commission reserves the right to amend any domestic wastewater permit in accordance with applicable procedural requirements to require the system covered by this permit to be integrated into an area-wide system, should such be developed; to require the delivery of the wastes authorized to be collected in, treated by or discharged from said system, to such area-wide system; or to amend this permit in any other particular to effectuate the Commission's policy. Such amendments may be

made when the changes required are advisable for water quality control purposes and are feasible on the basis of waste treatment technology, engineering, financial, and related considerations existing at the time the changes are required, exclusive of the loss of investment in or revenues from any then existing or proposed waste collection, treatment or disposal system.

9. Domestic wastewater treatment plants shall be operated and maintained by sewage plant operators holding a valid certificate of competency at the required level as defined in 30 TAC Chapter 30.
10. For Publicly Owned Treatment Works (POTWs), the 30-day average (or monthly average) percent removal for BOD and TSS shall not be less than 85%, unless otherwise authorized by this permit.
11. Facilities that generate industrial solid waste as defined in 30 TAC § 335.1 shall comply with these provisions:
 - a. Any solid waste, as defined in 30 TAC § 335.1 (including but not limited to such wastes as garbage, refuse, sludge from a waste treatment, water supply treatment plant or air pollution control facility, discarded materials, discarded materials to be recycled, whether the waste is solid, liquid, or semisolid), generated by the permittee during the management and treatment of wastewater, must be managed in accordance with all applicable provisions of 30 TAC Chapter 335, relating to Industrial Solid Waste Management.
 - b. Industrial wastewater that is being collected, accumulated, stored, or processed before discharge through any final discharge outfall, specified by this permit, is considered to be industrial solid waste until the wastewater passes through the actual point source discharge and must be managed in accordance with all applicable provisions of 30 TAC Chapter 335.
 - c. The permittee shall provide written notification, pursuant to the requirements of 30 TAC § 335.8(b)(1), to the Corrective Action Section (MC 221) of the Remediation Division informing the Commission of any closure activity involving an Industrial Solid Waste Management Unit, at least 90 days prior to conducting such an activity.
 - d. Construction of any industrial solid waste management unit requires the prior written notification of the proposed activity to the Registration and Reporting Section (MC 129) of the Permitting and Registration Support Division. No person shall dispose of industrial solid waste, including sludge or other solids from wastewater treatment processes, prior to fulfilling the deed recordation requirements of 30 TAC § 335.5.
 - e. The term “industrial solid waste management unit” means a landfill, surface impoundment, waste-pile, industrial furnace, incinerator, cement kiln, injection well, container, drum, salt dome waste containment cavern, or any other structure vessel, appurtenance, or other improvement on land used to manage industrial solid waste.
 - f. The permittee shall keep management records for all sludge (or other waste) removed from any wastewater treatment process. These records shall fulfill all applicable requirements of 30 TAC § 335 and must include the following, as it pertains to wastewater treatment and discharge:

- i. Volume of waste and date(s) generated from treatment process;
- ii. Volume of waste disposed of on-site or shipped off-site;
- iii. Date(s) of disposal;
- iv. Identity of hauler or transporter;
- v. Location of disposal site; and
- vi. Method of final disposal.

The above records shall be maintained on a monthly basis. The records shall be retained at the facility site, or shall be readily available for review by authorized representatives of the TCEQ for at least five years.

- 12. For industrial facilities to which the requirements of 30 TAC § 335 do not apply, sludge and solid wastes, including tank cleaning and contaminated solids for disposal, shall be disposed of in accordance with THSC § 361.

TCEQ Revision 08/2008

SLUDGE PROVISIONS

The permittee is authorized to dispose of sludge only at a Texas Commission on Environmental Quality (TCEQ) authorized land application site, co-disposal landfill, wastewater treatment facility, or facility that further processes sludge. **The disposal of sludge by land application on property owned, leased or under the direct control of the permittee is a violation of the permit unless the site is authorized with the TCEQ. This provision does not authorize Distribution and Marketing of Class A or Class AB Sewage Sludge. This provision does not authorize the permittee to land apply sludge on property owned, leased or under the direct control of the permittee.**

SECTION I. REQUIREMENTS APPLYING TO ALL SEWAGE SLUDGE LAND APPLICATION

A. General Requirements

1. The permittee shall handle and dispose of sewage sludge in accordance with 30 TAC § 312 and all other applicable state and federal regulations in a manner that protects public health and the environment from any reasonably anticipated adverse effects due to any toxic pollutants that may be present in the sludge.
2. In all cases, if the person (permit holder) who prepares the sewage sludge supplies the sewage sludge to another person for land application use or to the owner or lease holder of the land, the permit holder shall provide necessary information to the parties who receive the sludge to assure compliance with these regulations.

B. Testing Requirements

1. Sewage sludge shall be tested once during the term of this permit in accordance with the method specified in both 40 CFR Part 261, Appendix II and 40 CFR Part 268, Appendix I [Toxicity Characteristic Leaching Procedure (TCLP)] or other method that receives the prior approval of the TCEQ for the contaminants listed in 40 CFR Part 261.24, Table 1. Sewage sludge failing this test shall be managed according to RCRA standards for generators of hazardous waste, and the waste's disposition must be in accordance with all applicable requirements for hazardous waste processing, storage, or disposal. Following failure of any TCLP test, the management or disposal of sewage sludge at a facility other than an authorized hazardous waste processing, storage, or disposal facility shall be prohibited until such time as the permittee can demonstrate the sewage sludge no longer exhibits the hazardous waste toxicity characteristics (as demonstrated by the results of the TCLP tests). A written report shall be provided to both the TCEQ Registration and Reporting Section (MC 129) of the Permitting and Registration Support Division and the Regional Director (MC Region 16) within seven (7) days after failing the TCLP Test.

The report shall contain test results, certification that unauthorized waste management has stopped and a summary of alternative disposal plans that comply with RCRA standards for the management of hazardous waste. The report shall be addressed to: Director, Permitting and Registration Support Division (MC 129), Texas Commission on Environmental Quality, P.O. Box 13087, Austin, Texas 78711-3087. In addition, the permittee shall prepare an annual report on the results of all sludge toxicity testing. This annual report shall be submitted to the TCEQ Regional Office (MC Region 16) and the Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30th of each year. Effective December 21, 2020, the permittee must submit this annual report using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver.

2. Sewage sludge shall not be applied to the land if the concentration of the pollutants exceeds the pollutant concentration criteria in Table 1. The frequency of testing for pollutants in Table 1 is found in Section I.C. of this permit.

TABLE 1

<u>Pollutant</u>	<u>Ceiling Concentration</u> <u>(Milligrams per kilogram)*</u>
Arsenic	75
Cadmium	85
Chromium	3000
Copper	4300
Lead	840
Mercury	57
Molybdenum	75
Nickel	420
PCBs	49
Selenium	100
Zinc	7500

* Dry weight basis

3. Pathogen Control

All sewage sludge that is applied to agricultural land, forest, a public contact site, or a reclamation site must be treated by one of the following methods to ensure that the sludge meets either the Class A, Class AB or Class B pathogen requirements.

- a. For sewage sludge to be classified as Class A with respect to pathogens, the density of fecal coliform in the sewage sludge must be less than 1,000 most probable number (MPN) per gram of total solids (dry weight basis), or the density of Salmonella sp. bacteria in the sewage sludge must be less than three MPN per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed. In addition, one of the alternatives listed below must be met:

Alternative 1 - The temperature of the sewage sludge that is used or disposed shall be maintained at or above a specific value for a period of time. See 30 TAC § 312.82(a)(2)(A) for specific information;

Alternative 5 (PFRP) - Sewage sludge that is used or disposed of must be treated in one of the Processes to Further Reduce Pathogens (PFRP) described in 40 CFR Part 503, Appendix B. PFRP include composting, heat drying, heat treatment, and thermophilic aerobic digestion; or

Alternative 6 (PFRP Equivalent) - Sewage sludge that is used or disposed of must be treated in a process that has been approved by the U. S. Environmental Protection Agency as being equivalent to those in Alternative 5.

- b. For sewage sludge to be classified as Class AB with respect to pathogens, the density of fecal coliform in the sewage sludge must be less than 1,000 MPN per gram of total solids (dry weight basis), or the density of *Salmonella* sp. bacteria in the sewage sludge be less than three MPN per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed. In addition, one of the alternatives listed below must be met:

Alternative 2 - The pH of the sewage sludge that is used or disposed shall be raised to above 12 std. units and shall remain above 12 std. units for 72 hours.

The temperature of the sewage sludge shall be above 52° Celsius for 12 hours or longer during the period that the pH of the sewage sludge is above 12 std. units.

At the end of the 72-hour period during which the pH of the sewage sludge is above 12 std. units, the sewage sludge shall be air dried to achieve a percent solids in the sewage sludge greater than 50%; or

Alternative 3 - The sewage sludge shall be analyzed for enteric viruses prior to pathogen treatment. The limit for enteric viruses is less than one Plaque-forming Unit per four grams of total solids (dry weight basis) either before or following pathogen treatment. See 30 TAC § 312.82(a)(2)(C)(i-iii) for specific information. The sewage sludge shall be analyzed for viable helminth ova prior to pathogen treatment. The limit for viable helminth ova is less than one per four grams of total solids (dry weight basis) either before or following pathogen treatment. See 30 TAC § 312.82(a)(2)(C)(iv-vi) for specific information; or

Alternative 4 - The density of enteric viruses in the sewage sludge shall be less than one Plaque-forming Unit per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed. The density of viable helminth ova in the sewage sludge shall be less than one per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed.

- c. Sewage sludge that meets the requirements of Class AB sewage sludge may be classified a Class A sewage sludge if a variance request is submitted in writing that is supported by substantial documentation demonstrating equivalent methods for reducing odors and written approval is granted by the executive director. The executive director may deny the variance request or revoke that approved variance if it is determined that the variance may potentially endanger human health or the environment, or create nuisance odor conditions.
- d. Three alternatives are available to demonstrate compliance with Class B criteria for

sewage sludge.

Alternative 1

- i. A minimum of seven random samples of the sewage sludge shall be collected within 48 hours of the time the sewage sludge is used or disposed of during each monitoring episode for the sewage sludge.
- ii. The geometric mean of the density of fecal coliform in the samples collected shall be less than either 2,000,000 MPN per gram of total solids (dry weight basis) or 2,000,000 Colony Forming Units per gram of total solids (dry weight basis).

Alternative 2 - Sewage sludge that is used or disposed of shall be treated in one of the Processes to Significantly Reduce Pathogens (PSRP) described in 40 CFR Part 503, Appendix B, so long as all of the following requirements are met by the generator of the sewage sludge.

- i. Prior to use or disposal, all the sewage sludge must have been generated from a single location, except as provided in paragraph v. below;
- ii. An independent Texas Licensed Professional Engineer must make a certification to the generator of a sewage sludge that the wastewater treatment facility generating the sewage sludge is designed to achieve one of the PSRP at the permitted design loading of the facility. The certification need only be repeated if the design loading of the facility is increased. The certification shall include a statement indicating the design meets all the applicable standards specified in Appendix B of 40 CFR Part 503;
- iii. Prior to any off-site transportation or on-site use or disposal of any sewage sludge generated at a wastewater treatment facility, the chief certified operator of the wastewater treatment facility or other responsible official who manages the processes to significantly reduce pathogens at the wastewater treatment facility for the permittee, shall certify that the sewage sludge underwent at least the minimum operational requirements necessary in order to meet one of the PSRP. The acceptable processes and the minimum operational and record keeping requirements shall be in accordance with established U.S. Environmental Protection Agency final guidance;
- iv. All certification records and operational records describing how the requirements of this paragraph were met shall be kept by the generator for a minimum of three years and be available for inspection by commission staff for review; and
- v. If the sewage sludge is generated from a mixture of sources, resulting from a person who prepares sewage sludge from more than one wastewater treatment facility, the resulting derived product shall meet one of the PSRP, and shall meet the certification, operation, and record keeping requirements of this paragraph.

Alternative 3 - Sewage sludge shall be treated in an equivalent process that has been approved by the U.S. Environmental Protection Agency, so long as all of the following requirements are met by the generator of the sewage sludge.

- i. Prior to use or disposal, all the sewage sludge must have been generated from a

single location, except as provided in paragraph v. below;

- ii. Prior to any off-site transportation or on-site use or disposal of any sewage sludge generated at a wastewater treatment facility, the chief certified operator of the wastewater treatment facility or other responsible official who manages the processes to significantly reduce pathogens at the wastewater treatment facility for the permittee, shall certify that the sewage sludge underwent at least the minimum operational requirements necessary in order to meet one of the PSRP. The acceptable processes and the minimum operational and record keeping requirements shall be in accordance with established U.S. Environmental Protection Agency final guidance;
- iii. All certification records and operational records describing how the requirements of this paragraph were met shall be kept by the generator for a minimum of three years and be available for inspection by commission staff for review;
- iv. The Executive Director will accept from the U.S. Environmental Protection Agency a finding of equivalency to the defined PSRP; and
- v. If the sewage sludge is generated from a mixture of sources resulting from a person who prepares sewage sludge from more than one wastewater treatment facility, the resulting derived product shall meet one of the Processes to Significantly Reduce Pathogens, and shall meet the certification, operation, and record keeping requirements of this paragraph.

In addition to the Alternatives 1 – 3, the following site restrictions must be met if Class B sludge is land applied:

- i. Food crops with harvested parts that touch the sewage sludge/soil mixture and are totally above the land surface shall not be harvested for 14 months after application of sewage sludge.
- ii. Food crops with harvested parts below the surface of the land shall not be harvested for 20 months after application of sewage sludge when the sewage sludge remains on the land surface for 4 months or longer prior to incorporation into the soil.
- iii. Food crops with harvested parts below the surface of the land shall not be harvested for 38 months after application of sewage sludge when the sewage sludge remains on the land surface for less than 4 months prior to incorporation into the soil.
- iv. Food crops, feed crops, and fiber crops shall not be harvested for 30 days after application of sewage sludge.
- v. Animals shall not be allowed to graze on the land for 30 days after application of sewage sludge.
- vi. Turf grown on land where sewage sludge is applied shall not be harvested for 1 year after application of the sewage sludge when the harvested turf is placed on either land with a high potential for public exposure or a lawn.

- vii. Public access to land with a high potential for public exposure shall be restricted for 1 year after application of sewage sludge.
 - viii. Public access to land with a low potential for public exposure shall be restricted for 30 days after application of sewage sludge.
 - ix. Land application of sludge shall be in accordance with the buffer zone requirements found in 30 TAC § 312.44.
4. Vector Attraction Reduction Requirements

All bulk sewage sludge that is applied to agricultural land, forest, a public contact site, or a reclamation site shall be treated by one of the following Alternatives 1 through 10 for vector attraction reduction.

- Alternative 1 - The mass of volatile solids in the sewage sludge shall be reduced by a minimum of 38%.
- Alternative 2 - If Alternative 1 cannot be met for an anaerobically digested sludge, demonstration can be made by digesting a portion of the previously digested sludge anaerobically in the laboratory in a bench-scale unit for 40 additional days at a temperature between 30° and 37° Celsius. Volatile solids must be reduced by less than 17% to demonstrate compliance.
- Alternative 3 - If Alternative 1 cannot be met for an aerobically digested sludge, demonstration can be made by digesting a portion of the previously digested sludge with percent solids of two percent or less aerobically in the laboratory in a bench-scale unit for 30 additional days at 20° Celsius. Volatile solids must be reduced by less than 15% to demonstrate compliance.
- Alternative 4 - The specific oxygen uptake rate (SOUR) for sewage sludge treated in an aerobic process shall be equal to or less than 1.5 milligrams of oxygen per hour per gram of total solids (dry weight basis) at a temperature of 20° Celsius.
- Alternative 5 - Sewage sludge shall be treated in an aerobic process for 14 days or longer. During that time, the temperature of the sewage sludge shall be higher than 40° Celsius and the average temperature of the sewage sludge shall be higher than 45° Celsius.
- Alternative 6 - The pH of sewage sludge shall be raised to 12 or higher by alkali addition and, without the addition of more alkali shall remain at 12 or higher for two hours and then remain at a pH of 11.5 or higher for an additional 22 hours at the time the sewage sludge is prepared for sale or given away in a bag or other container.
- Alternative 7 - The percent solids of sewage sludge that does not contain unstabilized solids generated in a primary wastewater treatment process shall be equal to or greater than 75% based on the moisture content and total solids prior to mixing with other materials. Unstabilized solids are

defined as organic materials in sewage sludge that have not been treated in either an aerobic or anaerobic treatment process.

Alternative 8 - The percent solids of sewage sludge that contains unstabilized solids generated in a primary wastewater treatment process shall be equal to or greater than 90% based on the moisture content and total solids prior to mixing with other materials at the time the sludge is used. Unstabilized solids are defined as organic materials in sewage sludge that have not been treated in either an aerobic or anaerobic treatment process.

Alternative 9 -

- i. Sewage sludge shall be injected below the surface of the land.
- ii. No significant amount of the sewage sludge shall be present on the land surface within one hour after the sewage sludge is injected.
- iii. When sewage sludge that is injected below the surface of the land is Class A or Class AB with respect to pathogens, the sewage sludge shall be injected below the land surface within eight hours after being discharged from the pathogen treatment process.

Alternative 10 -

- i. Sewage sludge applied to the land surface or placed on a surface disposal site shall be incorporated into the soil within six hours after application to or placement on the land.
- ii. When sewage sludge that is incorporated into the soil is Class A or Class AB with respect to pathogens, the sewage sludge shall be applied to or placed on the land within eight hours after being discharged from the pathogen treatment process.

C. Monitoring Requirements

Toxicity Characteristic Leaching Procedure (TCLP) Test	- once during the term of this permit
PCBs	- once during the term of this permit

All metal constituents and fecal coliform or *Salmonella* sp. bacteria shall be monitored at the appropriate frequency shown below, pursuant to 30 TAC § 312.46(a)(1):

<u>Amount of sewage sludge (*) metric tons per 365-day period</u>	<u>Monitoring Frequency</u>
0 to less than 290	Once/Year
290 to less than 1,500	Once/Quarter
1,500 to less than 15,000	Once/Two Months
15,000 or greater	Once/Month

(*) *The amount of bulk sewage sludge applied to the land (dry wt. basis).*

Representative samples of sewage sludge shall be collected and analyzed in accordance with the methods referenced in 30 TAC § 312.7

Identify each of the analytic methods used by the facility to analyze enteric viruses, fecal coliforms, helminth ova, *Salmonella* sp., and other regulated parameters.

Identify in the following categories (as applicable) the sewage sludge treatment process or processes at the facility: preliminary operations (e.g., sludge grinding and degritting), thickening (concentration), stabilization, anaerobic digestion, aerobic digestion, composting, conditioning, disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization), dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons), heat drying, thermal reduction, and methane or biogas capture and recovery.

Identify the nature of material generated by the facility (such as a biosolid for beneficial use or land-farming, or sewage sludge for disposal at a monofill) and whether the material is ultimately conveyed off-site in bulk or in bags.

SECTION II. REQUIREMENTS SPECIFIC TO BULK SEWAGE SLUDGE FOR APPLICATION TO THE LAND MEETING CLASS A, CLASS AB or B PATHOGEN REDUCTION AND THE CUMULATIVE LOADING RATES IN TABLE 2, OR CLASS B PATHOGEN REDUCTION AND THE POLLUTANT CONCENTRATIONS IN TABLE 3

For those permittees meeting Class A, Class AB or B pathogen reduction requirements and that meet the cumulative loading rates in Table 2 below, or the Class B pathogen reduction requirements and contain concentrations of pollutants below listed in Table 3, the following conditions apply:

A. Pollutant Limits

Table 2

<u>Pollutant</u>	<u>Cumulative Pollutant Loading Rate (pounds per acre)*</u>
Arsenic	36
Cadmium	35
Chromium	2677
Copper	1339
Lead	268
Mercury	15
Molybdenum	Report Only
Nickel	375
Selenium	89
Zinc	2500

Table 3

<u>Pollutant</u>	<u>Monthly Average Concentration (milligrams per kilogram)*</u>
Arsenic	41
Cadmium	39
Chromium	1200
Copper	1500
Lead	300
Mercury	17
Molybdenum	Report Only
Nickel	420
Selenium	36
Zinc	2800

*Dry weight basis

B. Pathogen Control

All bulk sewage sludge that is applied to agricultural land, forest, a public contact site, a reclamation site, shall be treated by either Class A, Class AB or Class B pathogen reduction requirements as defined above in Section I.B.3.

C. Management Practices

1. Bulk sewage sludge shall not be applied to agricultural land, forest, a public contact site, or a reclamation site that is flooded, frozen, or snow-covered so that the bulk sewage sludge enters a wetland or other waters in the State.
2. Bulk sewage sludge not meeting Class A requirements shall be land applied in a manner which complies with Applicability in accordance with 30 TAC §312.41 and the Management Requirements in accordance with 30 TAC § 312.44.
3. Bulk sewage sludge shall be applied at or below the agronomic rate of the cover crop.
4. An information sheet shall be provided to the person who receives bulk sewage sludge sold or given away. The information sheet shall contain the following information:
 - a. The name and address of the person who prepared the sewage sludge that is sold or given away in a bag or other container for application to the land.
 - b. A statement that application of the sewage sludge to the land is prohibited except in accordance with the instruction on the label or information sheet.
 - c. The annual whole sludge application rate for the sewage sludge application rate for the sewage sludge that does not cause any of the cumulative pollutant loading rates in Table 2 above to be exceeded, unless the pollutant concentrations in Table 3 found in Section II above are met.

D. Notification Requirements

1. If bulk sewage sludge is applied to land in a State other than Texas, written notice shall be provided prior to the initial land application to the permitting authority for the State in which the bulk sewage sludge is proposed to be applied. The notice shall include:
 - a. The location, by street address, and specific latitude and longitude, of each land application site.
 - b. The approximate time period bulk sewage sludge will be applied to the site.
 - c. The name, address, telephone number, and National Pollutant Discharge Elimination System permit number (if appropriate) for the person who will apply the bulk sewage sludge.
2. The permittee shall give 180 days prior notice to the Executive Director in care of the Wastewater Permitting Section (MC 148) of the Water Quality Division of any change planned in the sewage sludge disposal practice.

E. Record keeping Requirements

The sludge documents will be retained at the facility site and/or shall be readily available for review by a TCEQ representative. The person who prepares bulk sewage sludge or a sewage sludge material shall develop the following information and shall retain the information at

the facility site and/or shall be readily available for review by a TCEQ representative for a period of five years. If the permittee supplies the sludge to another person who land applies the sludge, the permittee shall notify the land applier of the requirements for record keeping found in 30 TAC § 312.47 for persons who land apply.

1. The concentration (mg/kg) in the sludge of each pollutant listed in Table 3 above and the applicable pollutant concentration criteria (mg/kg), or the applicable cumulative pollutant loading rate and the applicable cumulative pollutant loading rate limit (lbs/ac) listed in Table 2 above.
2. A description of how the pathogen reduction requirements are met (including site restrictions for Class AB and Class B sludge, if applicable).
3. A description of how the vector attraction reduction requirements are met.
4. A description of how the management practices listed above in Section II.C are being met.
5. The following certification statement:

“I certify, under penalty of law, that the applicable pathogen requirements in 30 TAC § 312.82(a) or (b) and the vector attraction reduction requirements in 30 TAC § 312.83(b) have been met for each site on which bulk sewage sludge is applied. This determination has been made under my direction and supervision in accordance with the system designed to ensure that qualified personnel properly gather and evaluate the information used to determine that the management practices have been met. I am aware that there are significant penalties for false certification including fine and imprisonment.”

6. The recommended agronomic loading rate from the references listed in Section II.C.3. above, as well as the actual agronomic loading rate shall be retained. The person who applies bulk sewage sludge or a sewage sludge material shall develop the following information and shall retain the information at the facility site and/or shall be readily available for review by a TCEQ representative indefinitely. If the permittee supplies the sludge to another person who land applies the sludge, the permittee shall notify the land applier of the requirements for record keeping found in 30 TAC § 312.47 for persons who land apply:
 - a. A certification statement that all applicable requirements (specifically listed) have been met, and that the permittee understands that there are significant penalties for false certification including fine and imprisonment. See 30 TAC § 312.47(a)(4)(A)(ii) or 30 TAC § 312.47(a)(5)(A)(ii), as applicable, and to the permittee's specific sludge treatment activities.
 - b. The location, by street address, and specific latitude and longitude, of each site on which sludge is applied.
 - c. The number of acres in each site on which bulk sludge is applied.
 - d. The date and time sludge is applied to each site.

- e. The cumulative amount of each pollutant in pounds/acre listed in Table 2 applied to each site.
- f. The total amount of sludge applied to each site in dry tons.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

F. Reporting Requirements

The permittee shall report annually to the TCEQ Regional Office (MC Region 16) and Compliance Monitoring Team (MC 224) of the Enforcement Division, by September 30th of each year the following information. Effective December 21, 2020, the permittee must submit this annual report using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver.

1. Identify in the following categories (as applicable) the sewage sludge treatment process or processes at the facility: preliminary operations (e.g., sludge grinding and degritting), thickening (concentration), stabilization, anaerobic digestion, aerobic digestion, composting, conditioning, disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization), dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons), heat drying, thermal reduction, and methane or biogas capture and recovery.
2. Identify the nature of material generated by the facility (such as a biosolid for beneficial use or land-farming, or sewage sludge for disposal at a monofill) and whether the material is ultimately conveyed off-site in bulk or in bags.
3. Results of tests performed for pollutants found in either Table 2 or 3 as appropriate for the permittee's land application practices.
4. The frequency of monitoring listed in Section I.C. that applies to the permittee.
5. Toxicity Characteristic Leaching Procedure (TCLP) results.
6. PCB concentration in sludge in mg/kg.
7. Identity of hauler(s) and TCEQ transporter number.
8. Date(s) of transport.
9. Texas Commission on Environmental Quality registration number, if applicable.
10. Amount of sludge disposal dry weight (lbs/acre) at each disposal site.
11. The concentration (mg/kg) in the sludge of each pollutant listed in Table 1 (defined as a monthly average) as well as the applicable pollutant concentration criteria (mg/kg) listed in Table 3 above, or the applicable pollutant loading rate limit (lbs/acre) listed in Table 2 above if it exceeds 90% of the limit.
12. Level of pathogen reduction achieved (Class A, Class AB or Class B).
13. Alternative used as listed in Section I.B.3.(a. or b.). Alternatives describe how the pathogen reduction requirements are met. If Class B sludge, include information on how site restrictions were met.

14. Identify each of the analytic methods used by the facility to analyze enteric viruses, fecal coliforms, helminth ova, *Salmonella* sp., and other regulated parameters.
15. Vector attraction reduction alternative used as listed in Section I.B.4.
16. Amount of sludge transported in dry tons/year.
17. The certification statement listed in either 30 TAC § 312.47(a)(4)(A)(ii) or 30 TAC § 312.47(a)(5)(A)(ii) as applicable to the permittee's sludge treatment activities, shall be attached to the annual reporting form.
18. When the amount of any pollutant applied to the land exceeds 90% of the cumulative pollutant loading rate for that pollutant, as described in Table 2, the permittee shall report the following information as an attachment to the annual reporting form.
 - a. The location, by street address, and specific latitude and longitude.
 - b. The number of acres in each site on which bulk sewage sludge is applied.
 - c. The date and time bulk sewage sludge is applied to each site.
 - d. The cumulative amount of each pollutant (i.e., pounds/acre) listed in Table 2 in the bulk sewage sludge applied to each site.
 - e. The amount of sewage sludge (i.e., dry tons) applied to each site.

The above records shall be maintained on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

**SECTION III. REQUIREMENTS APPLYING TO ALL SEWAGE SLUDGE
DISPOSED IN A MUNICIPAL SOLID WASTE LANDFILL**

- A. The permittee shall handle and dispose of sewage sludge in accordance with 30 TAC § 330 and all other applicable state and federal regulations to protect public health and the environment from any reasonably anticipated adverse effects due to any toxic pollutants that may be present. The permittee shall ensure that the sewage sludge meets the requirements in 30 TAC § 330 concerning the quality of the sludge disposed in a municipal solid waste landfill.
- B. If the permittee generates sewage sludge and supplies that sewage sludge to the owner or operator of a municipal solid waste landfill (MSWLF) for disposal, the permittee shall provide to the owner or operator of the MSWLF appropriate information needed to be in compliance with the provisions of this permit.
- C. The permittee shall give 180 days prior notice to the Executive Director in care of the Wastewater Permitting Section (MC 148) of the Water Quality Division of any change planned in the sewage sludge disposal practice.
- D. Sewage sludge shall be tested once during the term of this permit in accordance with the method specified in both 40 CFR Part 261, Appendix II and 40 CFR Part 268, Appendix I (Toxicity Characteristic Leaching Procedure) or other method, which receives the prior approval of the TCEQ for contaminants listed in Table 1 of 40 CFR § 261.24. Sewage sludge failing this test shall be managed according to RCRA standards for generators of hazardous waste, and the waste's disposition must be in accordance with all applicable requirements for hazardous waste processing, storage, or disposal.

Following failure of any TCLP test, the management or disposal of sewage sludge at a facility other than an authorized hazardous waste processing, storage, or disposal facility shall be prohibited until such time as the permittee can demonstrate the sewage sludge no longer exhibits the hazardous waste toxicity characteristics (as demonstrated by the results of the TCLP tests). A written report shall be provided to both the TCEQ Registration and Reporting Section (MC 129) of the Permitting and Registration Support Division and the Regional Director (MC Region 16) of the appropriate TCEQ field office within 7 days after failing the TCLP Test.

The report shall contain test results, certification that unauthorized waste management has stopped and a summary of alternative disposal plans that comply with RCRA standards for the management of hazardous waste. The report shall be addressed to: Director, Permitting and Registration Support Division (MC 129), Texas Commission on Environmental Quality, P. O. Box 13087, Austin, Texas 78711-3087. In addition, the permittee shall prepare an annual report on the results of all sludge toxicity testing. This annual report shall be submitted to the TCEQ Regional Office (MC Region 16) and the Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30 of each year.

- E. Sewage sludge shall be tested as needed, in accordance with the requirements of 30 TAC Chapter 330.
- F. Record keeping Requirements

The permittee shall develop the following information and shall retain the information for five years.

1. The description (including procedures followed and the results) of all liquid Paint Filter Tests performed.
2. The description (including procedures followed and results) of all TCLP tests performed.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

G. Reporting Requirements

The permittee shall report annually to the TCEQ Regional Office (MC Region 16) and Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30th of each year the following information. Effective December 21, 2020, the permittee must submit this annual report using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver.

1. Identify in the following categories (as applicable) the sewage sludge treatment process or processes at the facility: preliminary operations (e.g., sludge grinding and degritting), thickening (concentration), stabilization, anaerobic digestion, aerobic digestion, composting, conditioning, disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization), dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons), heat drying, thermal reduction, and methane or biogas capture and recovery.
2. Toxicity Characteristic Leaching Procedure (TCLP) results.
3. Annual sludge production in dry tons/year.
4. Amount of sludge disposed in a municipal solid waste landfill in dry tons/year.
5. Amount of sludge transported interstate in dry tons/year.
6. A certification that the sewage sludge meets the requirements of 30 TAC § 330 concerning the quality of the sludge disposed in a municipal solid waste landfill.
7. Identity of hauler(s) and transporter registration number.
8. Owner of disposal site(s).
9. Location of disposal site(s).
10. Date(s) of disposal.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

SECTION IV. REQUIREMENTS APPLYING TO SLUDGE TRANSPORTED TO ANOTHER FACILITY FOR FURTHER PROCESSING

These provisions apply to sludge that is transported to another wastewater treatment facility or facility that further processes sludge. These provisions are intended to allow transport of sludge to facilities that have been authorized to accept sludge. These provisions do not limit the ability of the receiving facility to determine whether to accept the sludge, nor do they limit the ability of the receiving facility to request additional testing or documentation.

A. General Requirements

1. The permittee shall handle and dispose of sewage sludge in accordance with 30 TAC Chapter 312 and all other applicable state and federal regulations in a manner that protects public health and the environment from any reasonably anticipated adverse effects due to any toxic pollutants that may be present in the sludge.
2. Sludge may only be transported using a registered transporter or using an approved pipeline.

B. Record Keeping Requirements

1. For sludge transported by an approved pipeline, the permittee must maintain records of the following:
 - a. the amount of sludge transported;
 - b. the date of transport;
 - c. the name and TCEQ permit number of the receiving facility or facilities;
 - d. the location of the receiving facility or facilities;
 - e. the name and TCEQ permit number of the facility that generated the waste; and
 - f. copy of the written agreement between the permittee and the receiving facility to accept sludge.
2. For sludge transported by a registered transporter, the permittee must maintain records of the completed trip tickets in accordance with 30 TAC § 312.145(a)(1)-(7) and amount of sludge transported.
3. The above records shall be maintained on-site on a monthly basis and shall be made available to the TCEQ upon request. These records shall be retained for at least five years.

C. Reporting Requirements

The permittee shall report the following information annually to the TCEQ Regional Office (MC Region 16) and Compliance Monitoring Team (MC 224) of the Enforcement Division, by September 30th of each year. Effective December 21, 2020, the permittee must submit this annual report using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver.

1. Identify in the following categories (as applicable) the sewage sludge treatment process or processes at the facility: preliminary operations (e.g., sludge grinding and degritting), thickening (concentration), stabilization, anaerobic digestion, aerobic digestion, composting, conditioning, disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization), dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons), heat drying, thermal reduction, and methane or biogas capture and recovery.
2. the annual sludge production;
3. the amount of sludge transported;
4. the owner of each receiving facility;
5. the location of each receiving facility; and
6. the date(s) of disposal at each receiving facility.

TCEQ Revision 10/2019

OTHER REQUIREMENTS

1. The permittee shall employ or contract with one or more licensed wastewater treatment facility operators or wastewater system operations companies holding a valid license or registration according to the requirements of 30 TAC Chapter 30, Occupational Licenses and Registrations, and in particular 30 TAC Chapter 30, Subchapter J, Wastewater Operators and Operations Companies.

This Category D * in the interim phase and Category C in the final phase facility must be operated by a chief operator or an operator holding a Category D * license in the interim phase and C license in the final phase license or higher. The facility must be operated a minimum of five days per week by the licensed chief operator or an operator holding the required level of license or higher. The licensed chief operator or operator holding the required level of license or higher must be available by telephone or pager seven days per week. Where shift operation of the wastewater treatment facility is necessary, each shift that does not have the on-site supervision of the licensed chief operator must be supervised by an operator in charge who is licensed not less than one level below the category for the facility.

*A Class D Wastewater Treatment Operator license is not renewable for operators of a facility listed in 30 TAC Section 30.342(c) and must be upgraded to a Class C Wastewater Treatment Operator license or higher prior to the expiration date of the Class D license.

2. The facility is not located in the Coastal Management Program boundary.
3. The permittee shall comply with the requirements of 30 TAC § 309.13(a) through (d). In addition, by ownership of the required buffer zone area, the permittee shall comply with the requirements of 30 TAC § 309.13(e).
4. The permittee shall provide facilities for the protection of its wastewater treatment facility from a 100-year flood.
5. In accordance with 30 TAC § 319.9, a permittee that has at least twelve months of uninterrupted compliance with its bacteria limit may notify the commission in writing of its compliance and request a less frequent measurement schedule. To request a less frequent schedule, the permittee shall submit a written request to the TCEQ Wastewater Permitting Section (MC 148) for each phase that includes a different monitoring frequency. The request must contain all of the reported bacteria values (Daily Avg. and Daily Max/Single Grab) for the twelve consecutive months immediately prior to the request. If the Executive Director finds that a less frequent measurement schedule is protective of human health and the environment, the permittee may be given a less frequent measurement schedule. For this permit, 1/quarter may be reduced to 1/6 months in the Interim phase and 1/month may be reduced to 1/quarter in the Final phase. **A violation of any bacteria limit by a facility that has been granted a less frequent measurement schedule will require the permittee to return to the standard frequency schedule and submit written notice to the TCEQ Wastewater Permitting Section (MC 148).** The permittee may not apply for another reduction in measurement frequency for at least 24 months from the date of the last violation. The Executive Director may establish a more frequent measurement schedule if necessary to protect human health or the environment.
6. Prior to construction of the Final phase treatment facilities, the permittee shall submit to the TCEQ Wastewater Permitting Section (MC 148) a summary transmittal letter in accordance

with the requirements in 30 TAC § 217.6(d). If requested by the Wastewater Permitting Section, the permittee shall submit plans, specifications, and a final engineering design report which comply with 30 TAC Chapter 217, Design Criteria for Domestic Wastewater Systems. The permittee shall clearly show how the treatment system will meet the effluent limitations required on Page 2a of this permit. A copy of the summary transmittal letter shall be available at the plant site for inspection by authorized representatives of the TCEQ.

7. The permittee shall notify the TCEQ Regional Office (MC Region 16) and the Applications Review and Processing Team (MC 148) of the Water Quality Division, in writing at least forty-five (45) days prior to the completion of the new facilities on Notification of Completion Form 20007.
8. The permittee is authorized to use secondary effluent from this facility to irrigate 6.63 acres of non-public access land (see Attachment A) with the following conditions:
 - a. The permittee shall maintain and operate the treatment facility in order to achieve optimum efficiency of treatment capability. This shall include required monitoring of effluent flow and quality as well as appropriate grounds and building maintenance.
 - b. Irrigation practices shall be designed and managed so as to prevent ponding of effluent or contamination of ground and surface waters and to prevent the occurrence of nuisance conditions in the area. Tailwater control facilities shall be provided as necessary to prevent the discharge of any effluent from the irrigated land.
 - c. Application rates for the irrigated land shall not exceed 5.91 acre-feet/acre/year. The permittee is responsible for providing equipment to determine application rates and maintaining accurate records of the volume of effluent applied. These records shall be made available for review by the Texas Commission on Environmental Quality and shall be maintained for at least three years.
 - d. Holding or storage ponds shall conform to the design criteria for stabilization ponds with regard to construction and levee design and shall maintain a minimum freeboard of two feet according to 30 TAC § 217, Design Criteria for Domestic Wastewater Systems.
 - e. The permittee shall obtain representative soil samples from the root zones of the land application area receiving wastewater. Composite sampling techniques shall be used. Each composite sample shall represent no more than 6.63 acres, with no less than 10 subsamples representing each composite sample. Subsamples shall be composited by like sampling depth and soil type for analysis and reporting. Soil types are soils that have like topsoil or plow layer textures. These soils shall be sampled individually from 0 to 6 inches, 6 inches to 18 inches and 18 inches to 30 inches below ground level. The permittee shall sample soils in December to February of each year. Soil samples shall be analyzed within 30 days of sample collection.

The permittee shall provide annual soil analyses of the land application area according to the following table:

Parameter	Method	Minimum Analytical Level (MAL)	Reporting units
pH	2:1 (v/v) water to soil mixture		Reported to 0.1 pH units after calibration of pH meter
Electrical Conductivity	2:1 (v/v) water to soil mixture	0.01	dS/m (same as mmho/cm)
Nitrate-nitrogen	From a 1 <u>N</u> KCl soil extract	1	mg/kg (dry weight basis)
Ammonium-nitrogen			
Total Kjeldahl Nitrogen (TKN)	For determination of Organic plus Ammonium Nitrogen. Procedures that use Mercury (Hg) are not acceptable.	20	mg/kg (dry weight basis)
Total Nitrogen	= TKN + nitrate-nitrogen (same as, organic-nitrogen + ammonium-nitrogen + nitrate-nitrogen)		mg/kg (dry weight basis)
Plant-available: Phosphorus (P)	Mehlich III with inductively coupled plasma	1 (P)	mg/kg (dry weight basis)
Plant-available: Potassium (K)	May be determined in the same Mehlich III extract with inductively coupled plasma	5 (K)	mg/kg (dry weight basis)

The permittee shall provide a copy of this plan to the analytical laboratory prior to sample analysis. The permittee shall submit the results of the annual soil sample analyses with copies of the laboratory reports and a map depicting the areas that have received wastewater within the permanent land application fields to the TCEQ Regional Office (MC Region 16) and the Enforcement Division (MC 224) no later than end of September following the sampling date of each year. If wastewater is not applied in a particular year, the permittee shall notify the same TCEQ offices and indicate that wastewater and/or sludge has not been applied on the approved land disposal sites during that year.

- f. The permittee shall erect adequate signs stating that the irrigation water is from a non-potable water supply for any area where treated effluent is stored or where there exist hose bibs or faucets. Signs shall consist of a red slash superimposed over the international symbol for drinking water accompanied by the message "DO NOT DRINK THE WATER" in both English and Spanish. All piping transporting the effluent shall be clearly marked with these same signs.

- g. Spray fixtures for the irrigation system shall be of such design that they cannot be operated by unauthorized personnel.
- h. Irrigation with effluent shall be accomplished only when the area specified is not in use.

CONTRIBUTING INDUSTRIES AND PRETREATMENT REQUIREMENTS

1. The permittee shall operate an industrial pretreatment program in accordance with Sections 402(b)(8) and (9) of the Clean Water Act, the General Pretreatment Regulations (40 CFR Part 403), and the approved **City of Laredo** publicly owned treatment works (POTW) pretreatment program submitted by the permittee. The pretreatment program was approved on **December 29, 2005**.

The legal authority and the POTW's pretreatment program are not in compliance with the current 40 CFR Part 403 regulations [*rev. Federal Register/ Vol. 70/ No. 198/ Friday, October 14, 2005/ Rules and Regulations, pages 60134-60798*] and 30 TAC Chapter 315, as amended. The permittee submitted a modification to their pretreatment program containing some or all of the required [*i.e.* more stringent] Streamlining Rule provisions to the TCEQ on **October 4, 2011**, and revisions in **January 2017**. The Executive Director is currently reviewing this modification. If after review of the modification submission, the Executive Director determines that the submission does not comply with applicable requirements, including 40 CFR §§403.8 and 403.9, the Executive Director will notify the permittee. According to 40 CFR §403.11(c), the notification will include suggested modifications to bring the modification submission into compliance with applicable requirements, including 40 CFR §§403.8(b) and (f), and 403.9(b). In such a case, revised information will be necessary for the Executive Director to make a determination on whether to approve or deny the permittee's modification submission.

The POTW pretreatment program is hereby incorporated by reference and shall be implemented in a manner consistent with the following requirements:

- a. Industrial user (IU) information shall be kept current according to 40 CFR §§403.8(f)(2)(i) and (ii) and updated at a frequency set forth in the approved pretreatment program to reflect the accurate characterization of all IUs.
- b. The frequency and nature of IU compliance monitoring activities by the permittee shall be consistent with the approved POTW pretreatment program and commensurate with the character, consistency, and volume of waste. The permittee is required to inspect and sample the effluent from each significant industrial user (SIU) at least once per year, except as specified in 40 CFR §403.8(f)(2)(v). This is in addition to any industrial self-monitoring activities.
- c. The permittee shall enforce and obtain remedies for IU noncompliance with applicable pretreatment standards and requirements and the approved POTW pretreatment program.
- d. The permittee shall control through permit, order, or similar means, the contribution to the POTW by each IU to ensure compliance with applicable pretreatment standards and requirements and the approved POTW pretreatment program. In the case of SIUs (identified as significant under 40 CFR §403.3(v)), this control shall be achieved through individual permits or general control mechanisms, in accordance with 40 CFR §403.8(f)(1)(iii).

Both individual and general control mechanisms must be enforceable and contain, at a minimum, the following conditions:

- (1) Statement of duration (in no case more than five years);

- (2) Statement of non-transferability without, at a minimum, prior notification to the POTW and provision of a copy of the existing control mechanism to the new owner or operator;
 - (3) Effluent limits, which may include enforceable best management practices (BMPs), based on applicable general pretreatment standards, categorical pretreatment standards, local limits, and State and local law;
 - (4) Self-monitoring, sampling, reporting, notification and record keeping requirements, identification of the pollutants to be monitored (including, if applicable, the process for seeking a waiver for a pollutant neither present nor expected to be present in the IU's discharge in accordance with 40 CFR §403.12(e)(2), or a specific waived pollutant in the case of an individual control mechanism), sampling location, sampling frequency, and sample type, based on the applicable general pretreatment standards in 40 CFR Part 403, categorical pretreatment standards, local limits, and State and local law;
 - (5) Statement of applicable civil and criminal penalties for violation of pretreatment standards and requirements, and any applicable compliance schedule. Such schedules may not extend the compliance date beyond federal deadlines; and
 - (6) Requirements to control slug discharges, if determined by the POTW to be necessary.
 - e. For those IUs who are covered by a general control mechanism, in order to implement 40 CFR §403.8(f)(1)(iii)(A)(2), a monitoring waiver for a pollutant neither present nor expected to be present in the IU's discharge is not effective in the general control mechanism until after the POTW has provided written notice to the SIU that such a waiver request has been granted in accordance with 40 CFR §403.12(e)(2).
 - f. The permittee shall evaluate whether each SIU needs a plan or other action to control slug discharges, in accordance with 40 CFR §403.8(f)(2)(vi). If the POTW decides that a slug control plan is needed, the plan shall contain at least the minimum elements required in 40 CFR §403.8(f)(2)(vi).
 - g. The permittee shall provide adequate staff, equipment, and support capabilities to carry out all elements of the pretreatment program.
 - h. The approved program shall not be modified by the permittee without the prior approval of the Executive Director, according to 40 CFR §403.18.
2. The permittee is under a continuing duty to establish and enforce specific local limits to implement the provisions of 40 CFR §403.5, develop and enforce local limits as necessary, and modify the approved pretreatment program as necessary to comply with federal, state, and local law, as amended. The permittee may develop BMPs to implement 40 CFR §403.5(c)(1) and (2). Such BMPs shall be considered local limits and pretreatment standards. The permittee is required to effectively enforce such limits and to modify its pretreatment program, including the Legal Authority, Enforcement Response Plan, and Standard Operating Procedures (including forms), if required by the Executive Director to reflect changing conditions at the POTW. Substantial modifications will be approved in accordance with 40 CFR §403.18, and modifications will become effective upon approval by the Executive Director in accordance with 40 CFR §403.18.

The permittee is required to effectively enforce such limits and to modify their pretreatment

program, including the Legal Authority, Enforcement Response Plan and/or Standard Operating Procedures, if required by the Executive Director to reflect changing conditions at the POTW. Substantial modifications will be approved in accordance with 40 CFR §403.18, and modifications will become effective upon approval by the Executive Director in accordance with 40 CFR §403.18.

3. The permittee shall prepare annually a list of IUs, which during the preceding twelve (12) months were in significant noncompliance (SNC) with applicable pretreatment requirements. For the purposes of this section of the permit, "CONTRIBUTING INDUSTRIES AND PRETREATMENT REQUIREMENTS," SNC shall be determined based upon the more stringent of either criteria established at 40 CFR §403.8(f)(2)(viii) [rev. 10/14/05] or criteria established in the approved POTW pretreatment program. This list is to be published annually during the month of **January** in a newspaper of general circulation that provides meaningful public notice within the jurisdiction(s) served by the POTW.

In addition, each **January** the permittee shall submit an updated pretreatment program annual status report, in accordance with 40 CFR §§403.12(i) [rev. 10/22/15] and (m), to the TCEQ Pretreatment Team (MC148) of the Water Quality Division. The report summary shall be submitted on the Pretreatment Performance Summary (PPS) form [TCEQ-20218]. The report shall contain the following information as well as the information on the tables in this section:

- a. An updated list of all regulated IUs as indicated in this section. For each listed IU, the following information shall be included:
 - (1) Standard Industrial Classification (SIC) or North American Industry Classification System (NAICS) code *and* categorical determination.
 - (2) If the pretreatment program has been modified and approved to incorporate reduced monitoring for any of the categorical IUs as provided by 40 CFR Part 403 [rev. 10/14/05], then the list must also identify:
 - categorical IUs subject to the conditions for reduced monitoring and reporting requirements under 40 CFR § 403.12(e)(1) [rev. 10/22/15] and (3);
 - those IUs that are non-significant categorical industrial users (NSCIUs) under 40 CFR §403.3(v)(2); and
 - those IUs that are middle tier categorical industrial users (MTCIUs) under 40 CFR §403.12(e)(3).
 - (3) Control mechanism status.
 - Indicate whether the IU has an effective individual or general control mechanism, and the date such control mechanism was last issued, reissued, or modified;
 - Indicate which IUs were added to the system, or newly identified, during the pretreatment year reporting period;

- Include the type of general control mechanisms; and
 - Report all NSCIU annual evaluations performed, as applicable.
- (4) A summary of all compliance monitoring activities performed by the POTW during the pretreatment year reporting period. The following information shall be reported:
- Total number of inspections performed; and
 - Total number of sampling events conducted.
- (5) Status of IU compliance with effluent limitations, reporting, and narrative standard (which may include enforceable BMPs, narrative limits, and/or operational standards) requirements. Compliance status shall be defined as follows:
- Compliant (C) - no violations during the pretreatment year reporting period;
 - Non-compliant (NC) - one or more violations during the pretreatment year reporting period but does not meet the criteria for SNC; and
 - Significant Noncompliance (SNC) - in accordance with requirements described above in this section.
- (6) For noncompliant IUs, indicate the nature of the violations, the type and number of actions taken (notice of violation, administrative order, criminal or civil suit, fines or penalties collected, etc.), and the current compliance status. If any IU was on a schedule to attain compliance with effluent limits or narrative standards, indicate the date the schedule was issued and the date compliance is to be attained.
- b. A list of each IU whose authorization to discharge was terminated or revoked during the pretreatment year reporting period and the reason for termination.
- c. A report on any interference, pass through, Act of God, or POTW permit violations known or suspected to be caused by IUs and response actions taken by the permittee.
- d. The results of all influent and effluent analyses performed pursuant to Item 3 of this section.
- e. An original newspaper public notice, or copy of the newspaper publication with official affidavit, of the list of IUs that meet the criteria of SNC, giving the name of the newspaper and date the list was published.
- f. The daily average water quality based effluent concentrations (from the TCEQ's Texas Toxicity Modeling Program (TexTox)) necessary to attain the Texas Surface Water Quality Standards, 30 TAC Chapter 307, in water in the state.
- g. The maximum allowable headworks loading (MAHL) in pounds per day (lb/day) of the approved TBLLs or for each pollutant of concern (POC) for which the permittee

has calculated a MAHL. In addition, the influent loading as a percent of the MAHL, using the annual average flow of the wastewater treatment plant in million gallons per day (MGD) during the pretreatment year reporting period, for each pollutant that has an adopted TBLL or for each POC for which the permittee has calculated a MAHL. (*See Endnotes No. 2 at the end of this section for the influent loading as a percent of the MAHL equation.*)

- h. The permittee may submit the updated pretreatment program annual status report information in tabular form using the example table format provided. Please attach, on a separate sheet, explanations to document the various pretreatment activities, including IU permits that have expired, BMP violations, and any sampling events that were not conducted by the permittee as required.
- i. A summary of changes to the POTW's approved pretreatment program that have not been previously reported to the Approval Authority.

Effective December 21, 2023, the permittee must submit the updated pretreatment program annual status report required by this section electronically using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. [*rev. Federal Register/ Vol. 80/ No. 204/ Friday, October 22, 2015/ Rules and Regulations, pages 64064-64158*].

- 4. The permittee shall provide adequate written notification to the Executive Director, care of the Wastewater Permitting Section (MC 148) of the Water Quality Division, within 30 days of the permittee's knowledge of the following:
 - a. Any new introduction of pollutants into the treatment works from an indirect discharger that would be subject to Sections 301 and 306 of the Clean Water Act, if the indirect discharger was directly discharging those pollutants; and
 - b. Any substantial change in the volume or character of pollutants being introduced into the treatment works by a source introducing pollutants into the treatment works at the time of issuance of the permit.

Adequate notice shall include information on the quality and quantity of effluent to be introduced into the treatment works and any anticipated impact of the change on the quality or quantity of effluent to be discharged from the POTW.

Revised June 2020

TPDES Pretreatment Program Annual Report Form for Updated Industrial Users List**Reporting month/year:** _____, _____ **to** _____, _____**TPDES Permit No.:** _____ **Permittee:** _____ **Treatment Plant:** _____

PRETREATMENT PROGRAM STATUS REPORT UPDATED INDUSTRIAL USERS ¹ LIST																	
Industrial User Name	SIC or NAICS Code	CIU ²	CONTROL MECHANISM				New User ³ (Y or N)	Times Inspected by the CA	Times Sampled by the CA	COMPLIANCE STATUS During the Pretreatment Year Reporting Period ⁴ (C = Compliant, NC = Noncompliant, SNC= Significant Noncompliance)							
			Y/N or NR ⁵	IND or GEN or NR	Last Action ⁶	TBLLs or TBLLs only ⁷				REPORTS				NSCIU Certifications	Effluent Limits	Narrative Standards	
										BMR	90-Day	Semi-Annual	Self-Monitoring ⁸				

- 1 Include all significant industrial users (SIUs), non-significant categorical industrial users (NSCIUs) as defined in 40 CFR §403.3(v)(2), and/or middle tier categorical industrial users (MTCIUs) as defined in 40 CFR §403.12(e)(3). Please do not include non-significant noncategorical IUs that are covered under best management practices (BMPs) or general control mechanisms.
- 2 Categorical determination (include 40 CFR citation and NSCIU or MTCIU status, if applicable).
- 3 Indicate whether the IU is a new user. If the answer is No or N, then indicate the expiration date of the last issued IU permit.
- 4 The term SNC applies to a broader range of violations, such as daily maximum, long-term average, instantaneous limits, and narrative standards (which may include enforceable BMPs, narrative limits and/or operational standards). Any other violation, or group of violations, which the POTW determines will adversely affect the operation or implementation of the local Pretreatment Program now includes BMP violations (40 CFR §403.8(f)(2)(viii)(H)).
- 5 Code NR= None required (NSCIUs only); IND = individual control mechanism; GEN = general control mechanism. Include as a footnote (or on a separate page) the name of the general control mechanism used for similar groups of IUs, identify the similar types of operations and types of wastes that are the same for each general control mechanism. Any BMPs through general control mechanisms that are applied to nonsignificant IUs need to be reported separately, *e.g.* the sector type and BMP description.
- 6 Permit or NSCIU evaluations as applicable.
- 7 According to 40 CFR §403.12(i)(1), indicate whether the IU is subject to technically based local limits (TBLLs) that are more stringent than categorical pretreatment standards, *e.g.* where there is one end-of-pipe sampling point at a CIU, and you have determined that the TBLLs are more stringent than the categorical pretreatment standards for any pollutant at the end-of-pipe sampling point; **OR** the IU is subject only to local limits (TBLLs only), *e.g.* the IU is a non-categorical SIU subject only to TBLLs at the end-of-pipe sampling point.
- 8 For those IUs where a monitoring waiver has been granted, please add the code "W" (after either C, NC, or SNC codes) and indicate the pollutant(s) for which the waiver has been granted.

**TPDES Pretreatment Program Annual Report Form for
Industrial User Inventory Modifications**

Reporting month/year: _____, _____ **to** _____, _____

TPDES Permit No: _____ **Permittee:** _____ **Treatment Plant:** _____

INDUSTRIAL USER INVENTORY MODIFICATIONS					
FACILITY NAME, ADDRESS AND CONTACT PERSON	ADD, CHANGE, DELETE (Including categorical reclassification to NSCIU or MTCIU)	IF DELETION: Reason For Deletion	IF ADDITION OR SIGNIFICANT CHANGE:		
			PROCESS DESCRIPTION	POLLUTANTS (Including any sampling waiver given for each pollutant not present)	FLOW RATE ⁹ (In gpd) R = Regulated U = Unregulated T = Total

9 For NSCIUs, total flow must be given, if regulated flow is not determined.

TPDES Pretreatment Program Annual Report Form for Enforcement Actions Taken**Reporting month/year:** _____, _____ to _____, _____**TPDES Permit No:** _____ **Permittee:** _____ **Treatment Plant:** _____**Overall SNC** _____% **SNC ¹⁰ based on:** **Effluent Violations** _____%
Reporting Violations _____% **Narrative Standard Violations** _____%

Noncompliant Industrial Users - Enforcement Actions Taken															
Industrial User Name	Nature of Violation ¹¹				Number of Actions Taken					Penalties Collected (Do not Include Surcharge)	Compliance Schedule			Current Status Returned to Compliance: (Y or N)	Comments
	Effluent Limits	Reports	NSCIU Certifications	Narrative Standards	NOV	A.O.	Civil	Criminal	Other		Y or N	Date Issued	Date Due		

10 # %

_____ Pretreatment Standards [WENDB-PSNC] (Local Limits/Categorical Standards)


_____ Reporting Requirements [WENDB-PSNC]

_____ Narrative Standards

11 Please specify a separate number for each type of violation, *e.g.* report, notification, and/or NSCIU certification.



PLUMMER

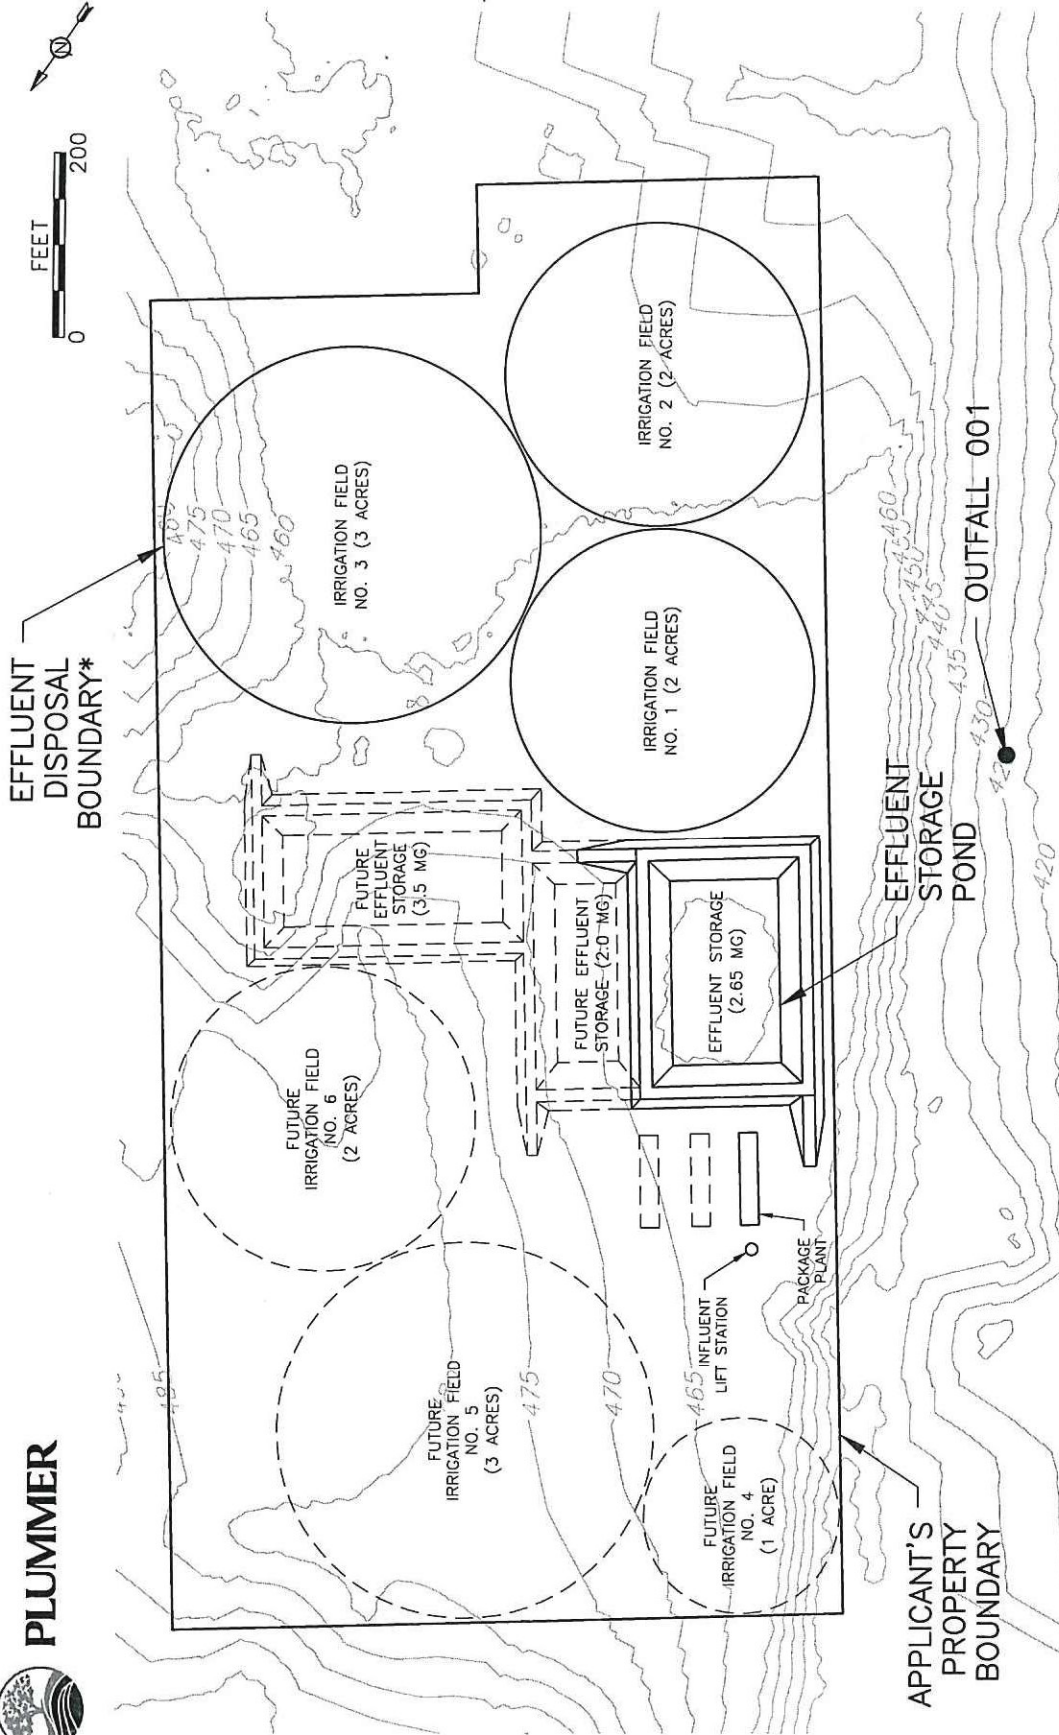

NOTE:
PREVAILING WIND DIRECTION
SOUTH-EASTERLY WIND

* LAND DISPOSAL OF EFFLUENT
HAS NEVER COMMENCED

Attachment A
City of Laredo
TPDES Permit No. WQ0010681006